

WHERE NEW WALK ABUTS ADJOINING WALK, SAWCUT EXISTING WALK TO NEAREST JOINT AND INSTALL EXPANSION JOINT.

EXPANSION JOINT LOCATIONS AND SPACING PER ITEM 608.03.

WATER AND UTILITY BOXES IN THE SIDEWALK AREA SHALL BE ADJUSTED FLUSH WITH FINAL SURFACE.

ROOF DRAINS SHALL BE EXTENDED UNDER THE SIDEWALK AND THROUGH THE CURB. SEE STD DWG 2320.

WHEN A SIDEWALK IS CONSTRUCTED FOR THE ENTIRE WIDTH FROM THE CURB TO THE R/W LINE, THE WALK SHALL BE CONSTRUCTED PART WIDTH AT A TIME, ALLOWING FOR SUFFICIENT UNOBSTRUCTED AREA 48" WIDE FOR SAFE MOVEMENT OF PEDESTRIAN TRAFFIC, OR AS APPROVED BY ENGINEER.


ITEM NUMBERS REFER TO THE CITY OF COLUMBUS CMSC, CURRENT EDITION. ALL WORK SHALL BE DONE IN ACCORDANCE WITH THESE SPECIFICATIONS.

\* #57 AGGREGATE MAY BE USED FOR REPLACEMENT WORK.

\*\* THE SAND TO CEMENT RATIO IS 5 PARTS SAND TO ONE PART CEMENT.

RESIDENTIAL

## BRICK SIDEWALK

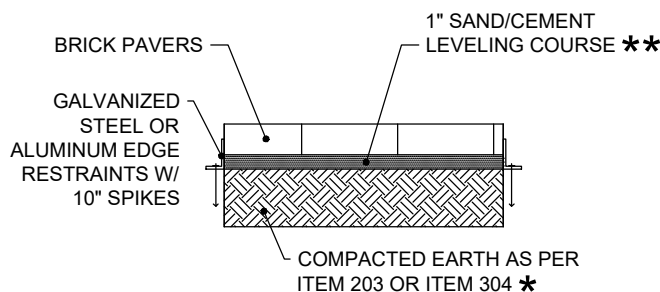

DETAIL

CITY OF COLUMBUS, OHIO  
DEPARTMENT OF PUBLIC SERVICE  
DIVISION OF DESIGN AND CONSTRUCTION

CITY ENGINEER

STD DWG  
2301

04/30/18

SHT 1 OF 3