


PEDESTRIAN PAD (PP) TYPE 2 CONDITION-CONNECTED ADJACENT TO CURB

GENERAL NOTES:

1. RAMP AND LANDING MUST BE CONSTRUCTED TO DRAIN, TYPICALLY TOWARDS THE ROADWAY, BUT MAY VARY BASED ON EXISTING TOPOGRAPHY. WEEP HOLES ARE NOT PERMITTED FOR DRAINAGE.
2. SEE SHEET 2 FOR ADDITIONAL DETAILED INFORMATION.

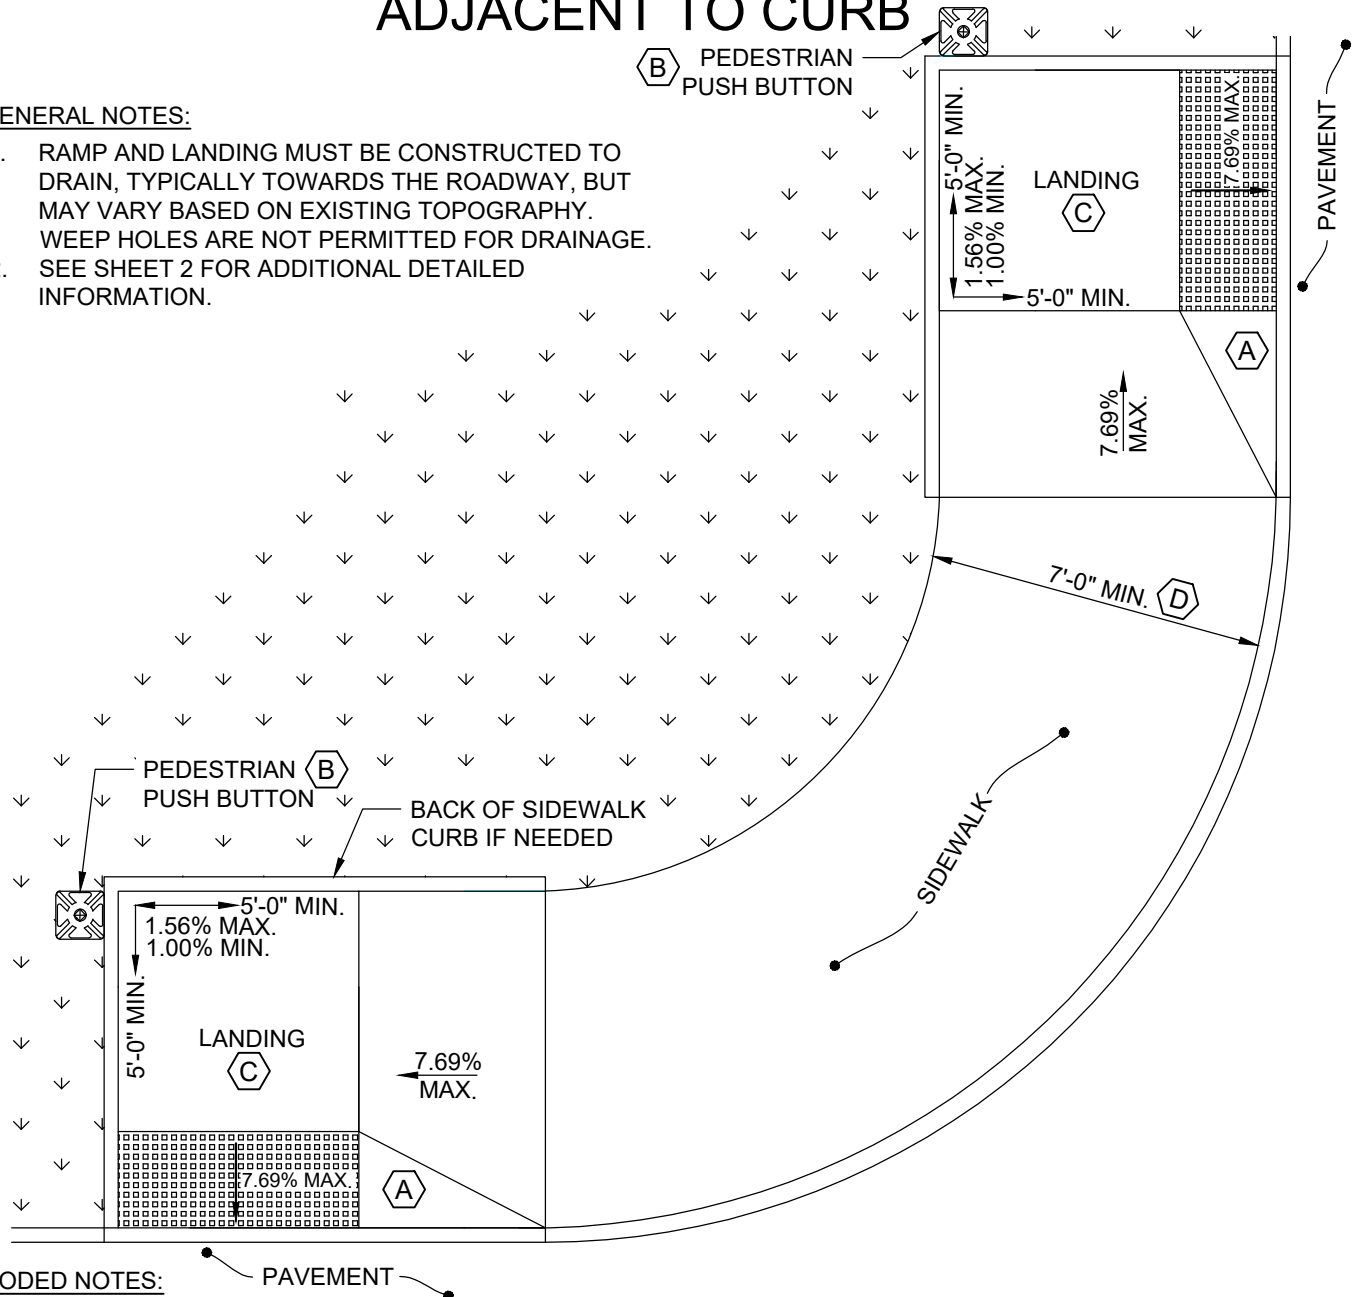

CODED NOTES:

- (A) SEE SHEET 22 FOR DETECTABLE WARNING DETAILS. THE FRONT TWO FEET OF THE RAMP AND FLARES SHALL BE CONSTRUCTED USING CONCRETE 8" THICK AND TRANSITIONING TO 4" CONCRETE FURTHER THAN 2 FEET FROM THE BACK OF THE CURB
- (B) ORIENTATION/LOCATION OF PUSH BUTTON/PEDESTAL TO BE PER POLICY
- (C) WIDTH OF THE RAMP AND LANDING MAY BE REDUCED TO 4-FT WHERE NO CURB WALL IS PRESENT
- (D) SIDEWALK WIDTH MAY BE REDUCED TO 5-FT MIN. WHEN CONSTRAINED. SEE RAMP TYPE P-4, SECTION A-A FOR RAMP AND LANDING

CURB RAMP TYPE PP-2

CITY OF COLUMBUS, OHIO
DEPARTMENT OF PUBLIC SERVICE
DIVISION OF DESIGN AND CONSTRUCTION

STD DWG

2319

07/01/20

SHT 17 OF 22