


C:\EEC\Projects\MAD-70\ELR\CADD\signals\Sheets\0709_CP003.dgn Design 3/9/2019 1:33:47 PM mhunter

NOTES:
1) THE POWER SERVICE SHALL DELIVER 120 VOLTS TO THE CCTV CABINET. POWER SERVICE CABLE SHALL BE #8 AWG COPPER.
2) ALL NETWORK EQUIPMENT WILL BE INSTALLED BY OTHERS.

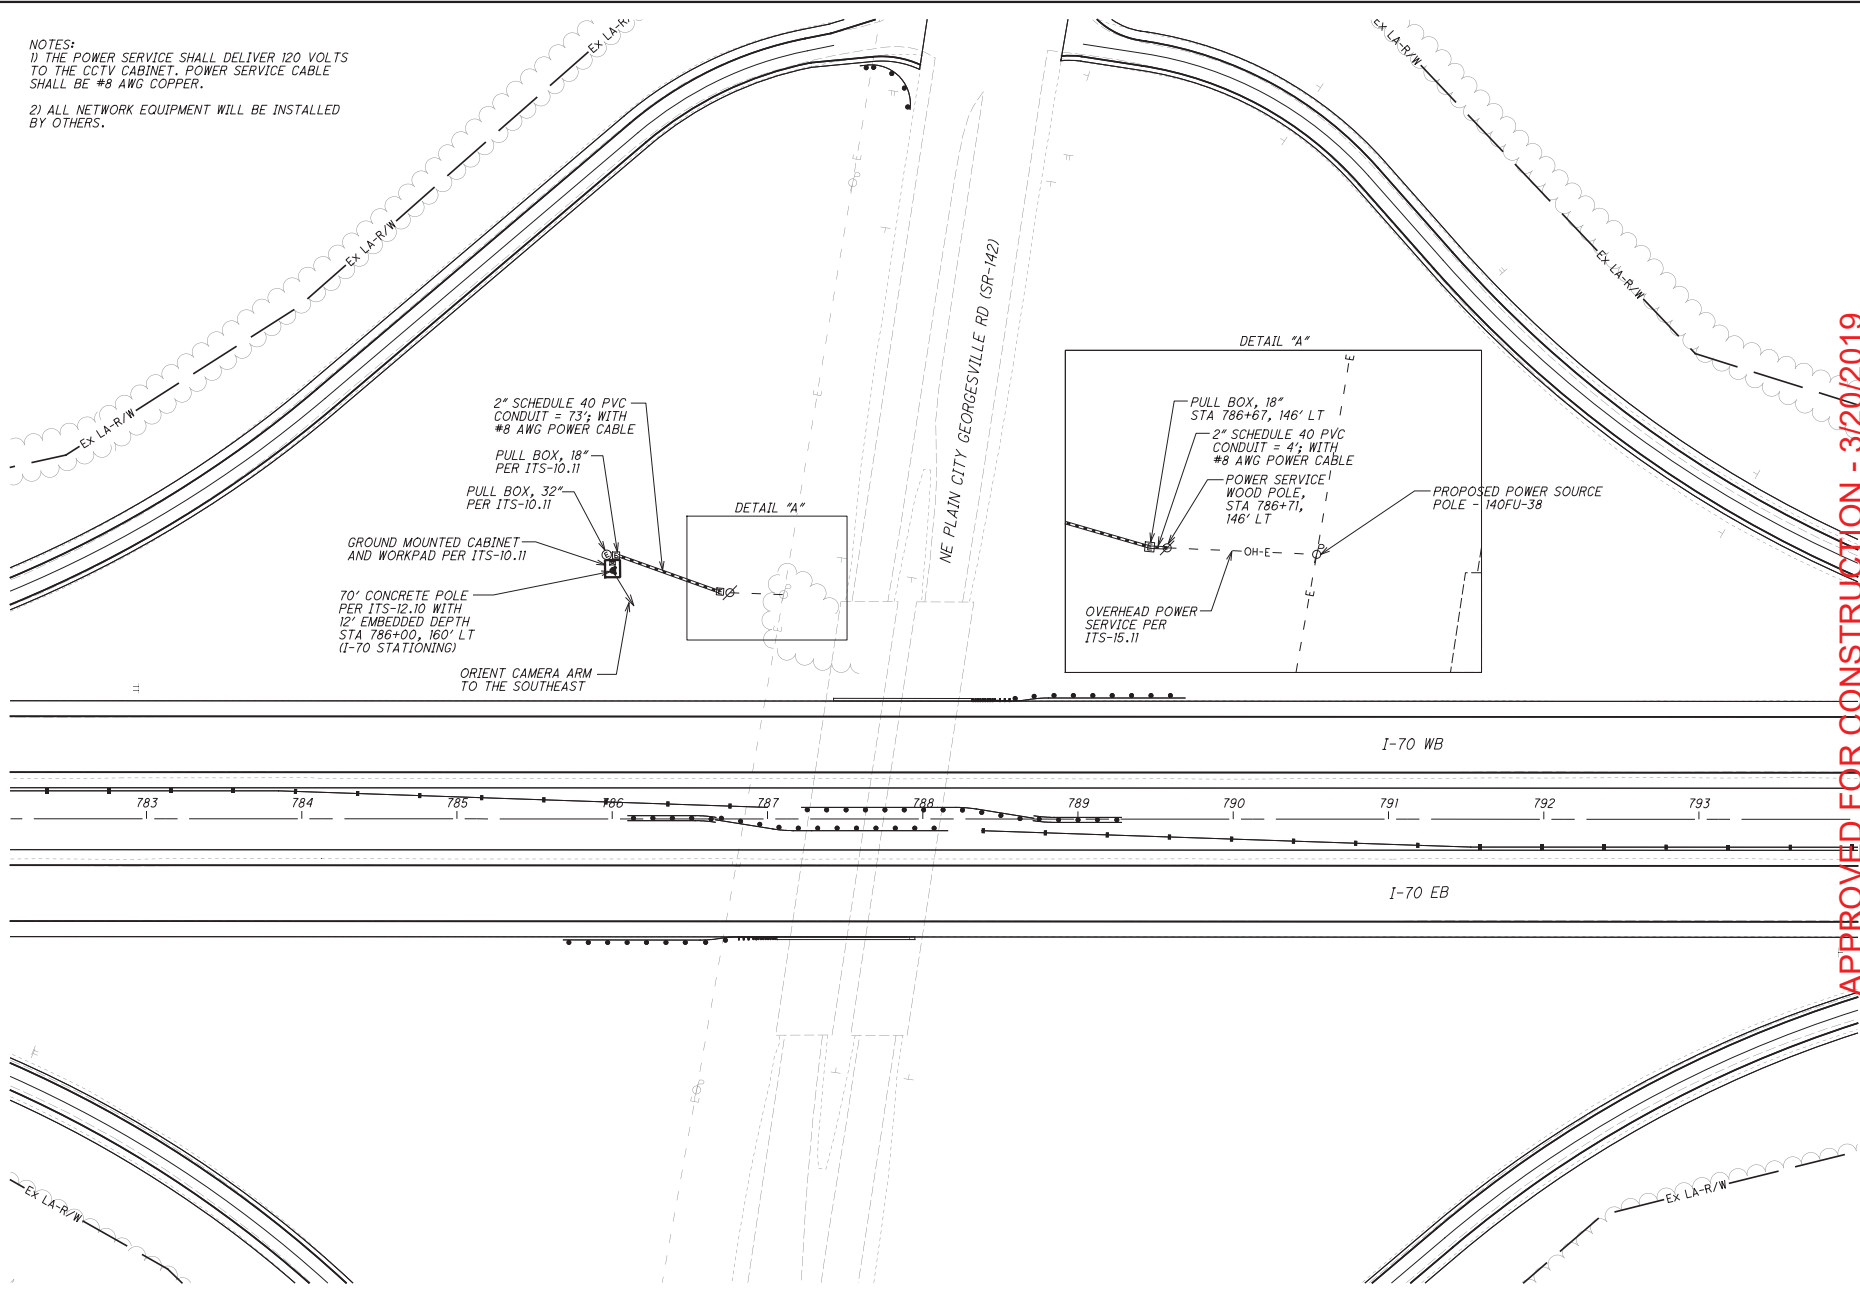

CALCULATED
M.J.H.
CHECKED
K.A.E.

0 20 40 80
HORIZONTAL
SCALE IN FEET

APPROVED FOR CONSTRUCTION - 3/20/2019

ITS PLAN
CAMERA #3 - I-70 AT SR 142 INTERCHANGE

MAD-70-8.62

457
470