
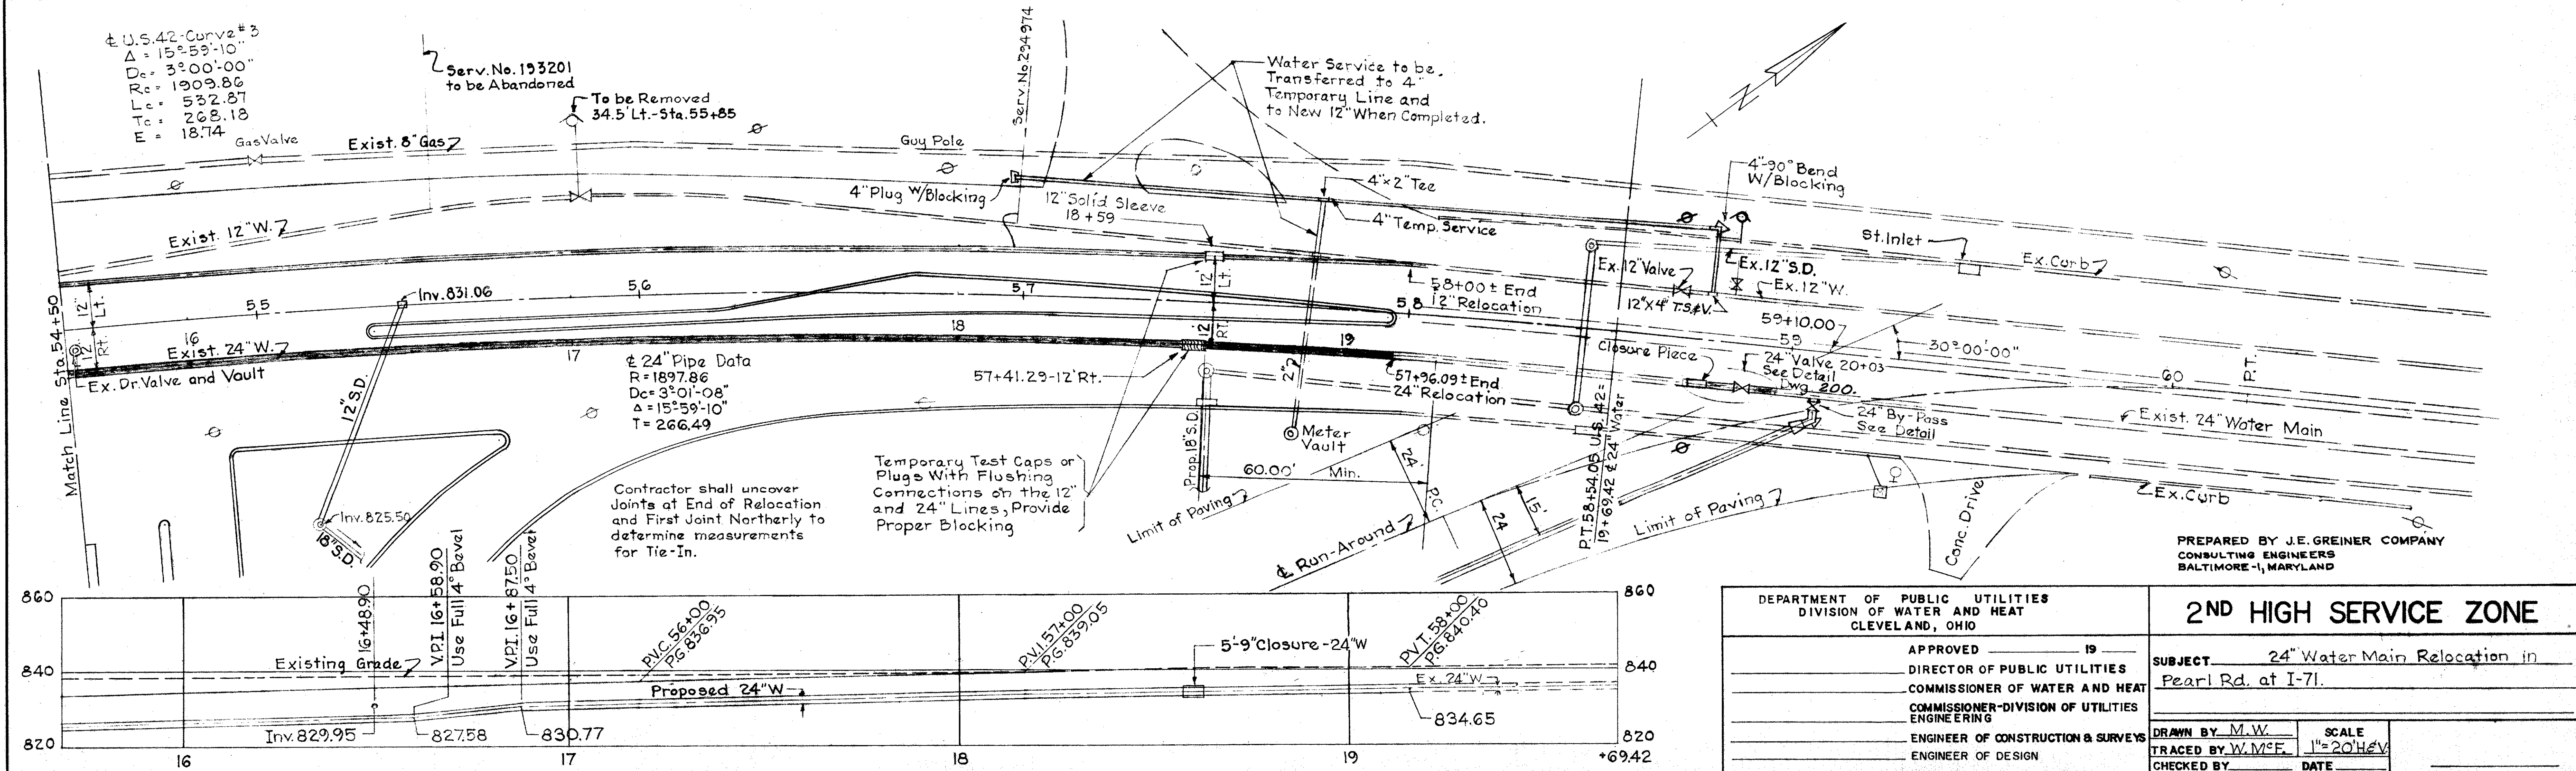


**CUYAHOGA COUNTY
CUY-42-3.38**

Note:
All existing valves, manhole frames and covers, fire hydrants and valve boxes to become the property of the Contractor.

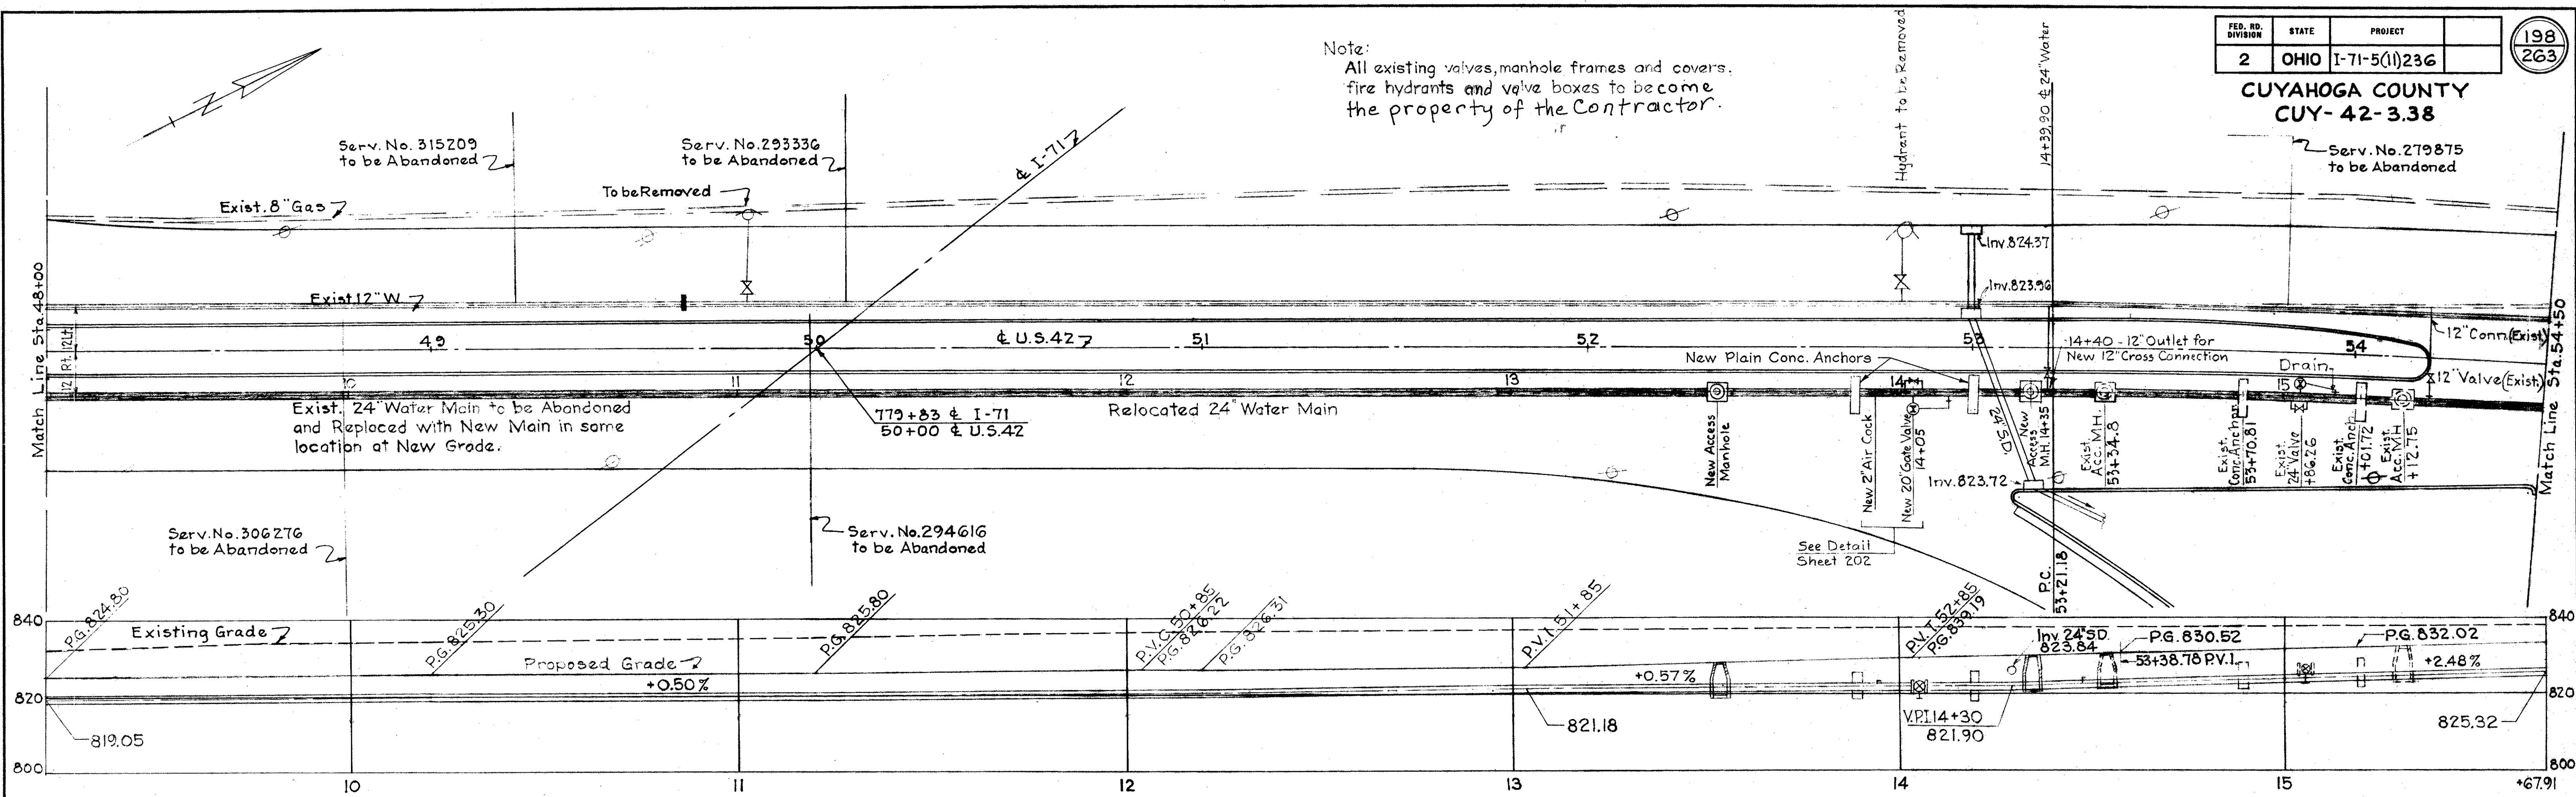

DEPARTMENT OF PUBLIC UTILITIES DIVISION OF WATER AND HEAT CLEVELAND, OHIO		2ND HIGH SERVICE ZONE	
APPROVED _____ 19 _____ DIRECTOR OF PUBLIC UTILITIES COMMISSIONER OF WATER AND HEAT COMMISSIONER-DIVISION OF UTILITIES ENGINEERING		SUBJECT 24" Water Main Relocation in Pearl Rd. at I-71.	
ENGINEER OF CONSTRUCTION & SURVEYS ENGINEER OF DESIGN		DRAWN BY M.W. TRACED BY W.M.C.F. CHECKED BY _____	SCALE 1"=20'H/V DATE _____