

WATER LINE PLAN

Note: For Alterations to Existing Facilities on Denison Ave. See Sheet 24


Note: Disconnect All Service Connections on the West Side of W. 14th St. Install Plugs at the Main and Remove Valve Boxes and Meter Vaults.

FED. RD. DIVISION	STATE	PROJECT
2	OHIO	


536
646

CUYAHOGA COUNTY
CUY. 71-17.83
CUY. 176-12.76

26
34

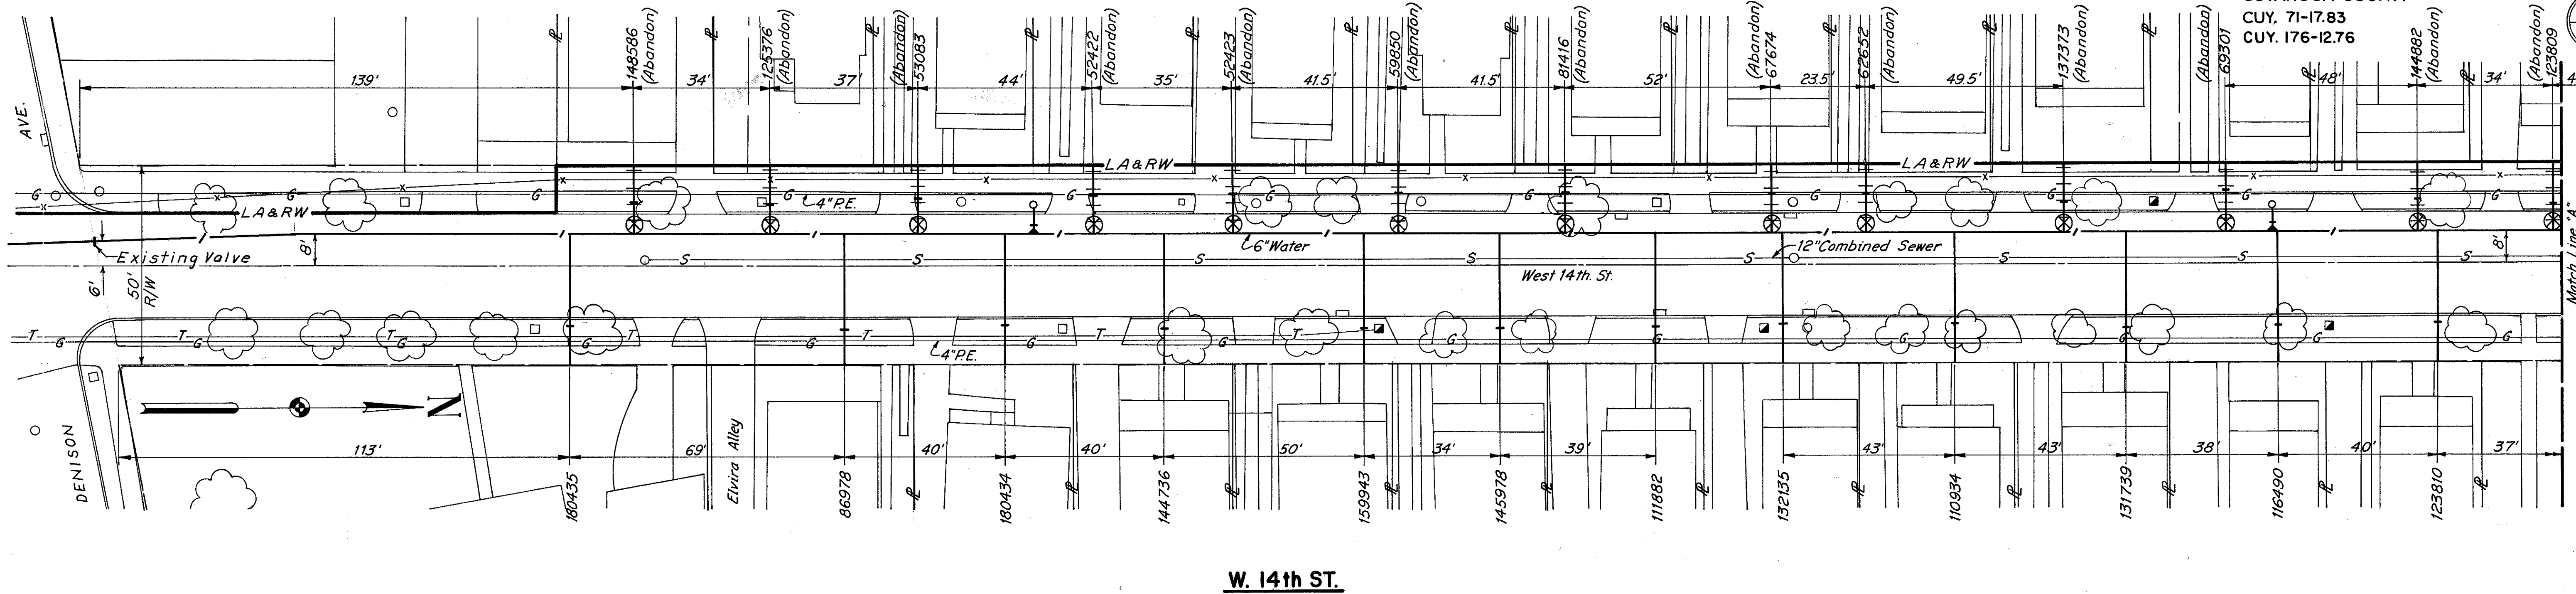

W. 14th St.

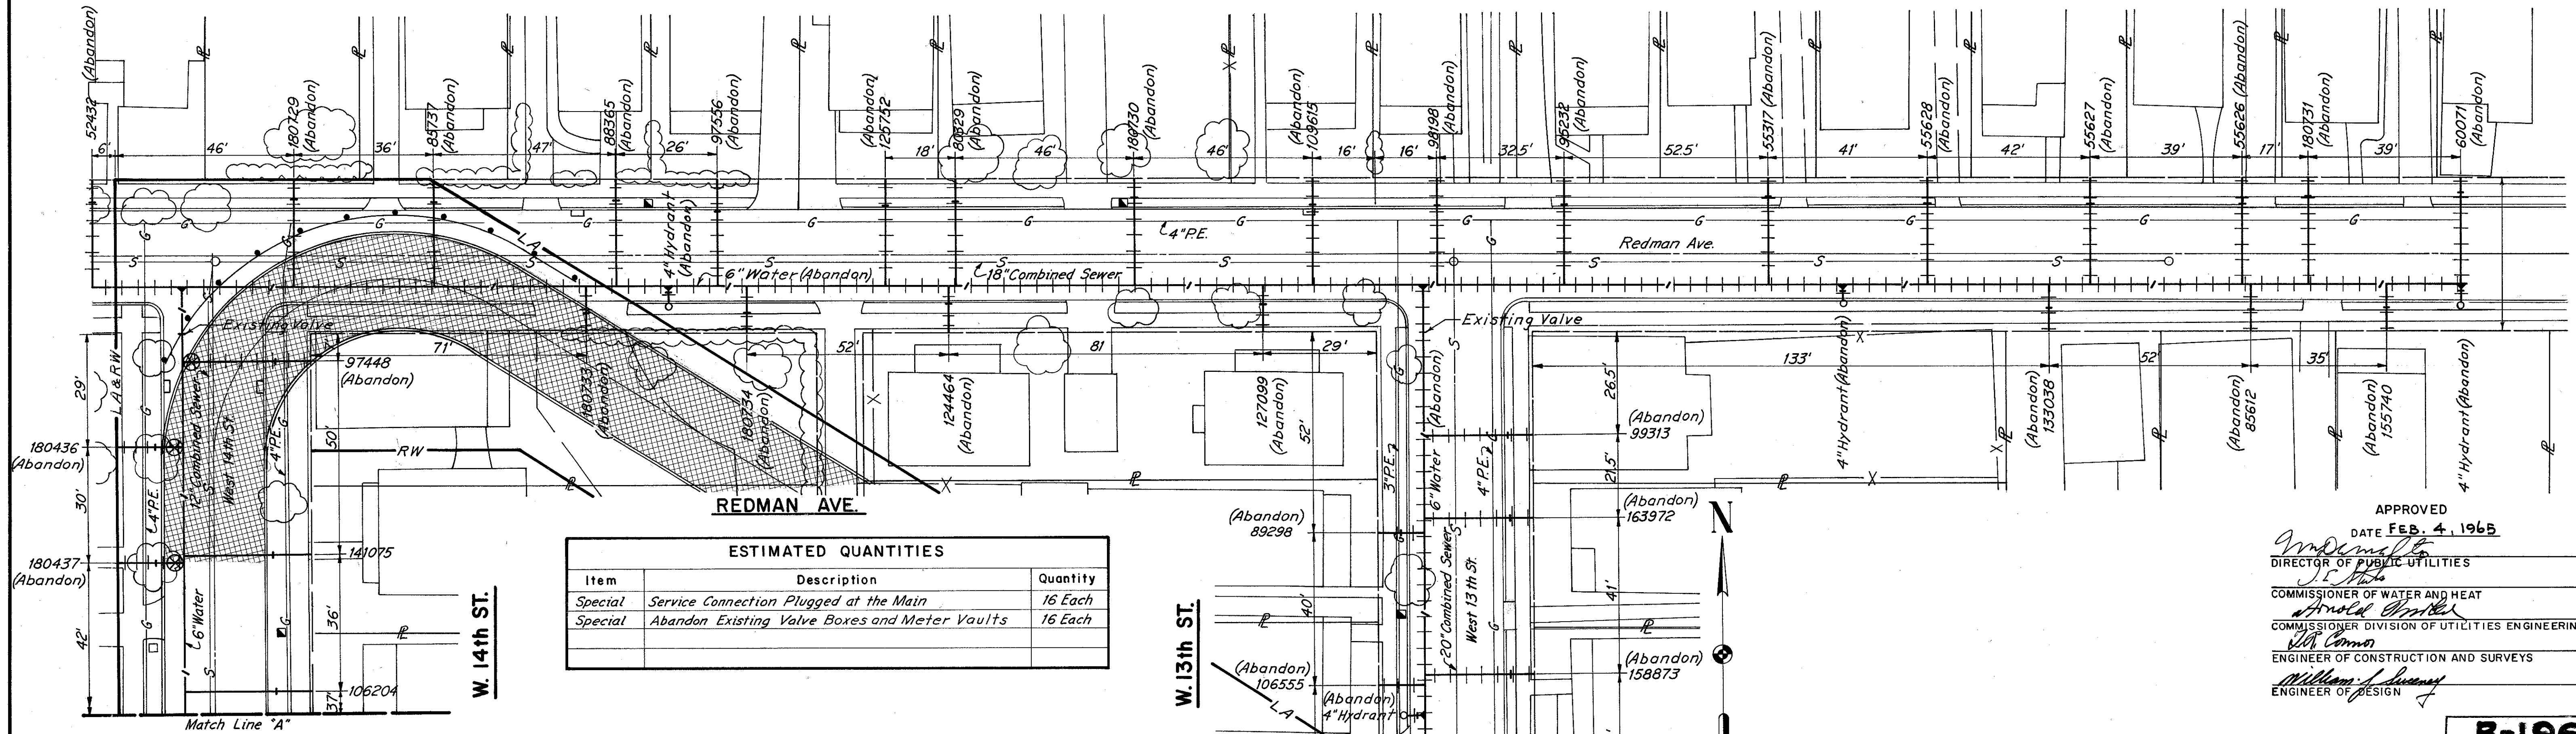

ESTIMATED QUANTITIES		
Item	Description	Quantity
Special	Service Connection Plugged at the Main	16 Each
Special	Abandon Existing Valve Boxes and Meter Vaults	16 Each

Note: Disconnect Service Connections 180436, 180437 & 97448 at the Main. Install Plugs and Abandon Existing Valves.

Note: For Connection of Existing 6" Water Main to Relocated 8" Water Main at Relocated Redman Ave. See Sheet 20

APPROVED
DATE FEB. 4, 1965
W. J. ...
DIRECTOR OF PUBLIC UTILITIES
COMMISSIONER OF WATER AND HEAT
Arnold ...
COMMISSIONER DIVISION OF UTILITIES ENGINEERING
Don ...
ENGINEER OF CONSTRUCTION AND SURVEYS
William ...
ENGINEER OF DESIGN

B-1960

LOW SERVICE DISTRICT

DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER AND HEAT
CLEVELAND, OHIO

SUBJECT Alterations to 6" Water Line on W. 14th St. From Denison Ave. to Redman Ave. Abandon 6" Water Line on Redman Ave. From W. 14th St. to 240' East of W. 13th St. and 150' on W. 13th St.