

NOTES:

EXTEND ALL HYDRANT BRANCHES WITH 4" CAST IRON CEMENT LINED CLASS 25 PIPE, LEAD JOINTS.

RESET ALL HYDRANTS AT LEAST 3' BEHIND NEW CURB.

REMOVE ALL WATER METER VAULTS AFFECTED BY ROADWAY WIDENING AND REBUILD THEM BEHIND THE CURB. THIS WORK SHALL INCLUDE ALL PIPE, METERS AND VALVES, COMPLETE AND WILL BE PERFORMED BY THE CITY BUT THE CONTRACTOR SHALL PAY FOR ALL MATERIALS AND LABOR EXCAVATION, BACKFILL, PAVING AND REPAVING WILL BE PERFORMED BY CONTRACTOR.


ALL CURB BOXES SHALL BE LOCATED OUTSIDE OF PAVEMENT AND SET TO GRADE BY THE CONTRACTOR. THE CITY OF CLEVELAND SHALL EXTEND THE CONNECTION AND RELOCATE CURB BOXES.

ADJUST ALL HYDRANT AND LINE VALVE BOXES AND CASTINGS TO NEW GRADE USING APPROPRIATE EXTENSION PIPES IF NEEDED. ALL MATERIALS AND LABOR NECESSARY TO PERFORM THIS WORK WILL BE PAID FOR UNDER UNIT PRICE BID FOR "ADJUSTING VALVE BOXES TO GRADE."

THE CONTRACTOR WILL NOT BE PERMITTED TO USE AN IRON BALL OR WEIGHT TO REMOVE EXISTING PAVEMENT ANYWHERE WITHIN 25' OF EXIST. WATER MAIN.

THE CONTRACTOR WILL NOT BE PERMITTED TO PLACE HEAVY EQUIPMENT WHEEL LOADS OVER THE EXISTING 36" WATER MAIN.

SEE NOTES SHEET 211.

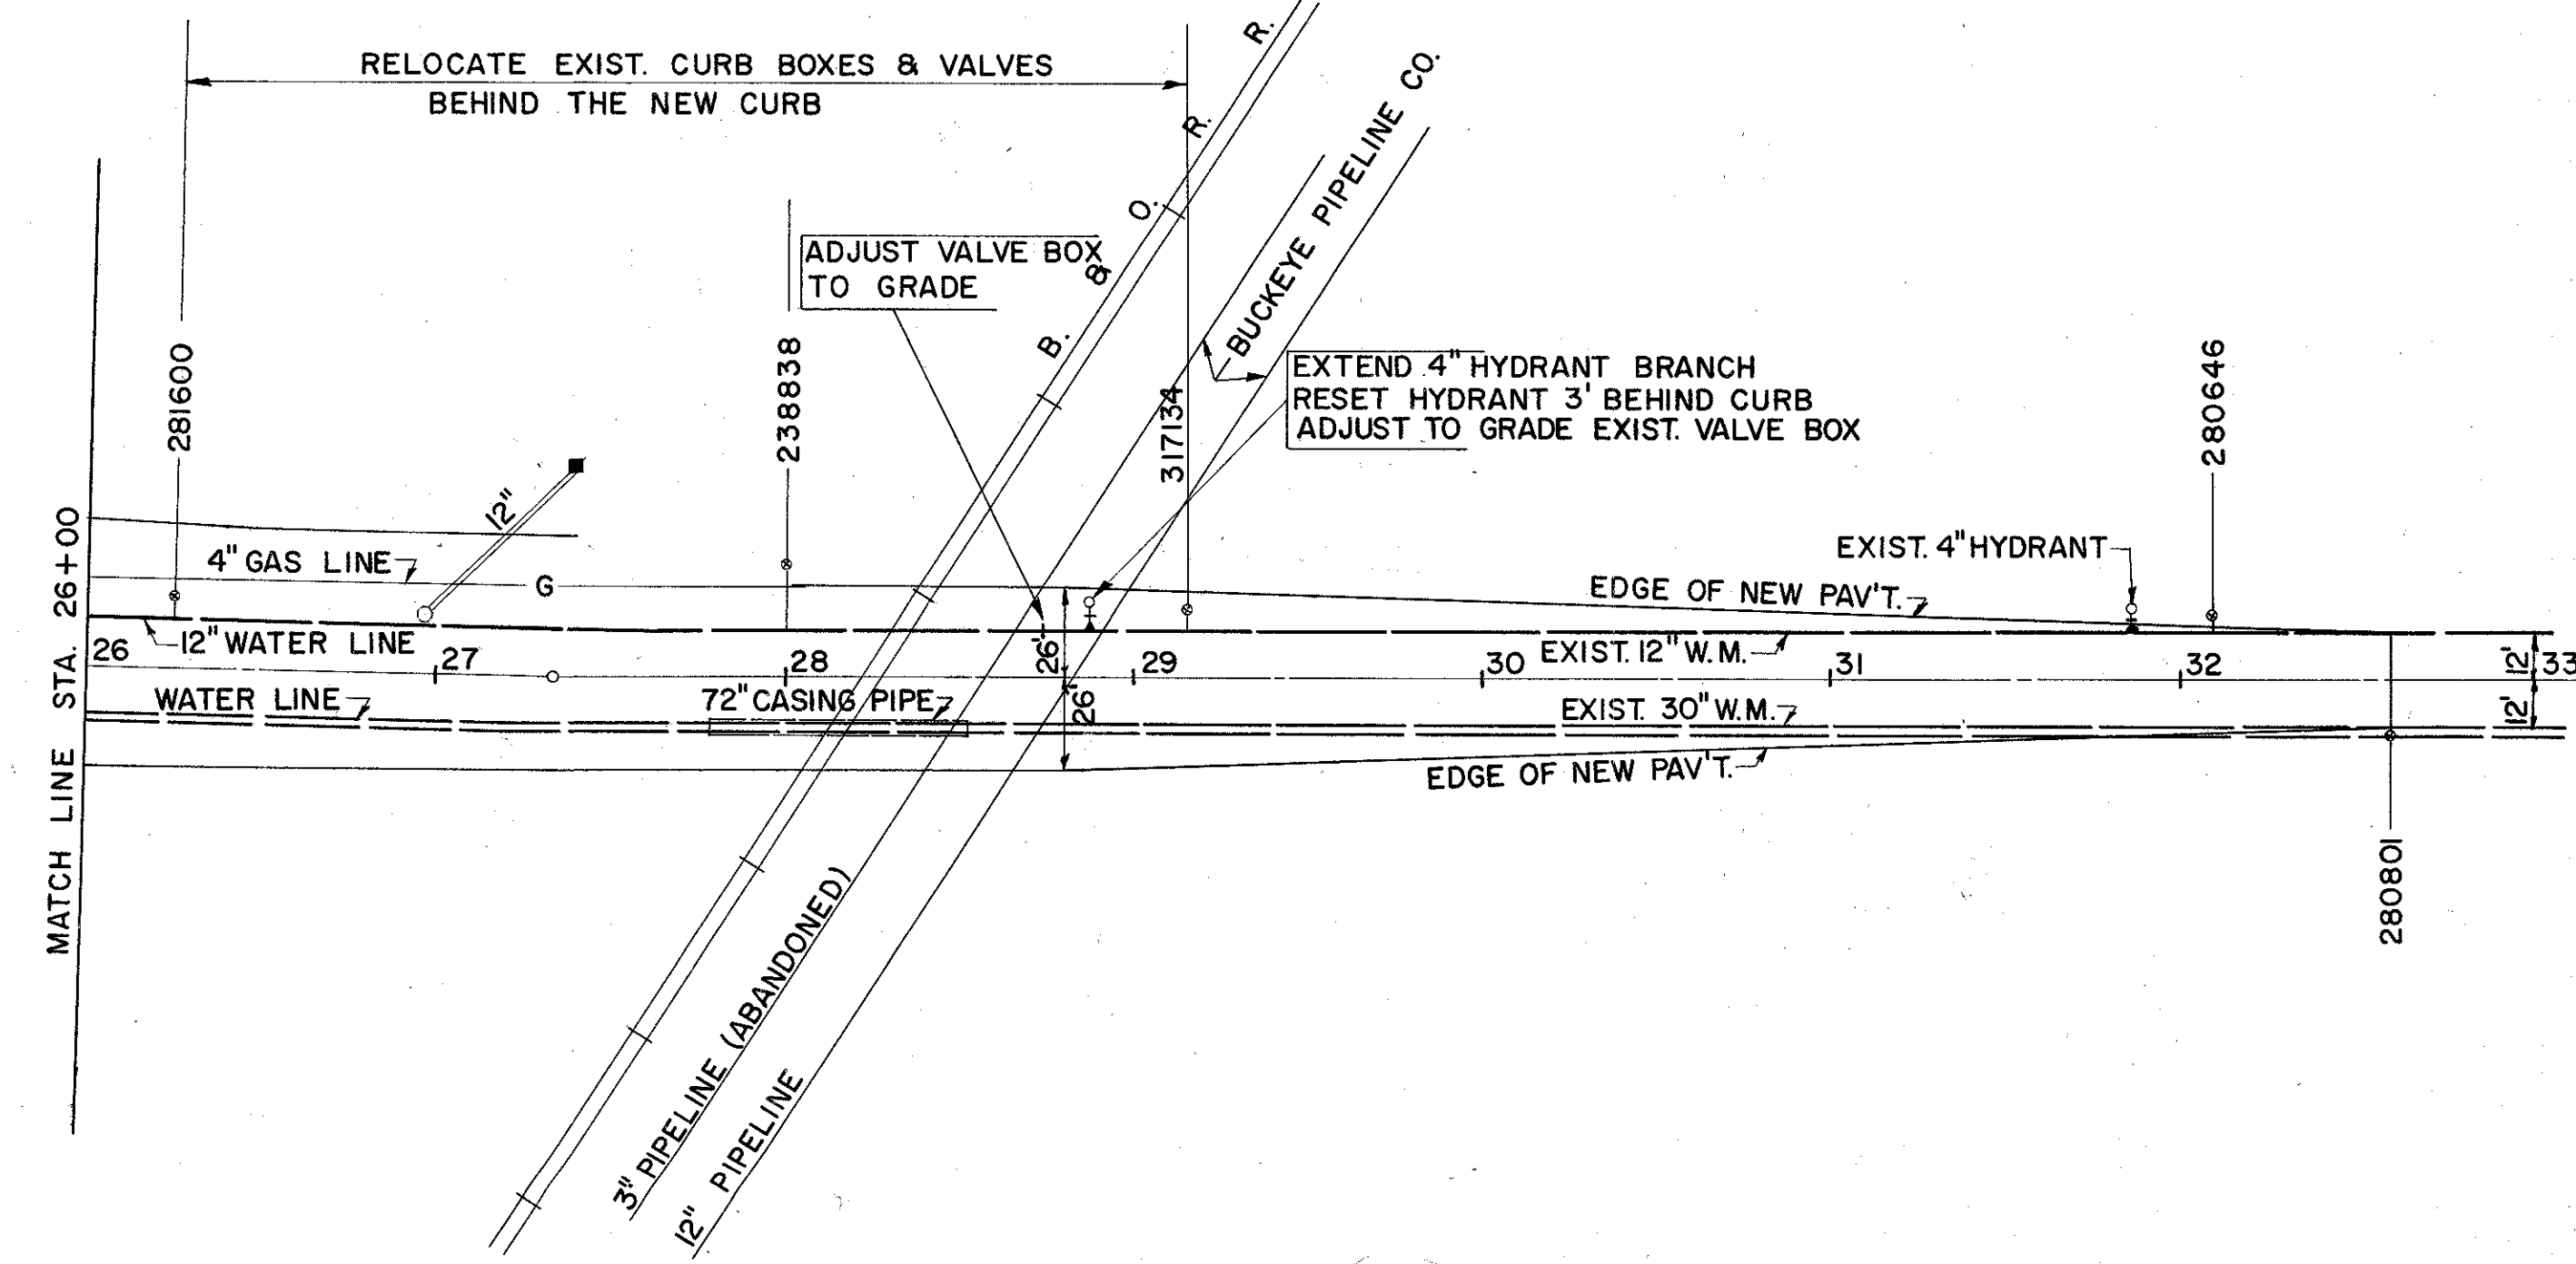

NOTICE

CONTRACTOR TO NOTIFY UTILITIES ENGINEERING 3 DAYS BEFORE STARTING WORK CALL TOWER 1-4600 LINE 813 BETWEEN 8 & 9 A.M.

2-ND HIGH SERVICE DISTRICT
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER AND HEAT
CLEVELAND, OHIO

APPROVED JUNE 26 19 64

J. R. Lorman
ENGINEER OF CONSTRUCTION & SURVEYS

William J. Lawrence
DESIGN ENGINEER

Charles J. Neff
CITY OF MIDDLEBURG HEIGHTS - ENGINEER

PACE ASSOCIATES OF OHIO
4500 EUCLID AVE. CLEVELAND 3, OHIO

WATERWORK
BAGLEY ROAD

SCALE	DATE
DESIGNED	DRAWN
TRACED	CHECKED
REVIEWED	DATE
	REVISED