





REMEMBER: Work zone area conditions may have changed for this job! Everyone is responsible for verifying the above safety information is correct prior to any work being performed each day.

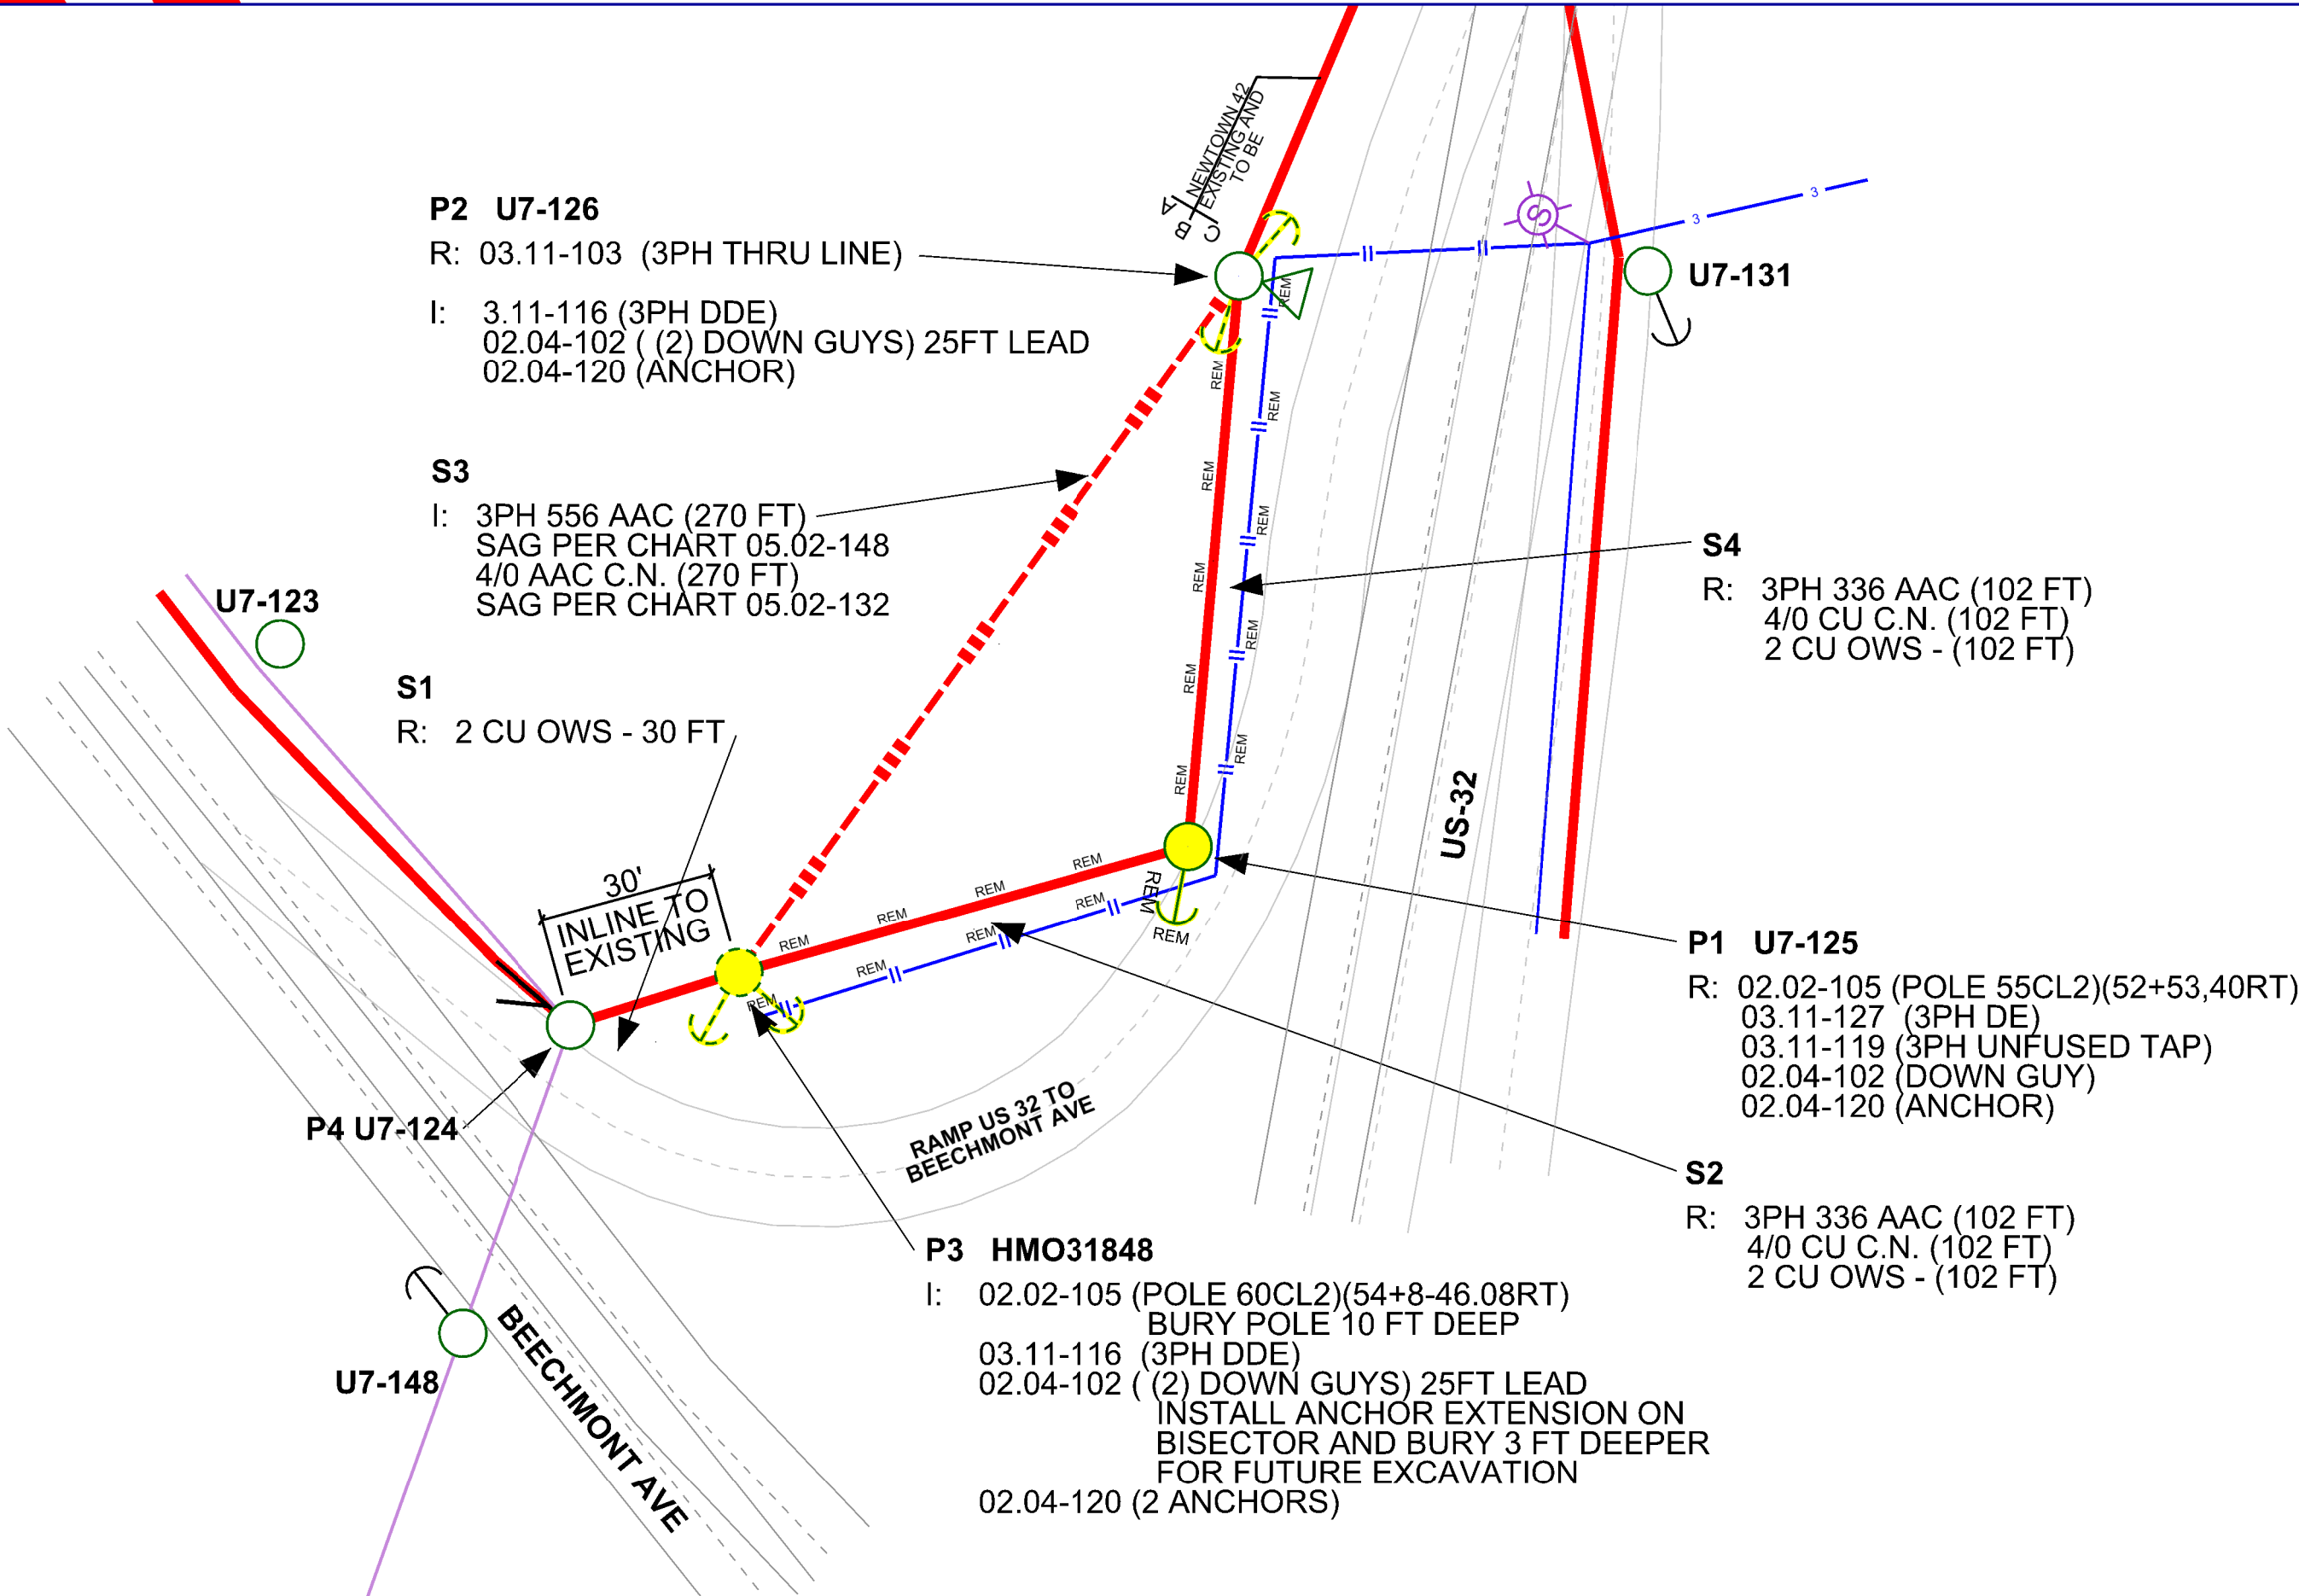

P2 U7-126

R: 03.11-103 (3PH THRU LINE)
 I: 3.11-116 (3PH DDE)
 02.04-102 ((2) DOWN GUYS) 25FT LEAD
 02.04-120 (ANCHOR)

S3

I: 3PH 556 AAC (270 FT)
 SAG PER CHART 05.02-148
 4/0 AAC C.N. (270 FT)
 SAG PER CHART 05.02-132

S1

R: 2 CU OWS - 30 FT

U7-131

S4

R: 3PH 336 AAC (102 FT)
 4/0 CU C.N. (102 FT)
 2 CU OWS - (102 FT)

P1 U7-125

R: 02.02-105 (POLE 55CL2)(52+53,40RT)
 03.11-127 (3PH DE)
 03.11-119 (3PH UNFUSED TAP)
 02.04-102 (DOWN GUY)
 02.04-120 (ANCHOR)

S2

R: 3PH 336 AAC (102 FT)
 4/0 CU C.N. (102 FT)
 2 CU OWS - (102 FT)

P4 U7-124

P3 HMO31848

I: 02.02-105 (POLE 60CL2)(54+8-46.08RT)
 BURY POLE 10 FT DEEP
 03.11-116 (3PH DDE)
 02.04-102 ((2) DOWN GUYS) 25FT LEAD
 INSTALL ANCHOR EXTENSION ON
 BISECTOR AND BURY 3 FT DEEPER
 FOR FUTURE EXCAVATION
 02.04-120 (2 ANCHORS)

Work Order Number	36850878
Customer/Contact	
Contact Phone	
Job Site Address	5037 Signal Hill Ln
City	CINCINNATI
County	HAMILTON
State, Zip	OH, 45244
Designer	Robert P Diesman II
Designer Phone	513-508-1827
Circuit ID	NEWTOWN 42
Primary Voltage	12.47 / 7.2 KV
Permit Required	Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>
Permit Type/No.	ODOT
Permit Type/No. 2	
Permit Type/No. 3	
Permit Type/No. 4	