


Geotechnical Information

Surface Elev.	=	819.5 ft	(Boring Logs)
Bottom of FTG. Elev.	=	793.9 ft	(Record Plans)
Depth to Bottom FTG.	=	25.6 ft	

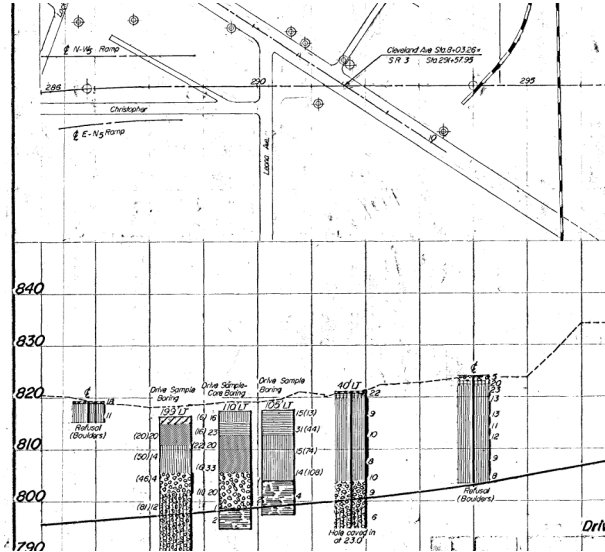

Note: Per email by NEAS (Geotechnical Engineer) on 10/14/2022: a Seismic Site Class of D - Stiff Soil, is recommended.

Elastic seismic response parameters

Risk Category	=	1	(Default/Stiff Soil)
Soil classification (Class/type)	=	'D'	(ASCE 7-16 Seismic Hazard Tool & ATC Hazard Tool)
PGA (Peak Ground Acceleration, Site Class D)	=	0.059	AASHTO LRFD 9TH ED. TABLE 3.10.3.2-1
F _{PGA} (Site Factor)	=	1.6	AASHTO LRFD 9TH ED. EQN 3.10.4.2-2
A _s (Acceleration Coefficient)	=	0.094	
25% of Permanent D.L shall be considered for horizontal seismic force (LRFD 3.10.9.2)			


Total Unfactored Dead Loads, Kip (MDX Models)

	DC1	DC2	
	252.06	63.36	
	228.96	63.36	
	228.96	63.36	
	228.96	63.36	
	228.96	63.36	
	242.26	63.36	
	265.45	63.36	
Total DL (DC1 + DC2)	2119.13	kip	
# of Gir	7		(No. of beams)
DL per Gir	302.73286	kip	(Dead Load on each girder)
25% DL (per Gir)	75.683214	kip	(25% of DL for EQ forces)
# of Bolts per BRG	2		(Total # of bolts per BRG)
Horiz. Force per Bolt	37.842	kip	(Design Shear)

Scope: Check for minimum supports length for horizontal displacements at abutments and bearings strength at pier

Anchor Bolts Edge Distances & Spacing

BRG PL. Width	2.792	Ft	
Dist. b/w bolts	2.4583	Ft	(Bolt line dia)
Exis. Column Dia	3.3333	Ft	
Min. Edge Distance	5.2500	In	

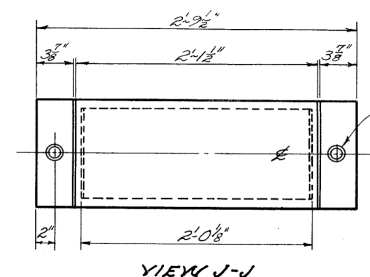

FRA-71-19.36 under Cleveland Ave. (Pier Bearings Strength Check/Anchor Bolts)

These calculations provide the capacity of a single anchor or an anchor group according to AASHTO LRFD (9th Ed.) and ACI 318 Appendix D.

DEFINE CONSTANTS:

Grade 36 was selected as the material for the structural bolts.

Material

Min. Yield Strength $F_y := 36\text{ksi}$

Min. Tensile Strength $F_u := 58\text{ksi}$

Concrete $F_c := 4\text{ksi}$

$$w_{\text{conc}} = 0.15 \cdot \frac{\text{kip}}{\text{ft}^3}$$

Resistance Factors [AASHTO LRFD Bridge Design 6.5.4.2]

for Flexure (Steel) $\phi_f := 1.0$

For ASTM F1554 bolts in Shear $\phi_s := 0.75$

GEOMETRY AND PROPERTIES

Nominal Anchor Bolt Diameter $d_{\text{bolt}} := 1.25\text{in}$


Nominal Anchor Bolt Area $A_{\text{bolt}} := \frac{\pi d_{\text{bolt}}^2}{4} = 1.23 \cdot \text{in}^2$

Anchor bolt bearing area $A_{\text{bolt_brg}} := 1.817\text{in}^2$ Table A.2 (a), smallest bearing area used conservatively (Hex Head Bolt)

Number of Bolts per Bearing $N_{\text{bolt}} := 2$

Spacing of Bolts $S_{\text{bolts}} := 29.5\text{in}$

Check Minimum Spacing b/w Centers of Bolts (in Standard Holes) $S_{\text{min}} := 3 \cdot d_{\text{bolt}} = 3.75 \cdot \text{in}$

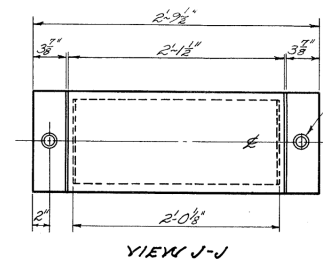

CheckSpacing := "OK" if $S_{\text{bolts}} \geq S_{\text{min}}$
 "NG, increase spacing" otherwise

CheckSpacing = "OK"

Clear Distance b/w
Holes

$$L_c := S_{bolts} - \left(1 \cdot \frac{1}{16} \text{ in} \right) = 29.44 \cdot \text{in}$$

Edge Distance

$$d_{edge} := 5.25 \text{ in} \quad \text{As-built plans}$$

Effective
Embedment

$$h_{ef} := 15 \text{ in} \quad \text{As-built plans}$$


DESIGN LOADS

Refer to the load calcs above for shear forces under seismic event.

Shear Force on Bolt due to seismic effects:

$$\text{Shear_Load} := 75.68 \text{ kip} \quad \text{Total shear force (for both bolts)}$$

$$V_u := \max(\text{Shear_Load}) = 75.68 \cdot \text{kip} \quad \text{per bolt group/brg}$$

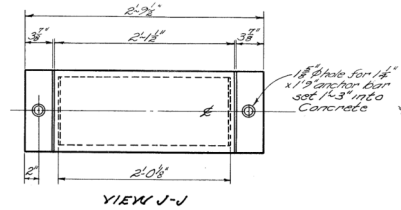

ANCHOR BOLT CAPACITY

[AASHTO LRFD Bridge Design
14.8.3.1]

The shear resistance of anchor bolts shall be determined as specified in Article 6.13.2.12.

Shear

[AASHTO LRFD Bridge Design 6.13.2.12]

Resistance

Calculation below is for shear resistance where threads are included in shear plane.

Factored Shear
Resistance

$$R_r = \phi_s \cdot 0.50 \cdot A_{\text{bolt}} \cdot F_u \cdot N_s$$

Design Shear Force

$$R_{\text{shear}} := V_u$$

$$R_{\text{shear}} = 75.68 \cdot \text{kip}$$

No. of Shear Planes per
Anchor Bolt

$$N_s := 1 N_{\text{bolt}}$$

Nominal Shear Resistance

$$R_n := 0.50 \cdot A_{\text{bolt}} \cdot F_u \cdot N_s$$

$$R_n = 71.18 \cdot \text{kip}$$

Shear Capacity
Check

$$\text{Check}_s := \begin{cases} \text{"Design is OK"} & \text{if } \phi_s \cdot R_n > R_{\text{shear}} \\ \text{"N.G"} & \text{otherwise} \end{cases}$$

$$\text{Check}_s = \text{"N.G"}$$

CONCRETE CAPACITY

Concrete Breakout Strength in Tension (Calculated for concrete pryout strength):

[ACI D.5.2.1]



$$c_{a1} := d_{\text{edge}} = 5.25 \cdot \text{in} \quad S_1 := S_{\text{bolts}} = 29.50 \cdot \text{in}$$

$$c_{a2} := c_{a1} = 5.25 \cdot \text{in}$$

Note (318-14, 17.4.2.3): Since three edge distances (i.e. 5.25 inches) are less than the $1.5 h_{ef}$ (i.e. 22.5 inches), h'_{ef} shall be calculated. h'_{ef} is taken largest of $c_{a,max}/1.5$ & $1/3$ of bolts spacing. Therefore, (Bolts spacing/3 = 9.83") controls.

$$h'_{ef} := \max\left(\frac{c_{a1}}{1.5}, \frac{S_{\text{bolts}}}{3}\right) = 9.83 \cdot \text{in}$$

For A_{Nco} & A_{Nc} , use reduced embedment of anchor.

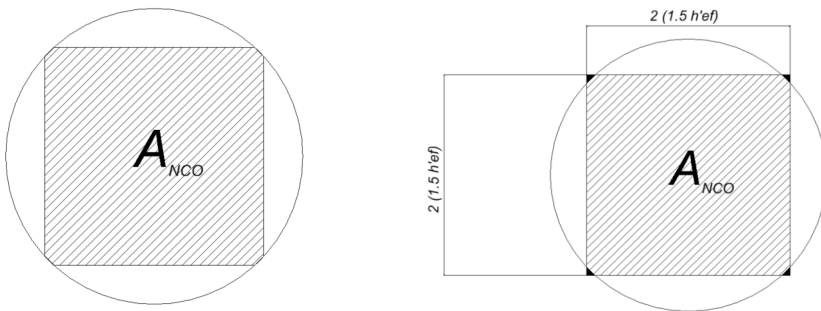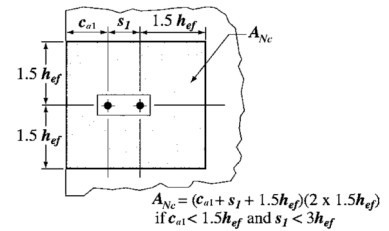

$$A_{Nco} := 866.71 \text{ in}^2$$


$$N_{\text{bolt}} \cdot A_{Nco} = 1.73 \times 10^3 \cdot \text{in}^2$$

(A_{Nco} (for non circular edges) = $9h_{ef}^2 = 870 \text{ in}^2$). However, due to circular edge constraints, the area is slightly reduced. Reduced (or effective) h'_{ef} shall be used for calculation of area.

$$A_{Nc} := (S_1) \cdot (27.01 \text{ in}) \quad (27.01" \text{ is taken from CAD for given bolt spacing})$$

$$A_{Nc} = 796.80 \cdot \text{in}^2$$

$$\text{check} := \begin{cases} \text{"ok"} & \text{if } A_{Nc} \leq N_{\text{bolt}} \cdot A_{Nco} \\ \text{"NG"} & \text{otherwise} \end{cases}$$

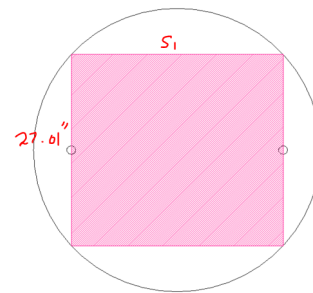

check = "ok"

$$A_{Nc} := \min(A_{Nc}, N_{\text{bolt}} \cdot A_{Nco}) = 796.80 \cdot \text{in}^2$$

modification for eccentric load (D5.2.4)

$$e_N := 0 \text{ in} \quad \text{For single corner anchor in tension, } e'_N \text{ shall be 0}$$

$$\Psi_{ec,N} := \frac{1}{1 + \frac{2e_N}{3h'_{ef}}} = 1.00$$

$$\Psi_{ec,N} := \min(\Psi_{ec,N}, 1.0) = 1.0$$

modification for edge effects
 (D5.2.5)

$$\Psi_{ed,N} := \begin{cases} 1 & \text{if } c_{a1} \geq 1.5h'_{ef} \\ 0.7 + 0.3 \cdot \frac{c_{a1}}{1.5h'_{ef}} & \text{if } c_{a1} < 1.5h'_{ef} \end{cases} = 0.81$$

Modification for cracked section
 (D5.2.6)

$$\Psi_{c,N} := 1.25 \text{ for cast-in anchors}$$

Modification for post-installed
 anchors (D5.2.6)

$$\Psi_{cp,N} := 1.0 \text{ for cast-in anchors}$$

Basic concrete breakout strength of a single anchor in tension in cracked concrete

$$k_c := 24 \text{ for cast-in-anchors}$$

Note:
 17 = Post-installed anchors
 24 = Cast-in anchors

$$N_b := k_c \cdot \sqrt{\frac{F_c}{(\text{psi})}} \cdot \left[\frac{h'_{ef}}{(\text{in})} \right]^{1.5} \cdot (\text{lbf}) = 46.81 \cdot \text{kip}$$

Nominal concrete breakout strength
 (D5.2)

$$N_{cbg} := \frac{A_{Nc}}{A_{Nco}} \cdot (\Psi_{ec,N} \cdot \Psi_{ed,N} \cdot \Psi_{c,N} \cdot \Psi_{cp,N} \cdot N_b) = 43.39 \cdot \text{kip}$$

Concrete Breakout Strength in Shear:

Assembly 1

Projected Area
 for single anchor in a deep
 member

Projected Area of Failure Surface
 (at 35 deg cone)
 at its edge for a single or group of
 anchors.)

$$A_{Vco} := 4.5c_{a1}^2 = 124.03 \cdot \text{in}^2$$

$$A_{Vc} := \left[S_1 + \left(\frac{c_{a1}}{\cos(35\text{deg})} \right) \cdot 2 \right] \cdot 1.5c_{a1} = 333.26 \cdot \text{in}^2$$

$$\text{check} := \begin{cases} \text{"ok"} & \text{if } A_{Vc} \leq N_{\text{bolt}} \cdot A_{Vco} \\ \text{"NG"} & \text{otherwise} \end{cases}$$



check = "NG"

$$A_{Vc} := \min(A_{Vc}, N_{\text{bolt}} \cdot A_{Vco}) = 248.06 \cdot \text{in}^2$$

Basic concrete breakout
 strength (cracked concrete)

$$V_b = 8 \cdot \left(\frac{l_e}{d_{\text{bolt}}} \right)^{0.2} \cdot \sqrt{\frac{d_{\text{bolt}}}{\text{in}}} \cdot \sqrt{\frac{F_c}{\text{psi}}} \cdot \left(\frac{c_{a1}}{\text{in}} \right)^{1.5} \cdot (\text{lbf})$$

$$d_{\text{bolt}} = \frac{5}{4} \cdot \text{in} \quad l_e := h_{ef} = 15.00 \cdot \text{in} \quad \text{D.6.2.2}$$

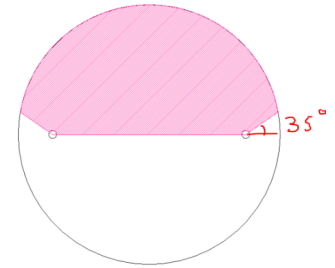

$$A_{Vc} = 1.5c_{a1}(1.5c_{a1} + c_{a2})$$

if $h_{ef} < 1.5c_{a1}$ and $s_y < 3c_{a1}$

$$A_{Vc} = [2(1.5c_{a1}) + s_y]h_{ef}$$


[ACI D.6.2.3]

$$V_b := 8 \cdot \left(\frac{l_e}{d_{\text{bolt}}} \right)^{0.2} \cdot \sqrt{\frac{d_{\text{bolt}}}{\text{in}}} \cdot \sqrt{\frac{F_c}{\text{psi}}} \cdot \left(\frac{c_{a1}}{\text{in}} \right)^{1.5} \cdot (\text{lbf}) = 11.19 \cdot \text{kip}$$

Modification for eccentricity (D6.2.5)

$$e_V := 0 \text{ in}$$

$$\Psi_{ec,V} := \frac{1}{1 + \frac{2 \cdot e_V}{3 \cdot c_{a1}}} = 1.00$$

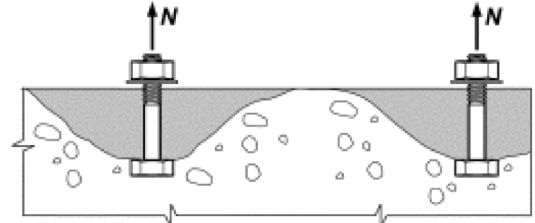

(iii) Concrete breakout

Modification for edge effect (D6.2.6)

$$\Psi_{ed,V} := \begin{cases} 1 & \text{if } c_{a2} \geq 1.5c_{a1} \\ 0.7 + 0.3 \cdot \frac{c_{a2}}{1.5c_{a1}} & \text{if } c_{a2} < 1.5c_{a1} \end{cases} = 0.90$$

$$\Psi_{ed,V} = 0.90$$

Modification for cracked concrete (D6.2.7)

$$\Psi_{c,V} := 1.2$$

for anchors in cracked concrete with supplementary reinforcement of a No. 4 bar or greater between the anchor and the edge

Nominal Concrete Breakout Strength

$$V_{cbg} := \frac{A_{Vc}}{A_{Vco}} \cdot \Psi_{ec,V} \cdot \Psi_{ed,V} \cdot \Psi_{c,V} \cdot V_b = 24.16 \cdot \text{kip} \quad [\text{ACI D.6.2.1}]$$

Concrete Pryout Strength:

$$h_{ef} = 15.00 \cdot \text{in}$$

[ACI D.6.3.1]

$$k_{cp} := \begin{cases} 1.0 & \text{if } h_{ef} < 2.5 \text{ in} \\ 2.0 & \text{if } h_{ef} \geq 2.5 \text{ in} \end{cases} \quad k_{cp} = 2.0$$

$$N_{cbg} = 4.34 \times 10^4 \cdot \text{lbf}$$

$$V_{cpg} := k_{cp} \cdot N_{cbg} = 8.68 \times 10^4 \cdot \text{lbf}$$

Factored Strength:

$$\phi V_n \geq V_u$$

$$\phi N_n \geq N_u$$

Note: Condition is determined from ACI

355.2
concrete breakout, side-face blowout, pullout or pryout strength

- i) shear loads $\phi_{c,V} := 0.75$ Condition A is applied due to provision of supplemental reinf.
- ii) tension loads $\phi_{c,N} := 0.75$

Shear:

Concrete breakout strength $\phi_{c,V} = 0.75$ $V_{cbg} = 24160 \cdot \text{lbf}$ $\phi_{c,V} \cdot V_{cbg} = 18 \cdot \text{kip}$

Concrete pryout strength $\phi_{c,V} = 0.75$ $V_{cpg} = 86788 \cdot \text{lbf}$ $\phi_{c,V} \cdot V_{cpg} = 65 \cdot \text{kip}$

FACTORED SHEAR CAPACITY $\phi V_n := \min(\phi_{c,V} \cdot V_{cbg}, \phi_{c,V} \cdot V_{cpg}) = 18 \cdot \text{kip}$

Check₂ := $\begin{cases} \text{"OK"} & \text{if } \phi V_n > V_u \\ \text{"Not OK, Modify"} & \text{otherwise} \end{cases}$

Check₂ = "Not OK, Modify"

Embedment Length $l_e = 15.00 \cdot \text{in}$