


WATER LINE PLAN

FED. RD. DIVISION	STATE	PROJECT
2	OHIO	

537
646


27
34

CUYAHOGA COUNTY
CUY. 71-17.83
CUY. 176-12.76

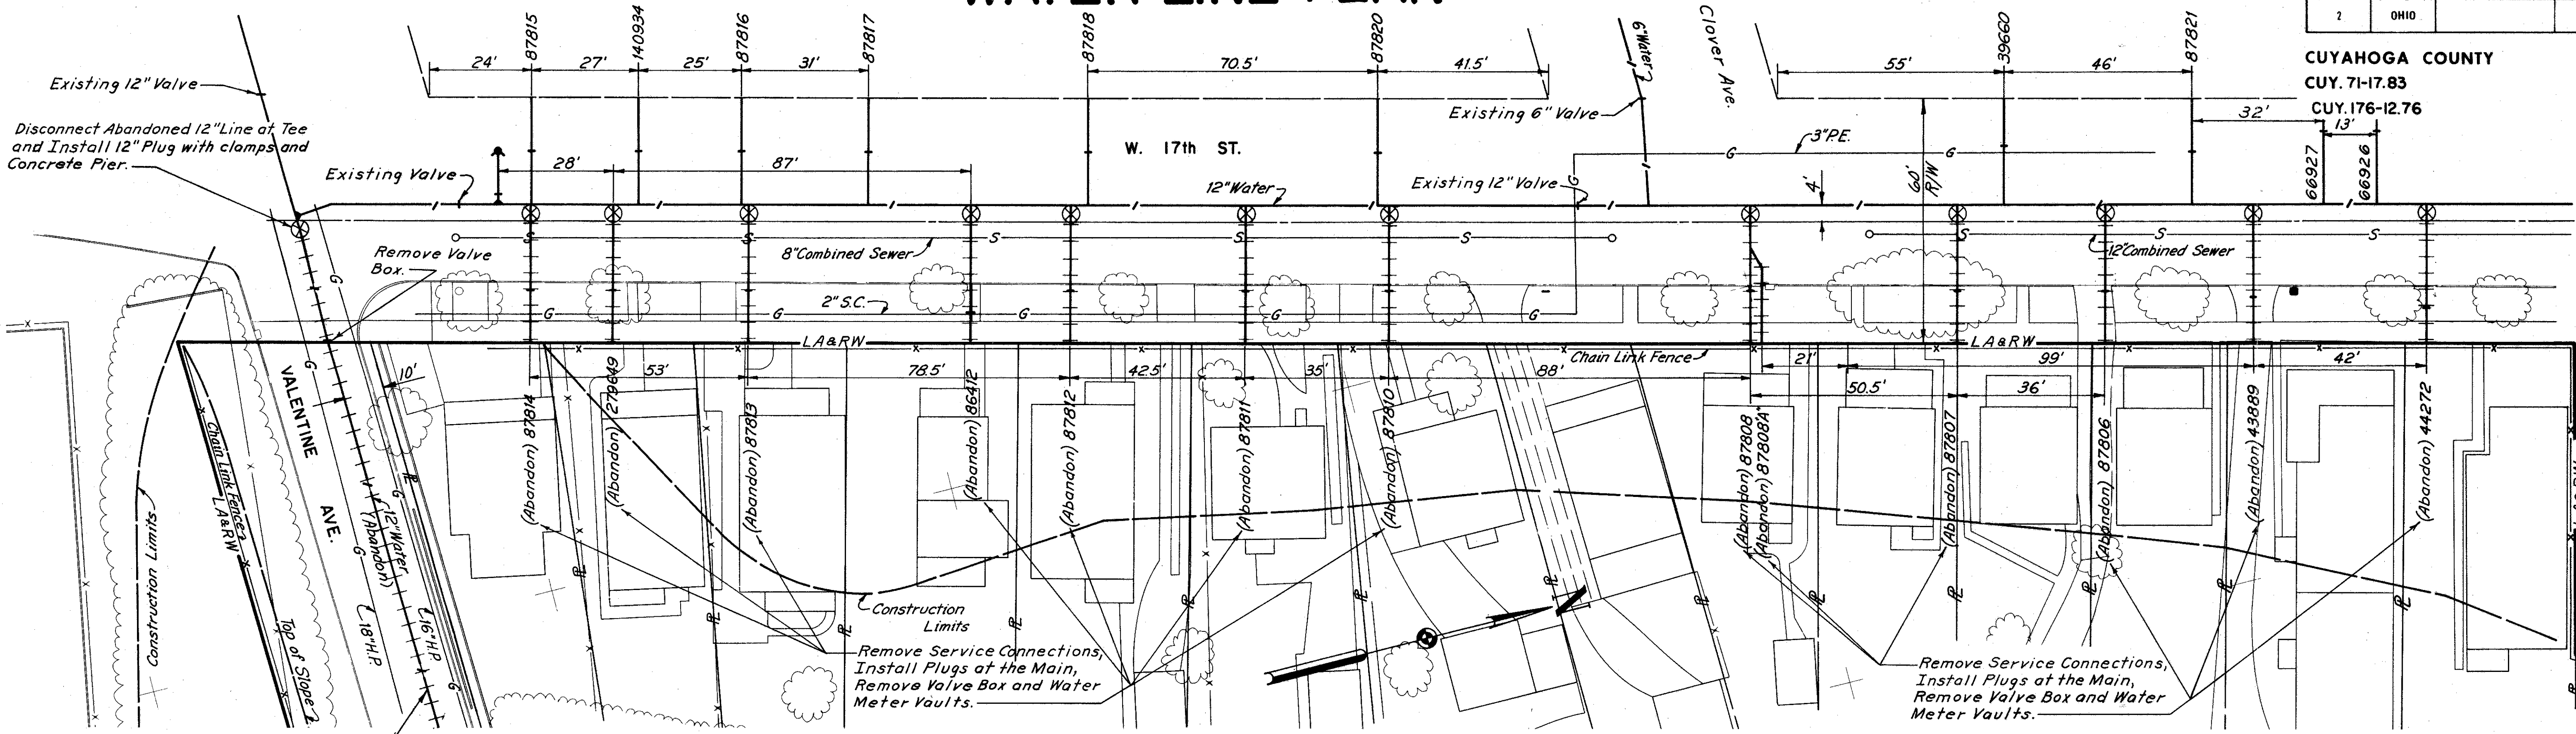

Note: Abandon 297' of 12" Water Main to Water Main in Jennings Rd. including 12" Valve and Connection No. 261149.

W. 17th ST.

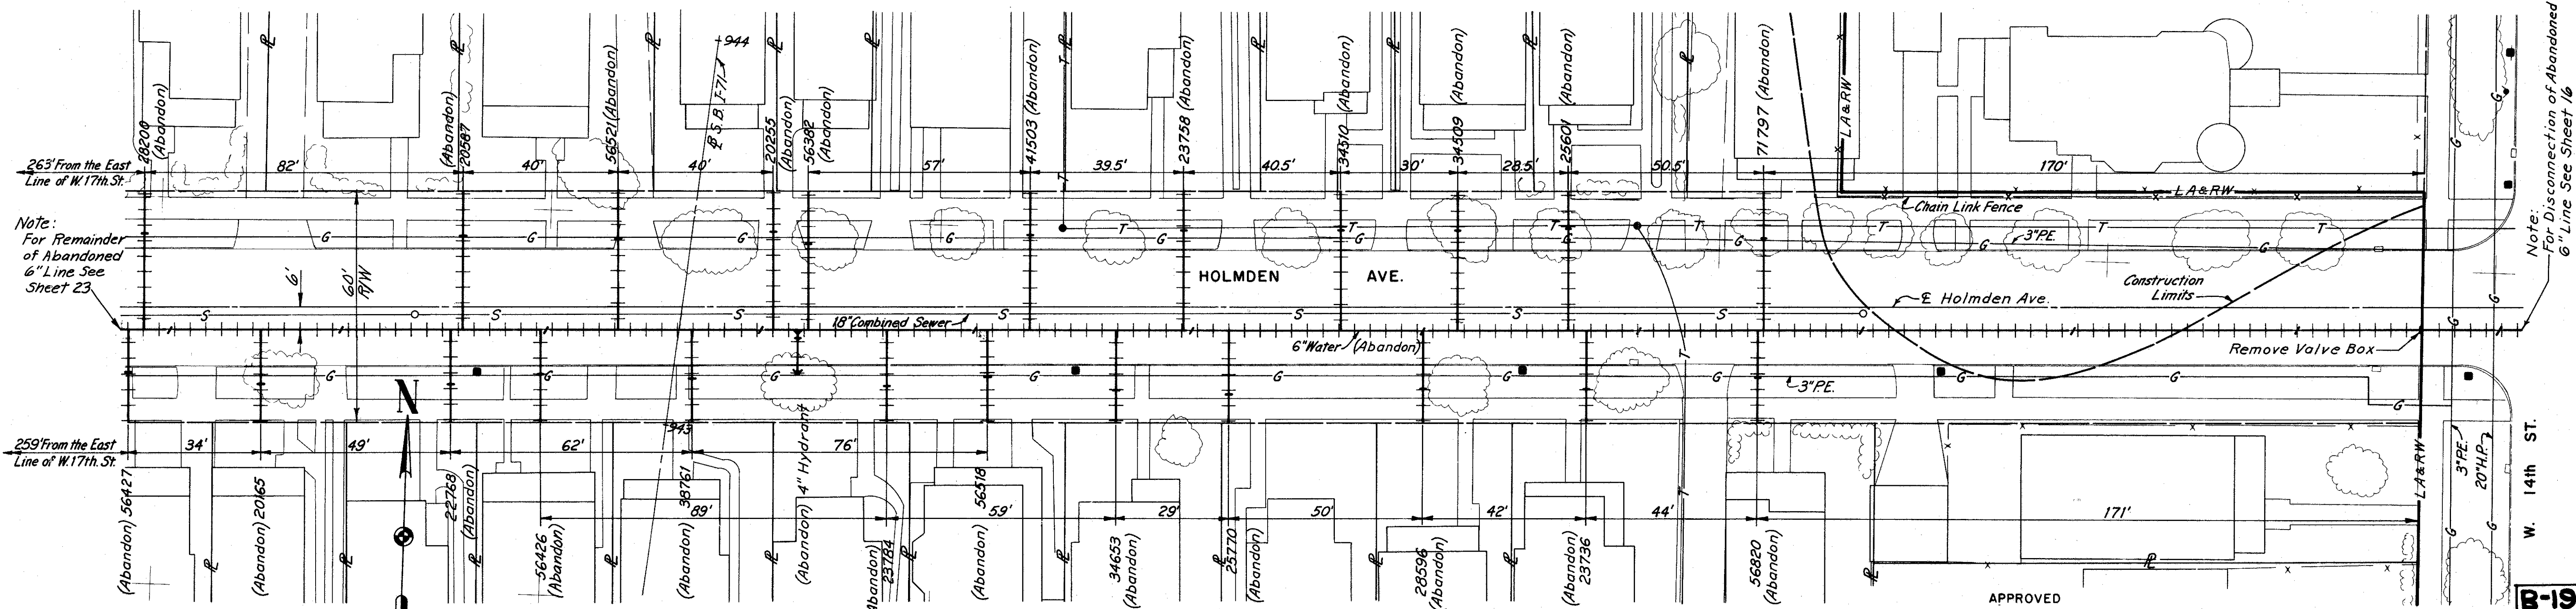

HOLMDEN AVE.

ESTIMATED QUANTITIES		
Item	Description	Quantity
Special	Service Connection Plugged at Main	12 each
Special	Water Main Plugged at Main	1 each
Special	Abandon Existing Valve Box	14 each
Special	Abandon Water Meter Vaults	13 each

APPROVED
DATE FEB. 4, 1965

W. J. ...
DIRECTOR OF PUBLIC UTILITIES

J. ...
COMMISSIONER OF WATER AND HEAT

J. ...
COMMISSIONER DIVISION OF UTILITIES ENGINEERING

J. ...
ENGINEER OF CONSTRUCTION AND SURVEYS

William J. ...
ENGINEER OF DESIGN

B-1961

LOW SERVICE DISTRICT

DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER AND HEAT
CLEVELAND, OHIO

SUBJECT: Alterations to 12" Water Line on West 17th Street from Valentine Avenue to 141' North of Clover Avenue. Abandon 5" Water Line on Holmden Avenue from West 14th Street to 250' East of West 17th Street.

SCALE 1" = 20'

HOWARD, NEEDLES, TAMMEN & BERGENDOFF
CONSULTING ENGINEERS
NEW YORK

MADE P.L.K. DATE 11-12-64
TRCD P.L.K. DATE 11-12-64
CKD. E.C.E. DATE 1-7-65