
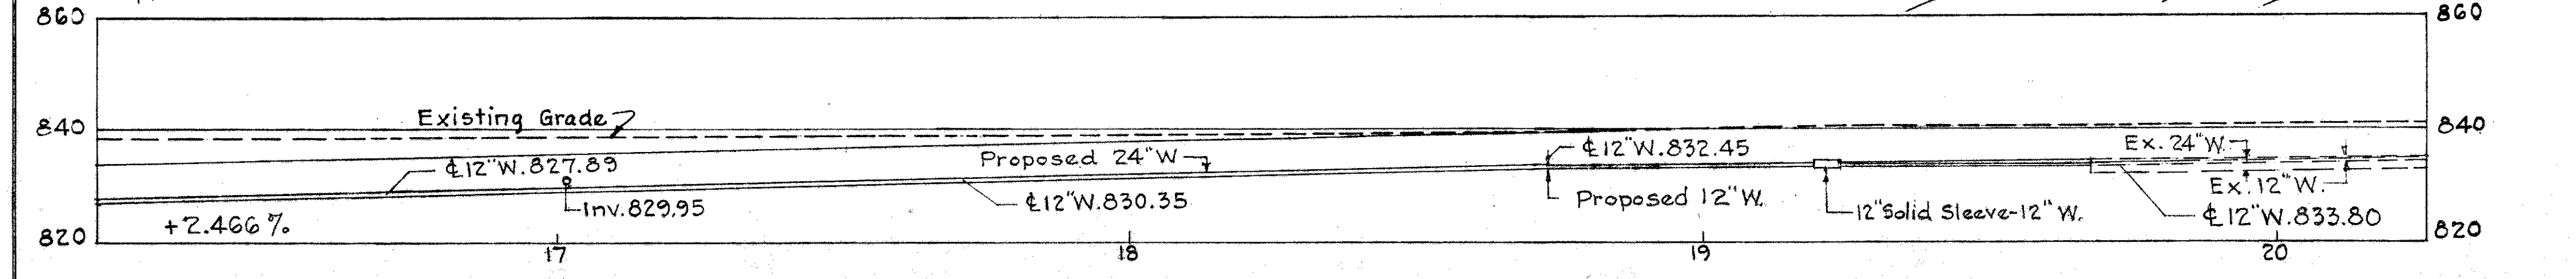
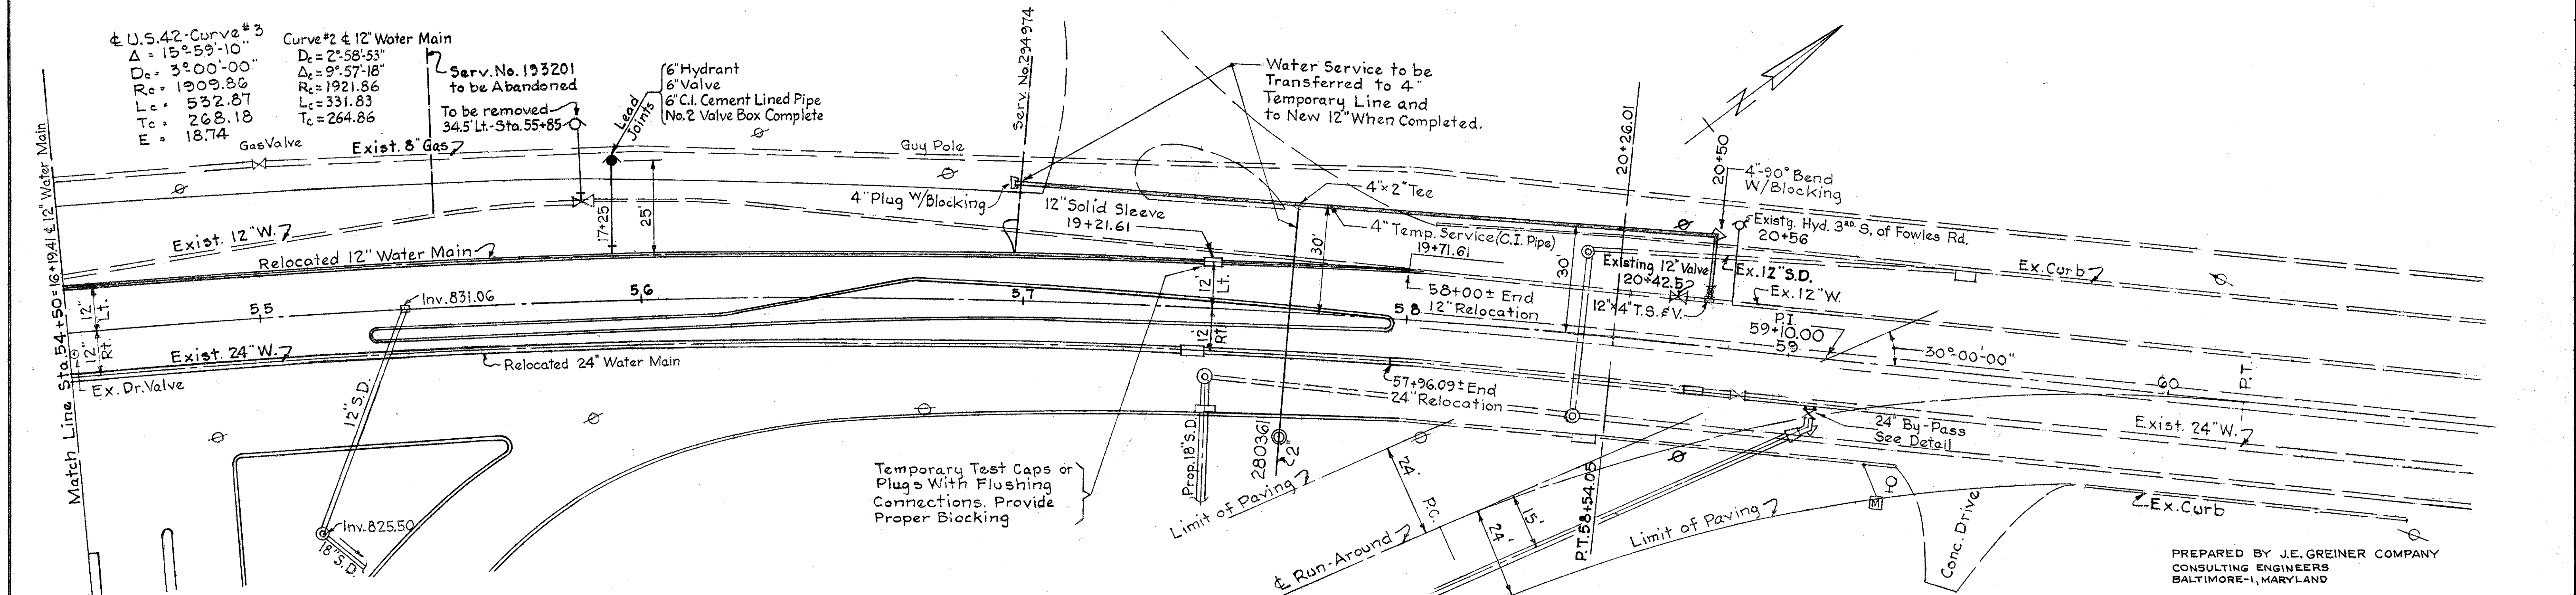


CUYAHOGA COUNTY
CUY-42-3.38

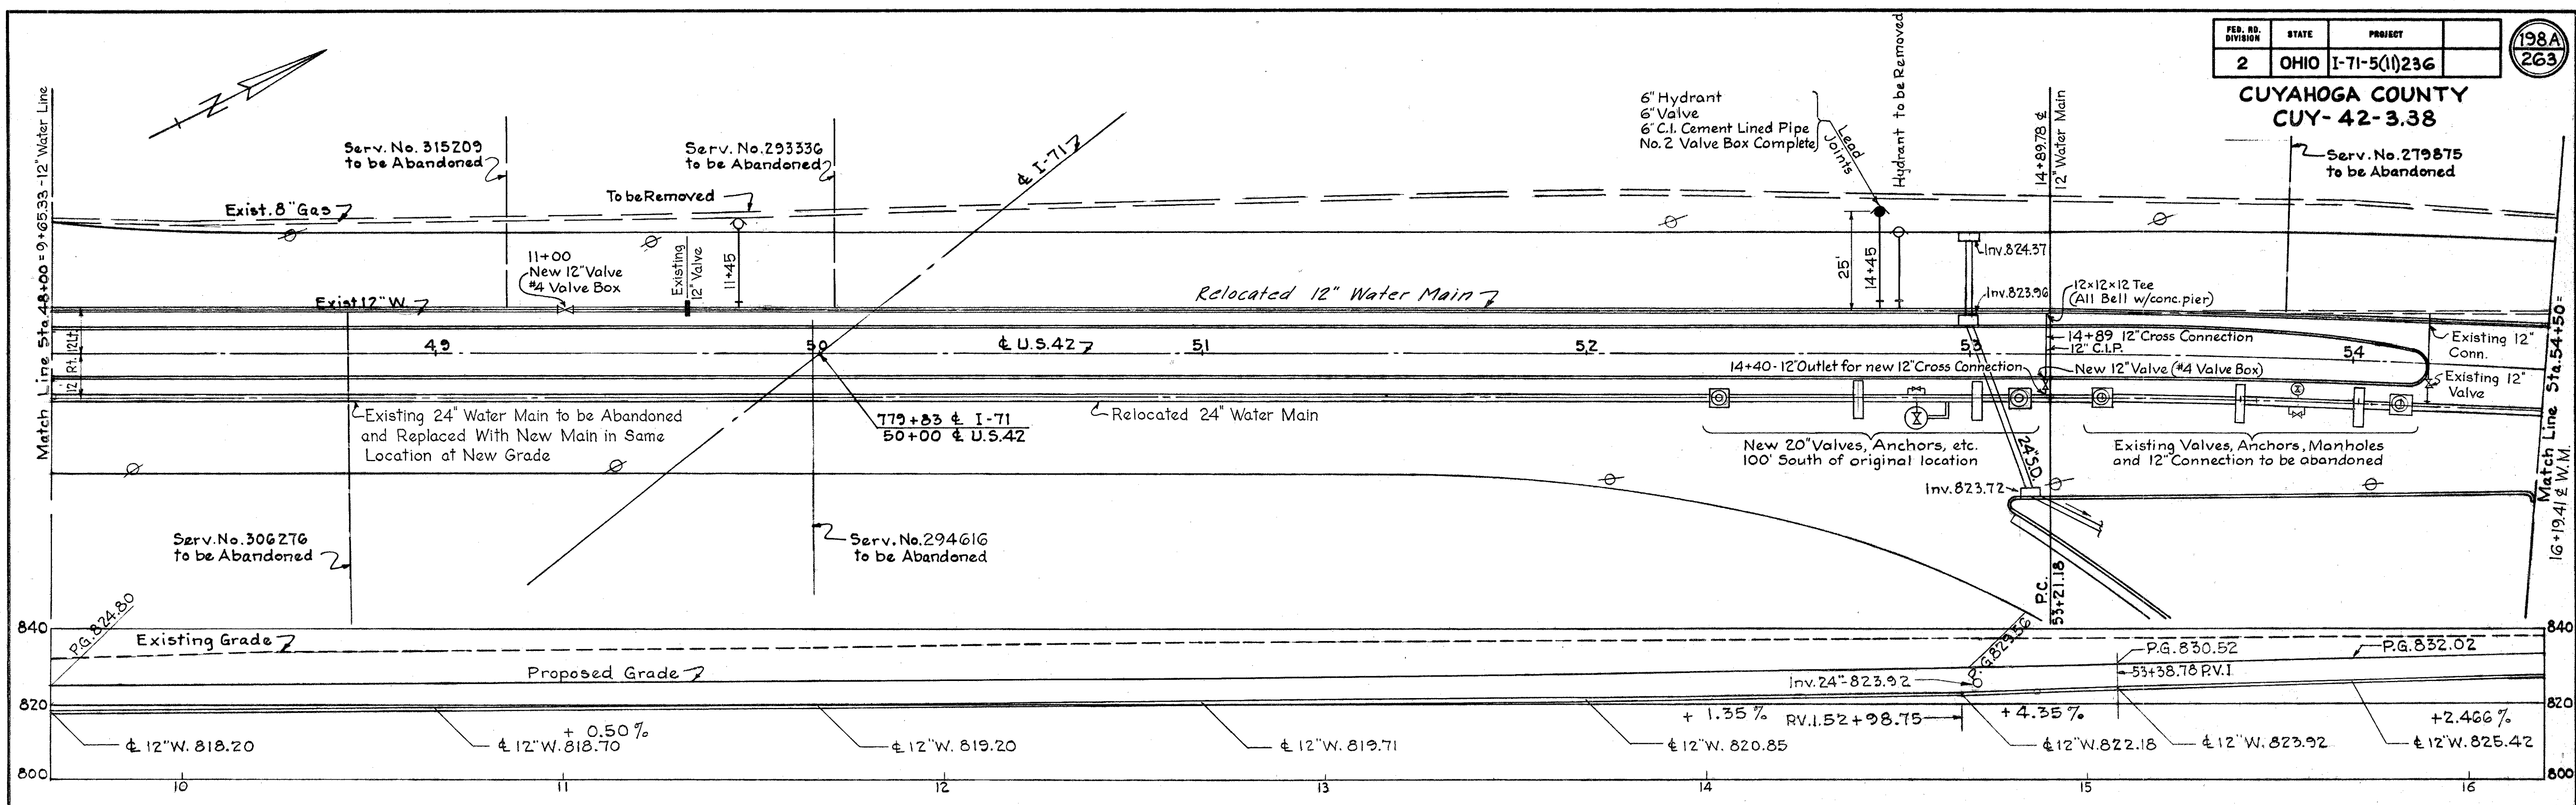

DEPARTMENT OF PUBLIC UTILITIES DIVISION OF WATER AND HEAT CLEVELAND, OHIO		2ND HIGH SERVICE ZONE	
APPROVED _____ 19 _____	DIRECTOR OF PUBLIC UTILITIES	SUBJECT 12" Water Main Relocation in Pearl Rd. at I-71.	
_____	COMMISSIONER OF WATER AND HEAT	DRAWN BY M.W.	
_____	COMMISSIONER-DIVISION OF UTILITIES	TRACED BY M.W.	SCALE 1"=20'H.&V.
_____	ENGINEER OF CONSTRUCTION & SURVEYS	CHECKED BY _____	DATE _____
_____	ENGINEER OF DESIGN		

PREPARED BY J.E. GREINER COMPANY
CONSULTING ENGINEERS
BALTIMORE-1, MARYLAND