

WATER LINE PLAN

FED. RD. DIVISION	STATE	PROJECT
2	OHIO	

534
646

CUYAHOGA COUNTY
CUY - 71-17.83
CUY-176-12.76


24
37

Note: For Alterations to 6" Water Line on W. 14th St. See Sheet 26

Remove Service Connection, Install Plug at the Main & Remove Meter Vault if Existing.


Note: For Alterations to 6" Water Line on W. 15th St. See Sheet 25.

Remove Service Connection and Install Plug at Main.

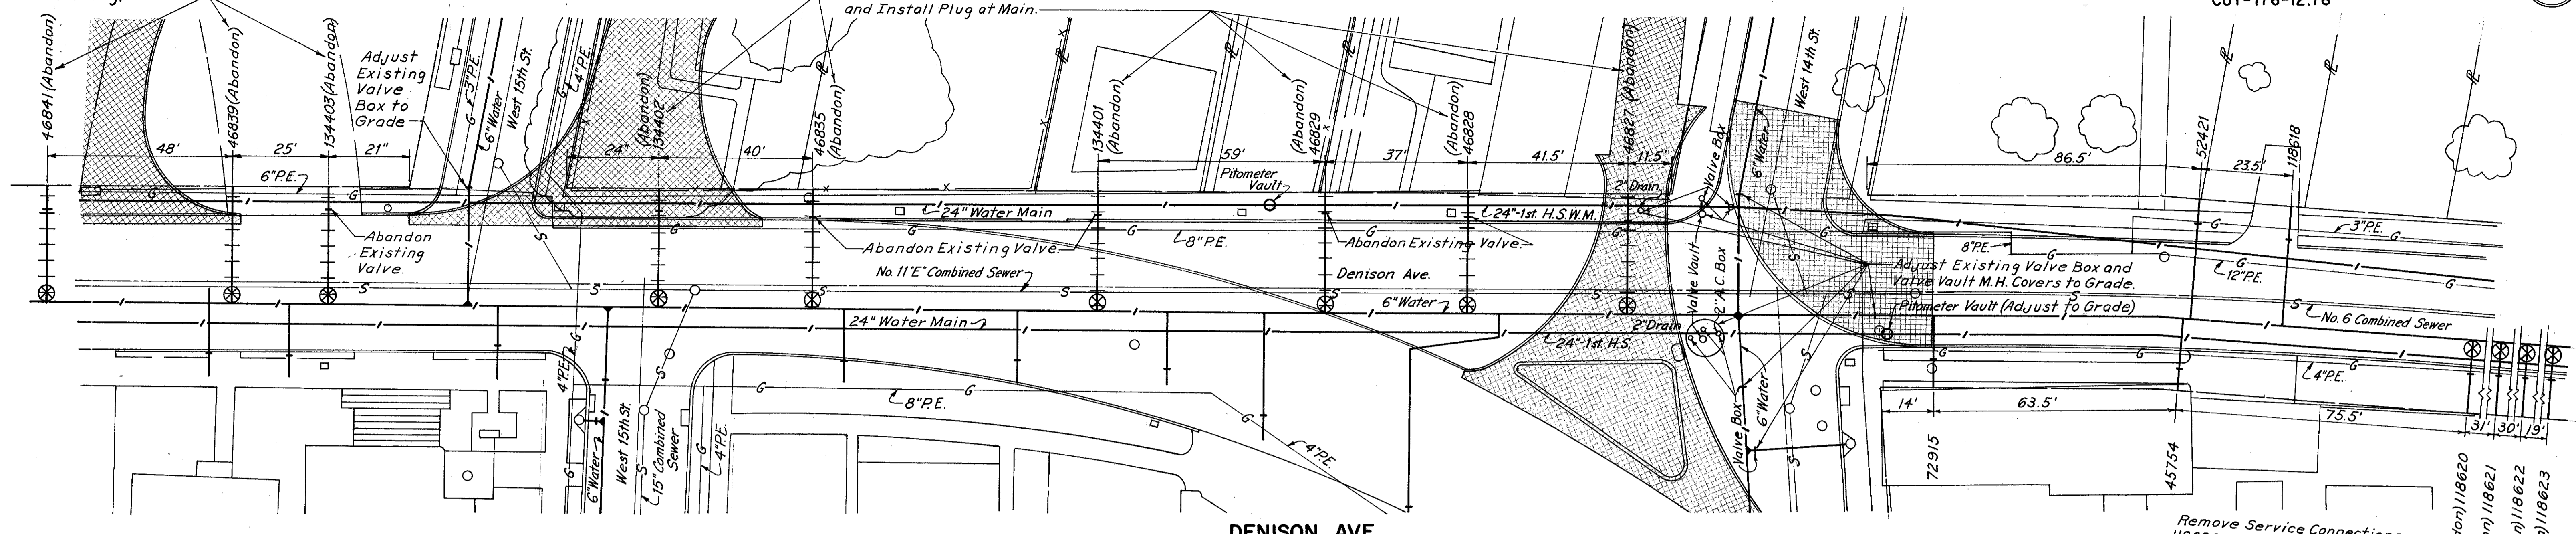

DENISON AVE.

Remove Service Connections 118620, 118621, 118622 & 118623 and Install Plug at Main. Abandon Existing Valves.

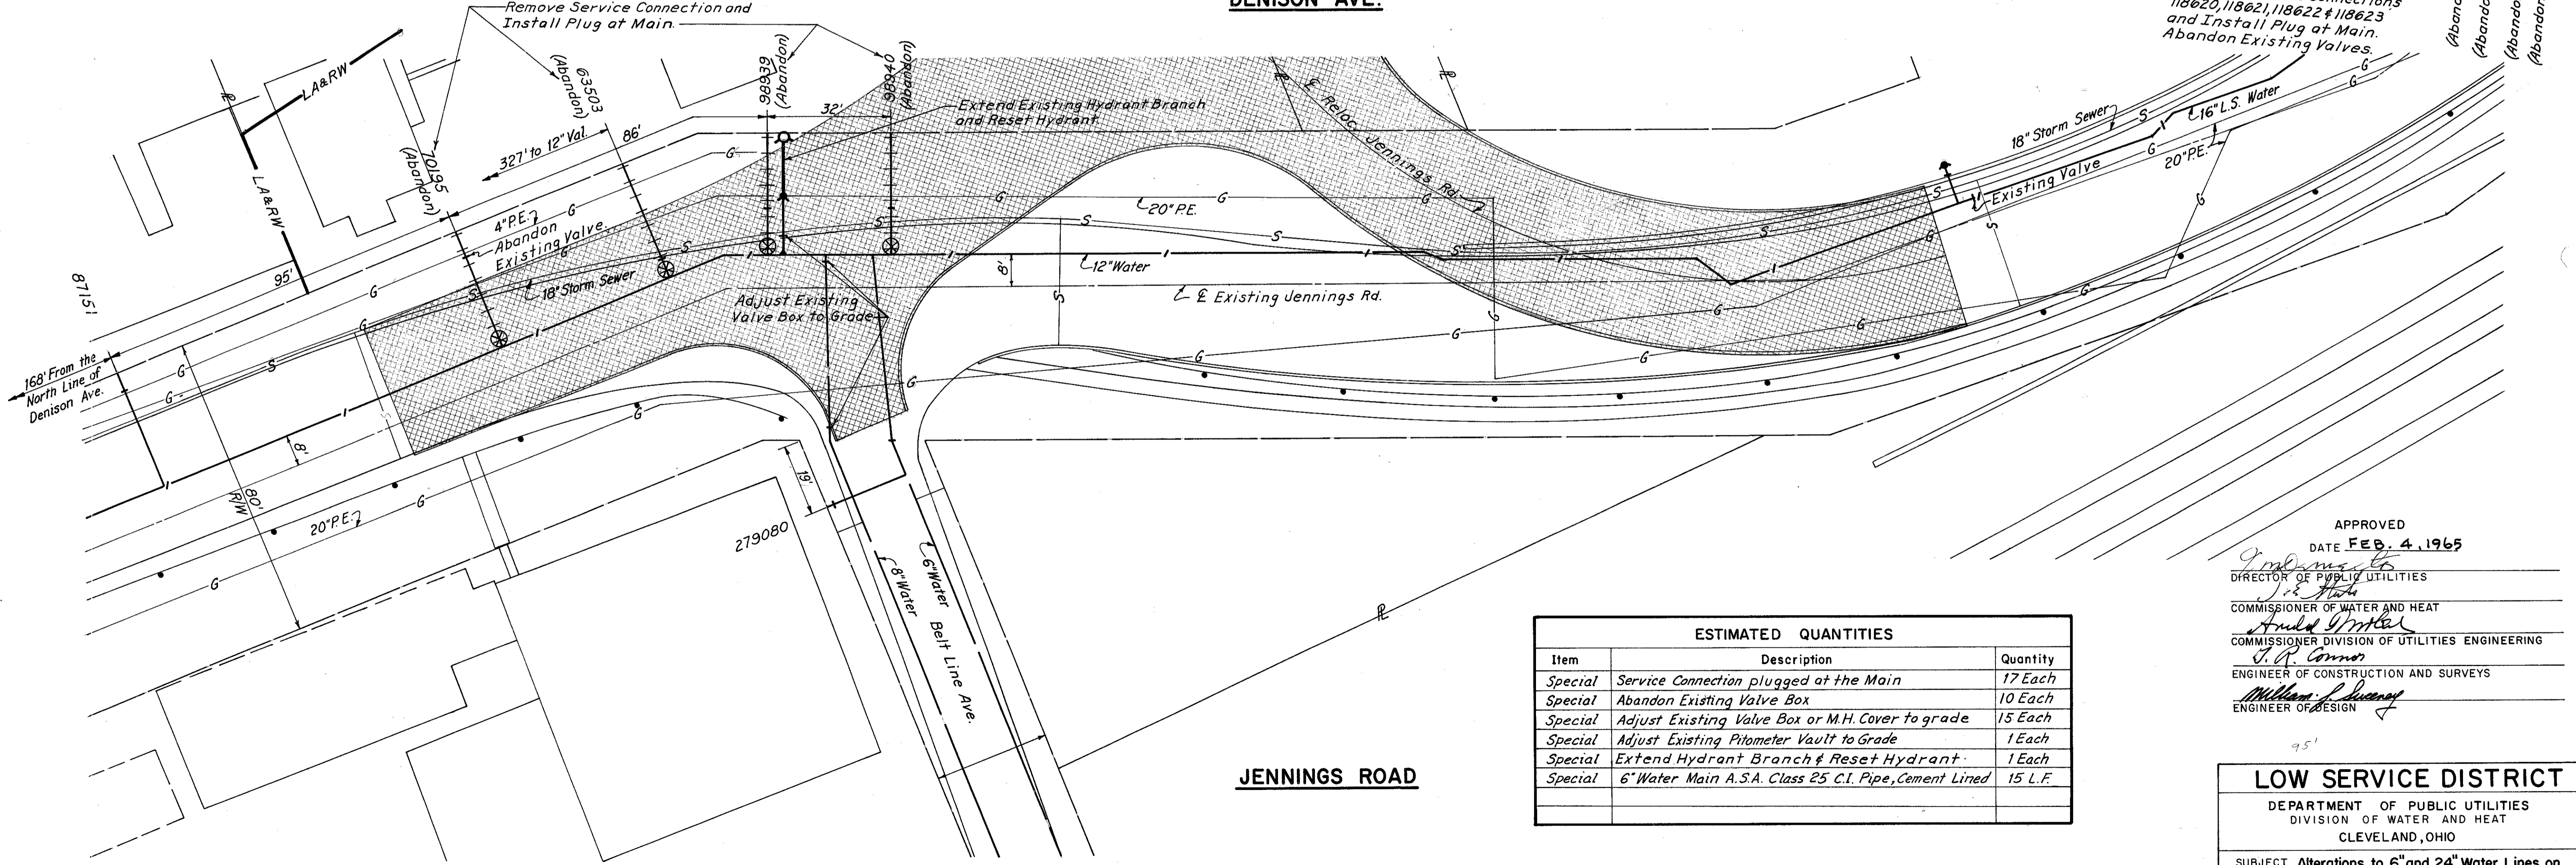

JENNINGS ROAD

ESTIMATED QUANTITIES		
Item	Description	Quantity
Special	Service Connection plugged at the Main	17 Each
Special	Abandon Existing Valve Box	10 Each
Special	Adjust Existing Valve Box or M.H. Cover to grade	15 Each
Special	Adjust Existing Pitometer Vault to Grade	1 Each
Special	Extend Hydrant Branch & Reset Hydrant	1 Each
Special	6" Water Main A.S.A. Class 25 C.I. Pipe, Cement Lined	15 L.F.

APPROVED
DATE FEB. 4, 1965
J. P. Connor
DIRECTOR OF PUBLIC UTILITIES
Arthur J. Miller
COMMISSIONER OF WATER AND HEAT
J. P. Connor
COMMISSIONER DIVISION OF UTILITIES ENGINEERING
ENGINEER OF CONSTRUCTION AND SURVEYS
William J. Dwyer
ENGINEER OF DESIGN

LOW SERVICE DISTRICT
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER AND HEAT
CLEVELAND, OHIO

SUBJECT: Alterations to 6" and 24" Water Lines on Denison Ave. From 95' West of W. 15th St. to 233' East of W. 14th St.
Alterations to 12" Water Line on Jennings Rd. Vicinity Belt Line Ave.
8-1958

MADE T.J.T. DATE 11-12-64 TRACED D.V.S. & R.J.K. DATE 10-30-64
CHECKED _____ DATE _____ SCALE 1" = 20'

HOWARD, NEEDLES, TAMMEN & BERGENDOFF
CONSULTING ENGINEERS
KANSAS CITY CLEVELAND NEW YORK