



PROFILE 12" WATER MAIN - DENISON AVENUE

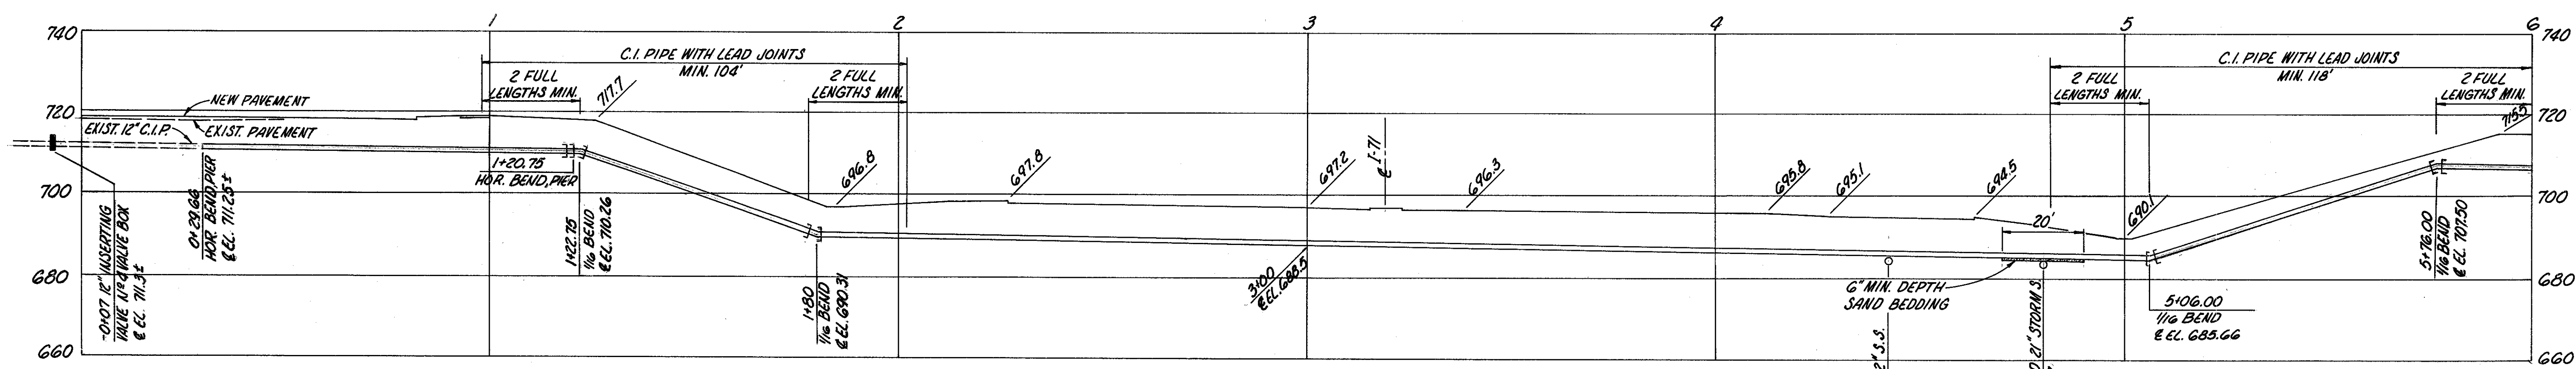

NOTE:
RELOCATED 12" W.M. BETWEEN STATIONS
1+80 & 5+06 TO BE CEMENT LINED DUCTILE
IRON PIPE, CL. 25.

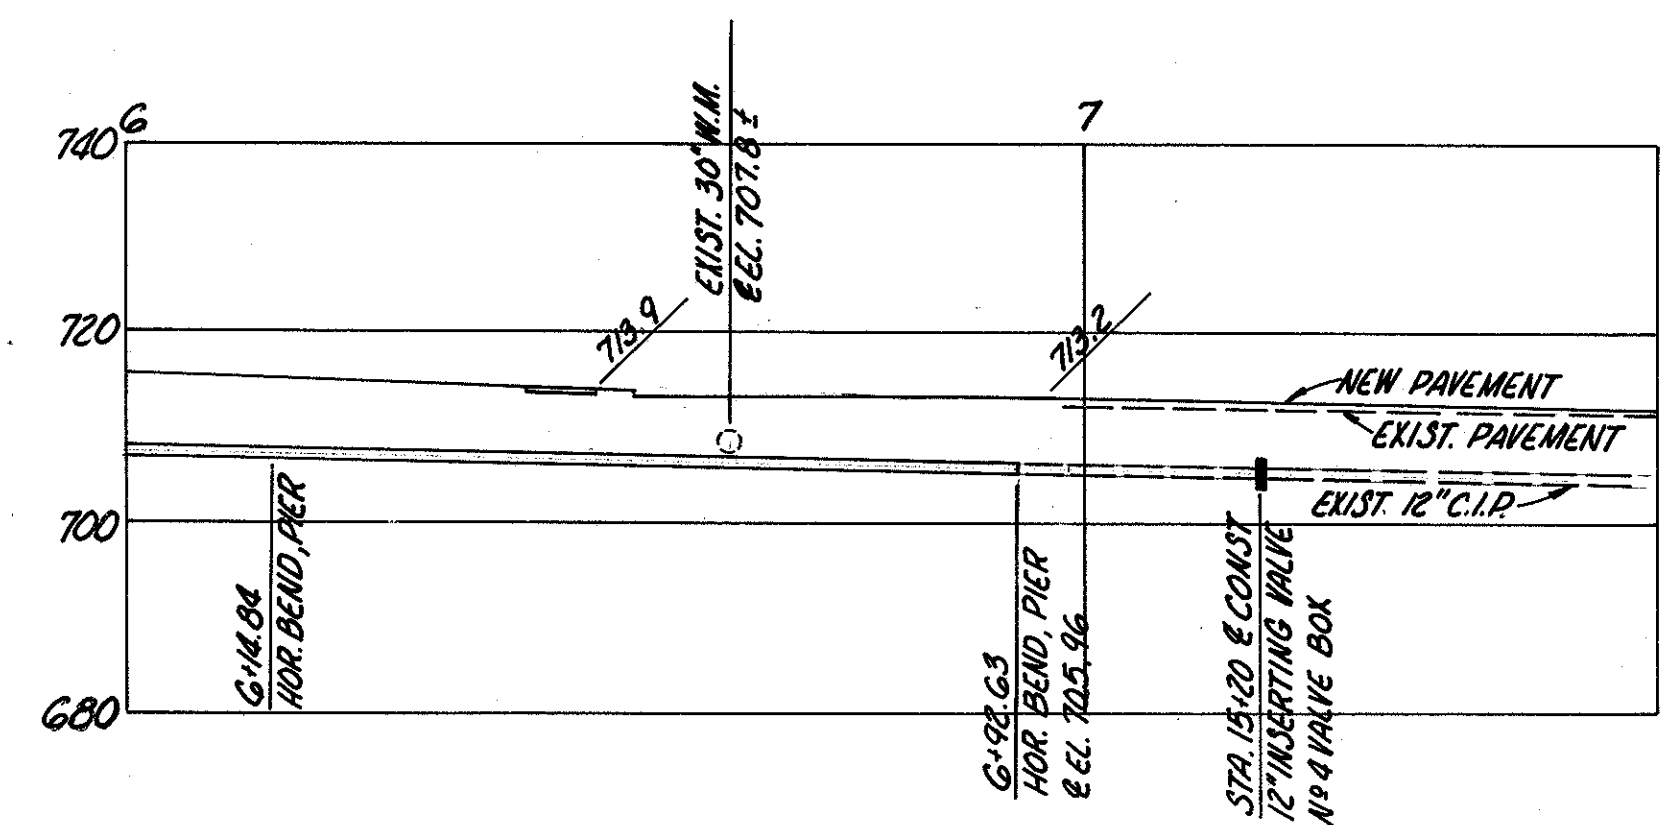

| | | | |
|--|--|--------------------------------------|---------|
| 1ST. HIGH SERVICE DISTRICT | | HORIZONTAL & VERTICAL SCALES 1"=20' | |
| DEPARTMENT OF PUBLIC UTILITIES | | RACKOFF ASSOCIATES | |
| DIVISION OF WATER AND HEAT | | ENGINEERS COLUMBUS - CLEVELAND, OHIO | |
| CLEVELAND, OHIO | | | |
| APPROVED MARCH 26, 1965 | | | |
| V. M. DeMello | DIRECTOR OF PUBLIC UTILITIES | | |
| J. E. Stanton | COMMISSIONER OF WATER AND HEAT | | |
| Arnold Miller | COMMISSIONER - DIVISION OF UTILITIES - ENGINEERING | | |
| J. R. Connor | ENGINEER OF CONSTRUCTION & SURVEYS | | |
| William J. Sweeney | ENGINEER OF DESIGN | | |
| MEDINA FREEWAY PROFILE OF 12" W.M. IN DENISON AVENUE | | | |
| Designed | Drawn | Traced | Checked |
| Reviewed | Date | Revised | |