


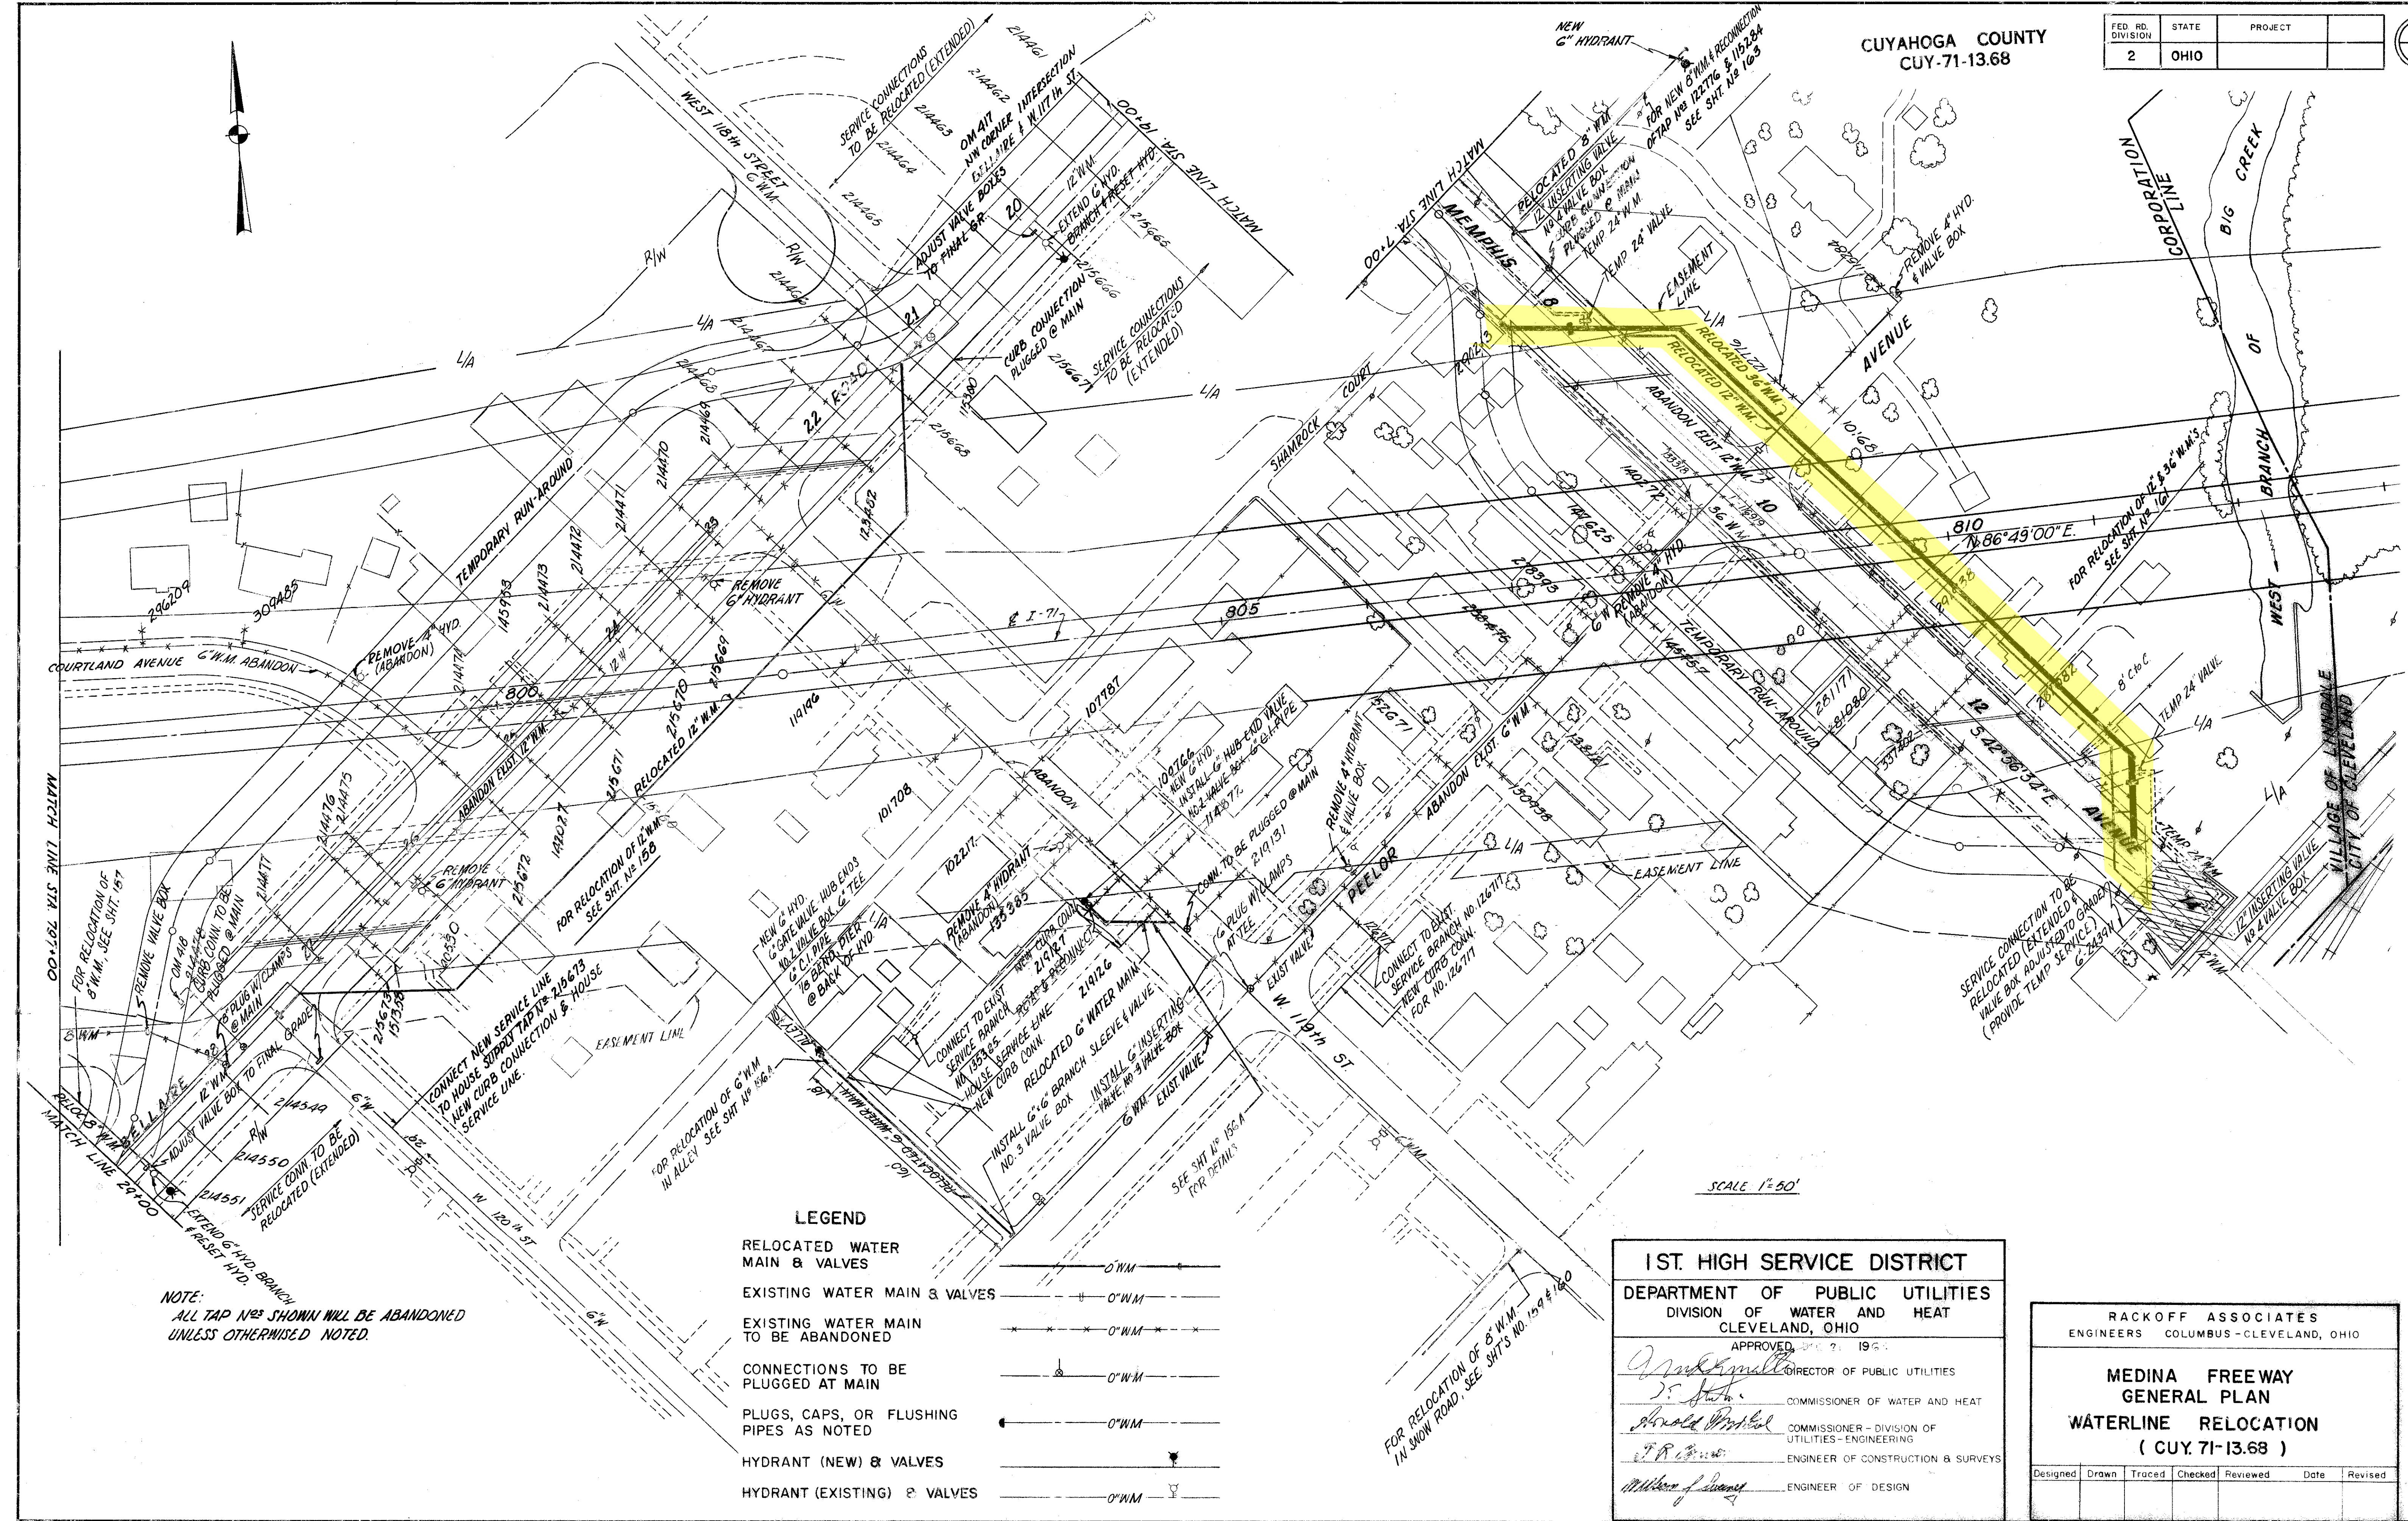

NOTE:
ALL TAP NOS SHOWN WILL BE ABANDONED
UNLESS OTHERWISE NOTED.

- LEGEND**
- RELOCATED WATER MAIN & VALVES
 - EXISTING WATER MAIN & VALVES
 - EXISTING WATER MAIN TO BE ABANDONED
 - CONNECTIONS TO BE PLUGGED AT MAIN
 - PLUGS, CAPS, OR FLUSHING PIPES AS NOTED
 - HYDRANT (NEW) & VALVES
 - HYDRANT (EXISTING) & VALVES

1ST. HIGH SERVICE DISTRICT
DEPARTMENT OF PUBLIC UTILITIES
DIVISION OF WATER AND HEAT
CLEVELAND, OHIO

APPROVED: 2/19/68
DIRECTOR OF PUBLIC UTILITIES

COMMISSIONER OF WATER AND HEAT

COMMISSIONER - DIVISION OF UTILITIES - ENGINEERING

ENGINEER OF CONSTRUCTION & SURVEYS

ENGINEER OF DESIGN

RACKOFF ASSOCIATES ENGINEERS COLUMBUS - CLEVELAND, OHIO							
MEDINA FREEWAY GENERAL PLAN WATERLINE RELOCATION (CUY. 71-13.68)							
Designed	Drawn	Traced	Checked	Reviewed	Date	Revised	