
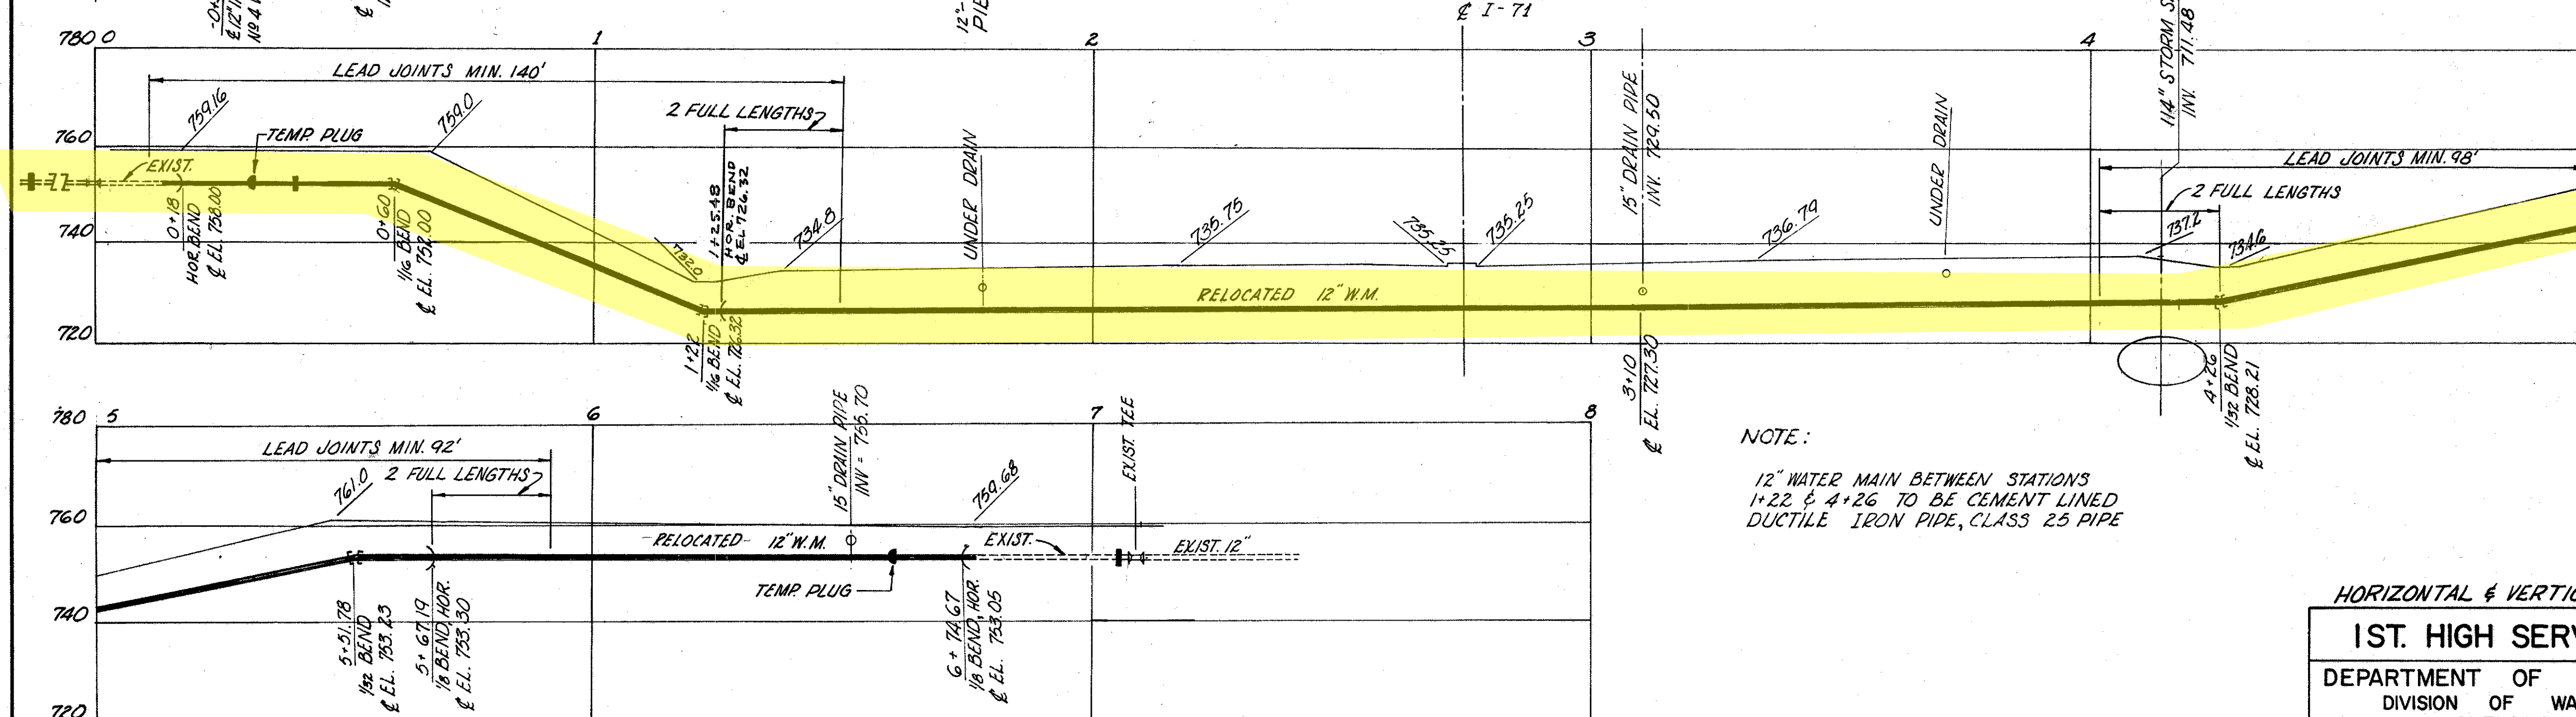


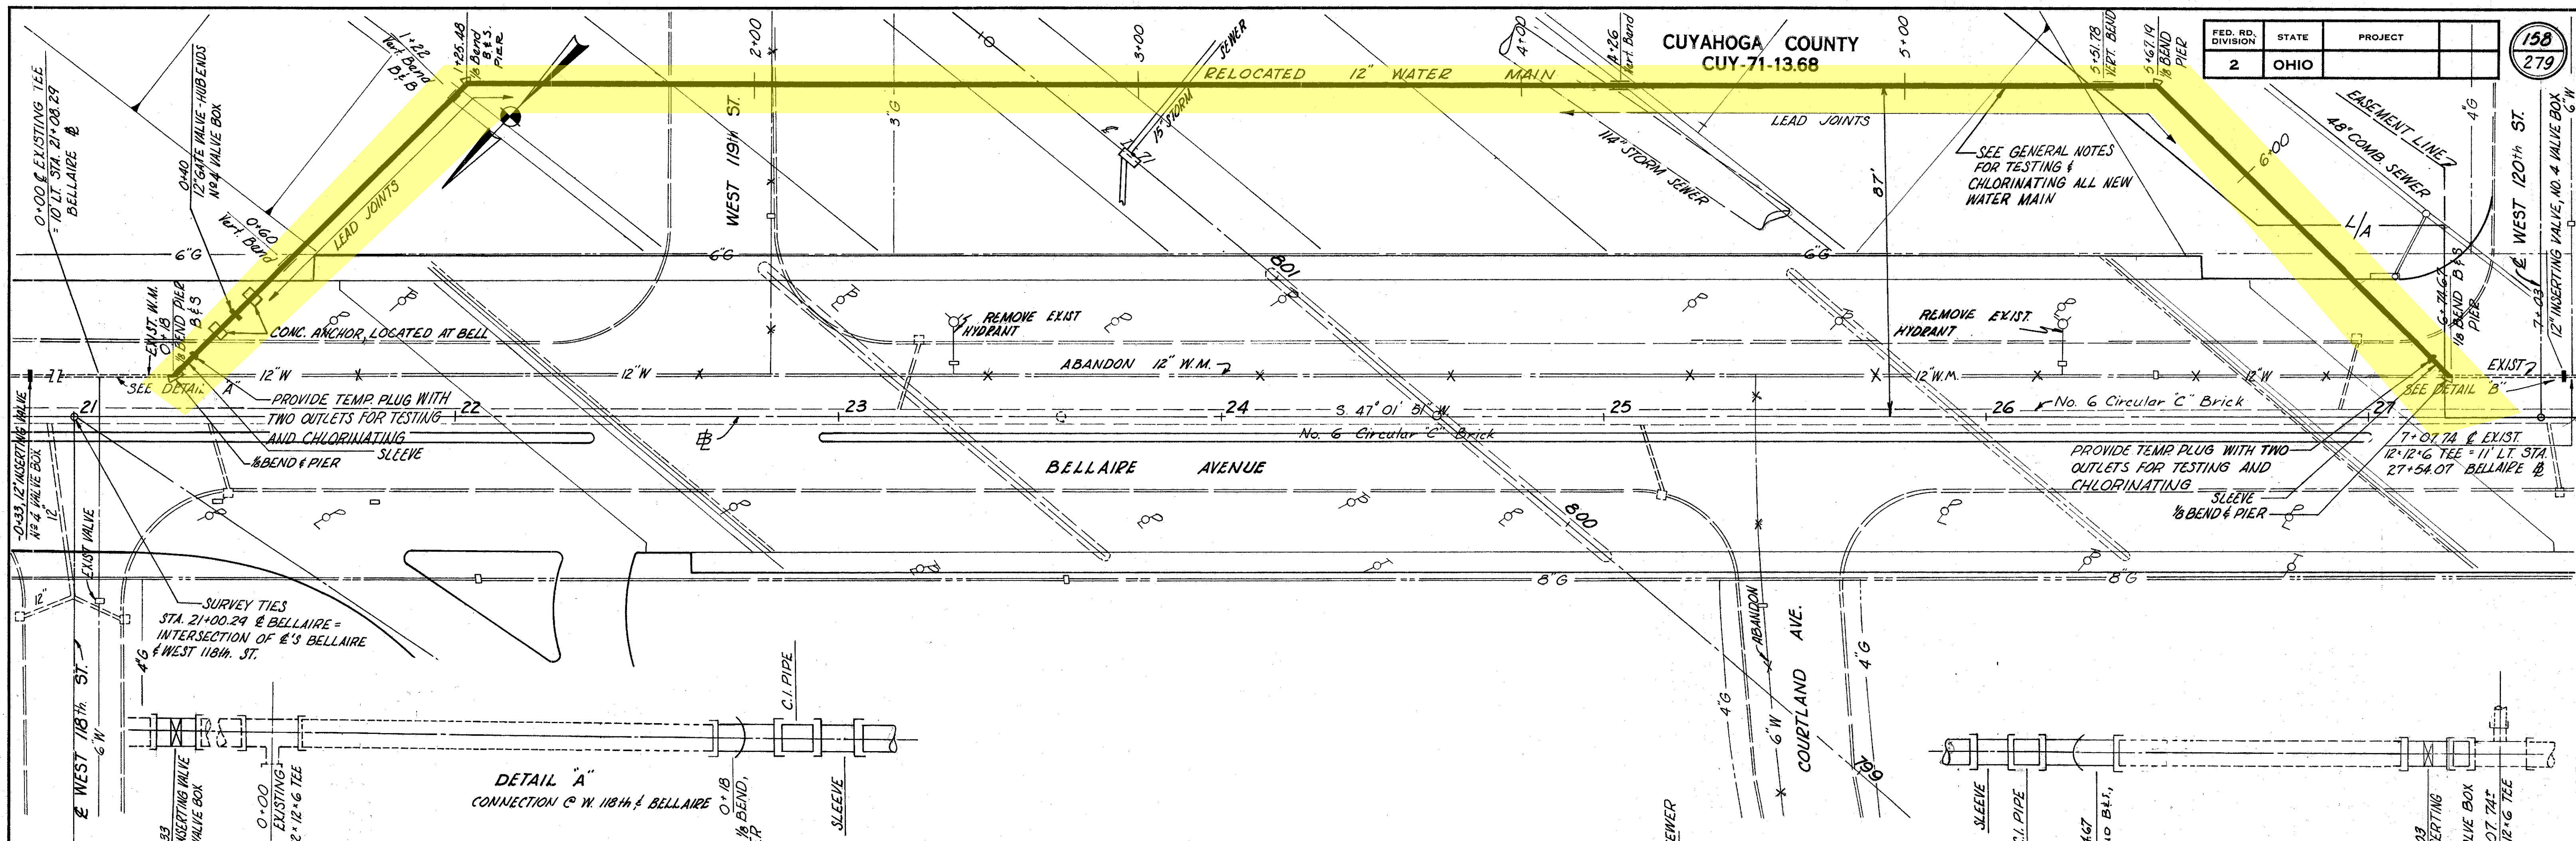

PROFILE RELOCATED 12" WATER MAIN

NOTE:
12" WATER MAIN BETWEEN STATIONS
1+22 & 4+26 TO BE CEMENT LINED
DUCTILE IRON PIPE, CLASS 25 PIPE

HORIZONTAL & VERTICAL SCALES: 1"=20'

1ST. HIGH SERVICE DISTRICT	
DEPARTMENT OF PUBLIC UTILITIES DIVISION OF WATER AND HEAT CLEVELAND, OHIO	
APPROVED, DEC. 21, 1964.	
<i>[Signature]</i> DIRECTOR OF PUBLIC UTILITIES	
<i>[Signature]</i> COMMISSIONER OF WATER AND HEAT	
<i>[Signature]</i> COMMISSIONER - DIVISION OF UTILITIES - ENGINEERING	
<i>[Signature]</i> ENGINEER OF CONSTRUCTION & SURVEYS	
<i>[Signature]</i> ENGINEER OF DESIGN	

RACKOFF ASSOCIATES ENGINEERS COLUMBUS, OHIO	
MEDINA FREEWAY RELOCATION OF 12" WATER MAIN IN BELLAIRE AVE.	
Designed	Drawn
Traced	Checked
Reviewed	Date
Revised	