THE C.E.I. CO.	REQUESTED BY 8/15/11	FAC. MAPPING REFERENCE # -	GRID # 4722
FILE 53724361	DATE 5/19/11		SHEET 3 OF 3

2 WORKING DAYS
BEFORE YOU DIG
"IT'S THE LAW"
CALL TOLL FREE 800-362-2764
OHIO UTILITIES PROTECTION SERVICE

DESIGN

SURVEY FOR	INNERBELT BRIDGE PROJECT – COMMERCIAL RD PROJ.
ADDRESS	COMMERCIAL ROAD TO CENTRAL AVENUE
MUNICIPALITY	CITY OF CLEVELAND — SCALE: NONE
ORDER FOR	OHIO DEPARTMENT OF TRANSPORTATION
PREPARED BY	SURVEY OFFICE — DRAWN BY CHATFIELD — PHONE 440.717.6846
DESCRIPTION	H-5-CN-P CABLE POLE RELOCATION WORK – OH TO UG (KNOWN AS ODOT PHASE 3)

CONST. PLANS APPROVED _____ JOINT PROPOSAL

MARKETING B.J.D. J.U.

CONSUMER'S CHARGE

DATE	REC.	FOREST	O.H.	SUBWAY	CABLE	SERV	RDU	DMC3	MER3	DEB1	RJS1	TOTAL
5 19 11	2		1		2		1	1	1	1	1	10

RETURN TO RIGHT-OF-WAY BEFORE SCHEDULING — DATE CLEARED _____

JOINT POLE RELEASE

GANG MEET ☐ TREE WORK ☐ MUNICIPAL PERMIT ☐ INFO ☐

REVISION HISTORY

DATE	DESCRIPTION	APPROVED BY
5/19/11	CABLE INSTALL RELEASE	

CONSTRUCTION

A CHECK MARK NEXT TO EACH ITEM ON THE SKETCH, INCLUDING CHANGES, INDICATES THAT THE WORK HAS BEEN COMPLETED

ITEMS	UNITS OF WORK COMPLETED: INSTALLED	REMOVED	SHIFTED
POLES			
WIRE			
TRANS			
ANCHORS			

KIND OF POLE(S) INSTALLED BY SYMBOL

POLES LEFT FOR TEL. TO REMOVE

REMARKS

DATE WORK COMPLETED — SUPERVISORS SIGNATURE

CAUTION

UNDERGROUND FACILITIES WARNING

	AT SYMBOL	CHECKED BY	SPECIAL INSTRUCTIONS
HIGH PRESSURE PIPELINE			
CEI	"	"	
TELEPHONE	"	"	

O.H. TRANSMISSION CLEARANCE WARNING

_____ FT. MIN. CLEARANCE REQUIRED AT _____ DEGREES F.

AT SYMBOLS _____

ENGINEERING CHECKED BY: DATE

CONSTRUCTION CHECKED BY: DATE

CONFIDENTIAL
FIRSTENERGY CORP.

INFORMATION IN THIS DOCUMENT IS PROPRIETARY AND SHALL NOT BE USED, COPIED, REPRODUCED OR DISCLOSED IN WHOLE OR IN PART WITHOUT THE WRITTEN CONSENT OF FIRSTENERGY CORP.

WBS: CE-000246-DU

CIRCUITS: H-5-CN-P

SEE WR-53706728 FOR RELATED OVERHEAD WORK

CABLE INSTALL SUMMARY SHEET 3

FROM MH POLE #532965 TO MH 1143-03
INSTALL CABLE-25kV 3/0-1C-CU-EPR-FSN TRIPLEXED (3-1C), 600 TCF TOTAL

FROM MH 1143-03 TO MH 1143-05
INSTALL CABLE-25kV 3/0-1C-CU-EPR-FSN TRIPLEXED (3-1C), 241 TCF TOTAL

FROM MH 1143-05 TO MH 1143-06
INSTALL CABLE-25kV 3/0-1C-CU-EPR-FSN TRIPLEXED (3-1C), 83 TCF TOTAL

FROM MH 1143-06 TO POLE #218119
REMOVE 15KV 4/0-3C-CU-PILC-JKT, 119 TCF TOTAL

CABLE WORK ON SHEET 3

AT P# 532965
INSTALL 6-15KV POLE MOUNTED TERMINATIONS

IN MH 1143-03
INSTALL 3-15KV-1C STRAIGHT 3/0 MOLDED SPLICES

IN MH 1143-05
INSTALL 3-15KV-1C STRAIGHT 3/0 MOLDED SPLICES

IN MH 1143-06
REMOVE 5KV SPLICE 4/0-3C-PILC, RESHAPE REMAINING EAST PILC CABLE
INSTALL 15KV COLDSHRINK TRANS SPLICE 4/0-3C-PILC TO 3/0-1C EPR
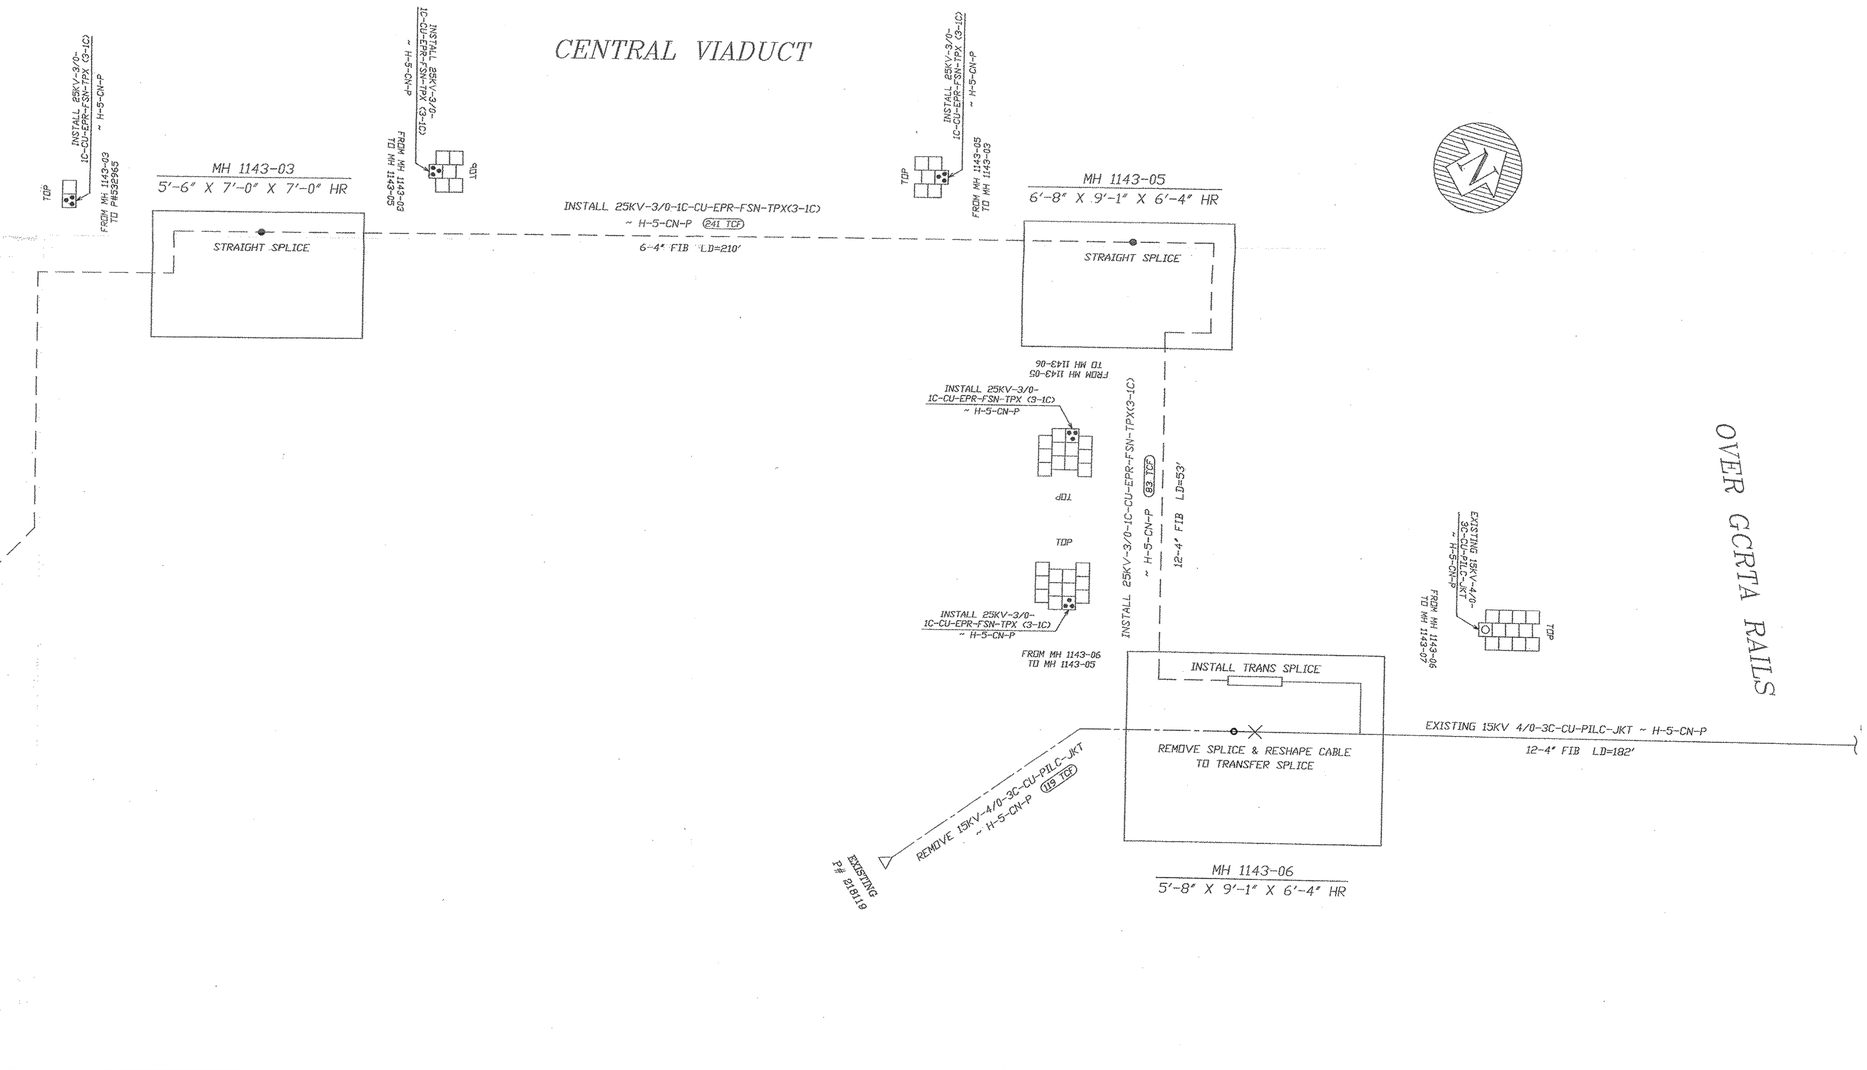
AT P# 532965
REMOVE POLE MOUNTED POTHEAD