


CONSOLIDATION TEST REPORT

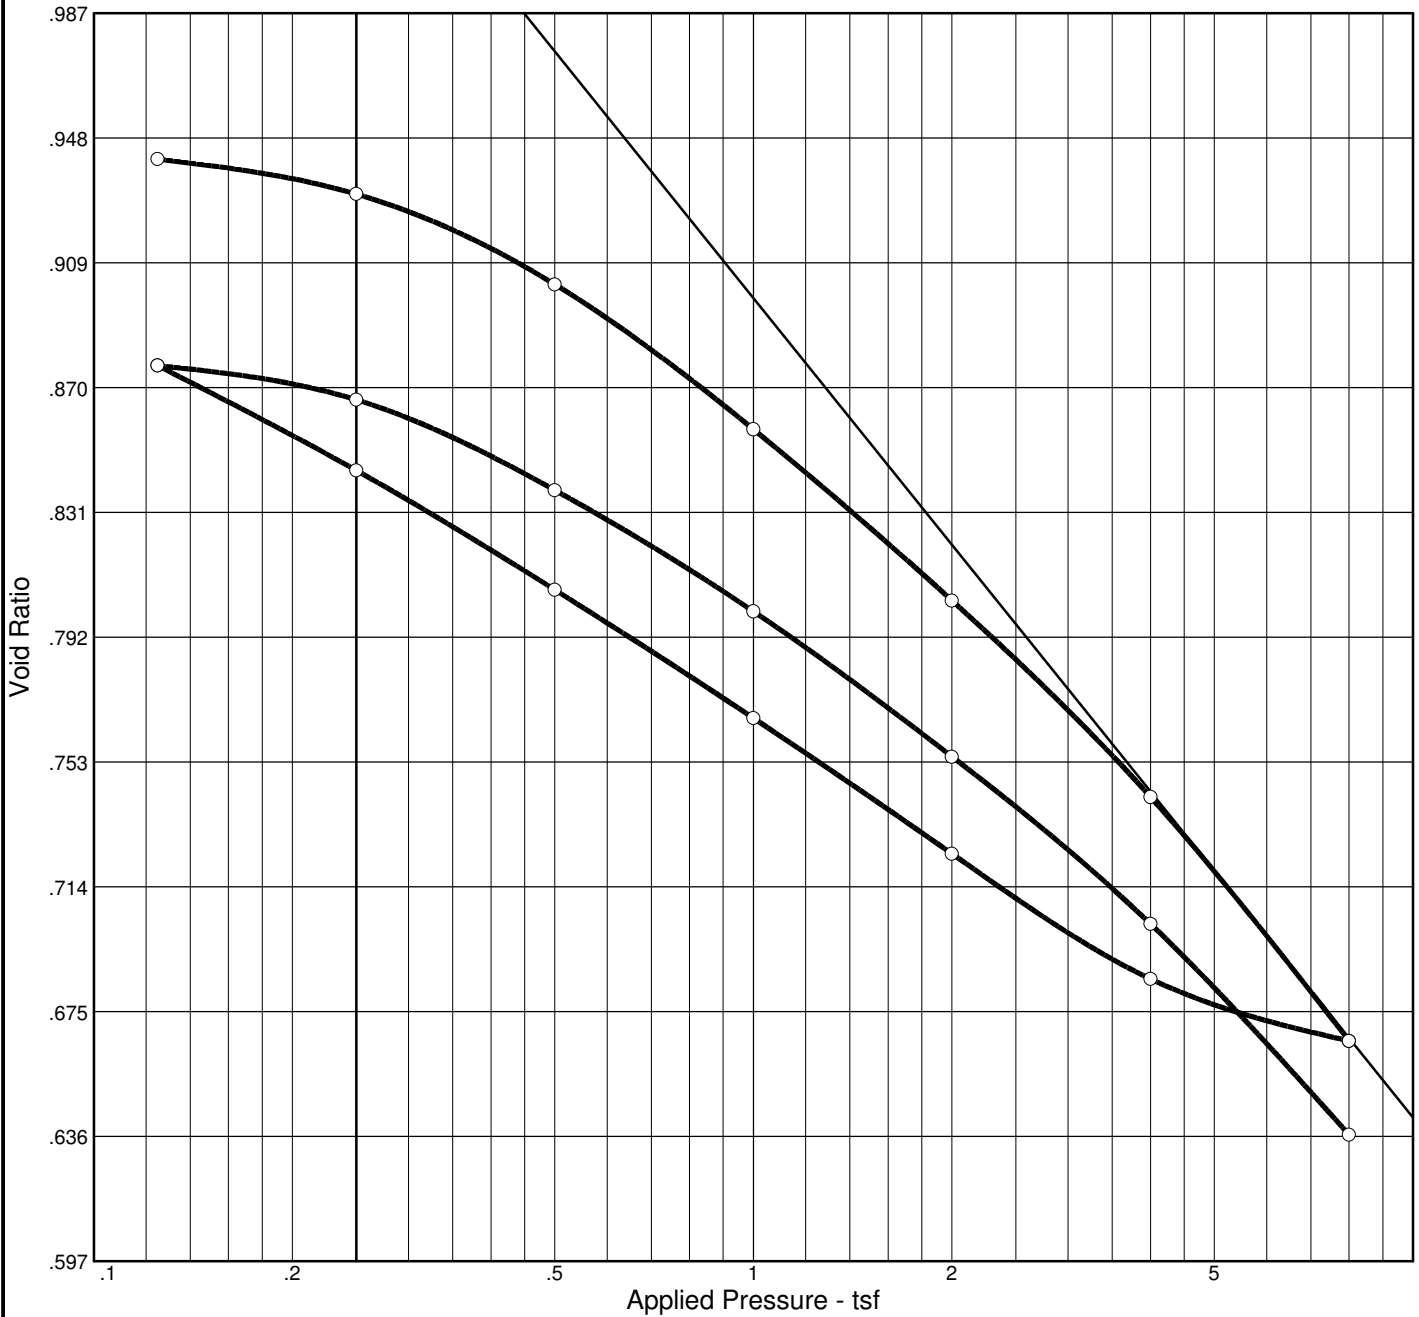

Natural		Dry Dens. (pcf)	LL	PI	Sp. Gr.	USCS	AASHTO	Initial Void Ratio
Saturation	Moisture							
99.8 %	34.8 %	85.8	47	25	2.64	CL	A-7-6(28)	0.920

MATERIAL DESCRIPTION

Lean clay

Project No. 0121-
Project: SCI-823-0.00

Client: TranSystems, Inc.

Remarks:
Specific Gravity= 2.64

Source: C-22

Sample No.: P-3

Elev./Depth: 32



Figure