


CONSOLIDATION TEST REPORT

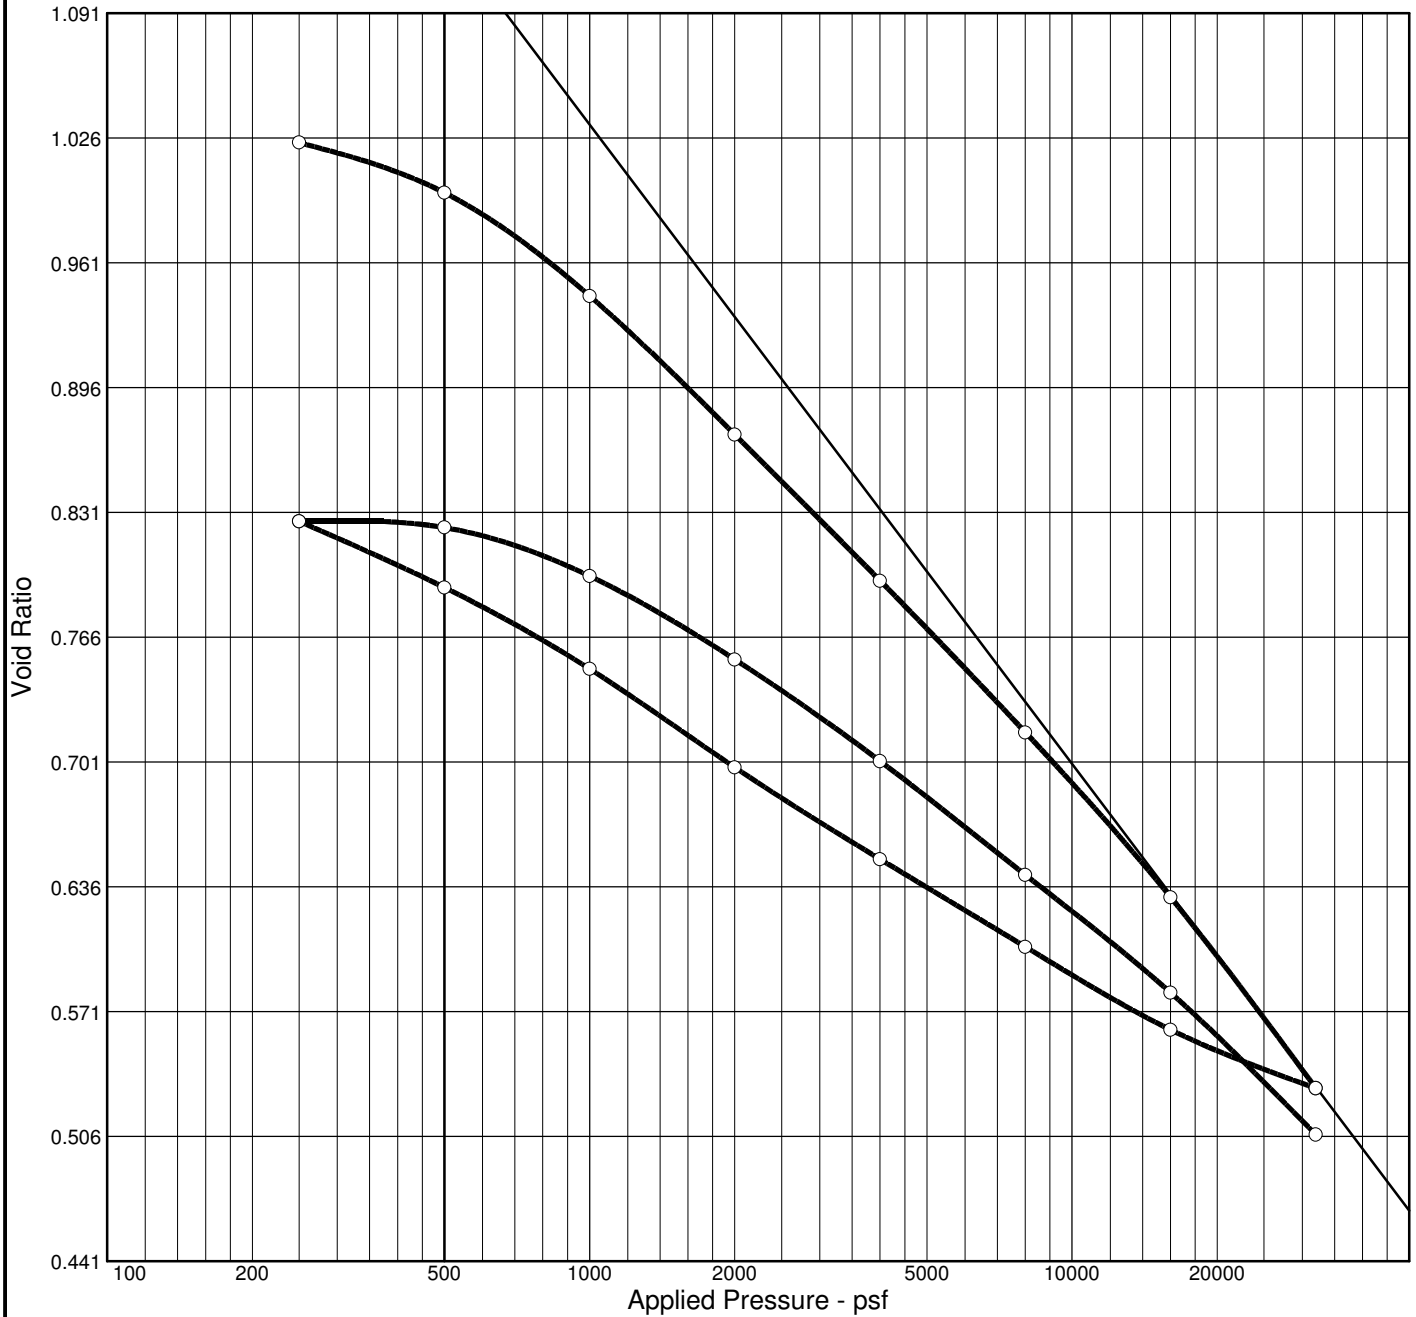

Natural		Dry Dens. (pcf)	LL	PI	Sp. Gr.	USCS	AASHTO	Initial Void Ratio
Saturation	Moisture							
90.1 %	33.4 %	85.8		44	2.8	CH	A-7-6	1.037

MATERIAL DESCRIPTION

Project No. 0121-	Client: TranSystems, Inc.	Remarks:
Project: SCI-823-0.00		
Source: R-329	Sample No.: 5 Elev./Depth: 11	



Figure