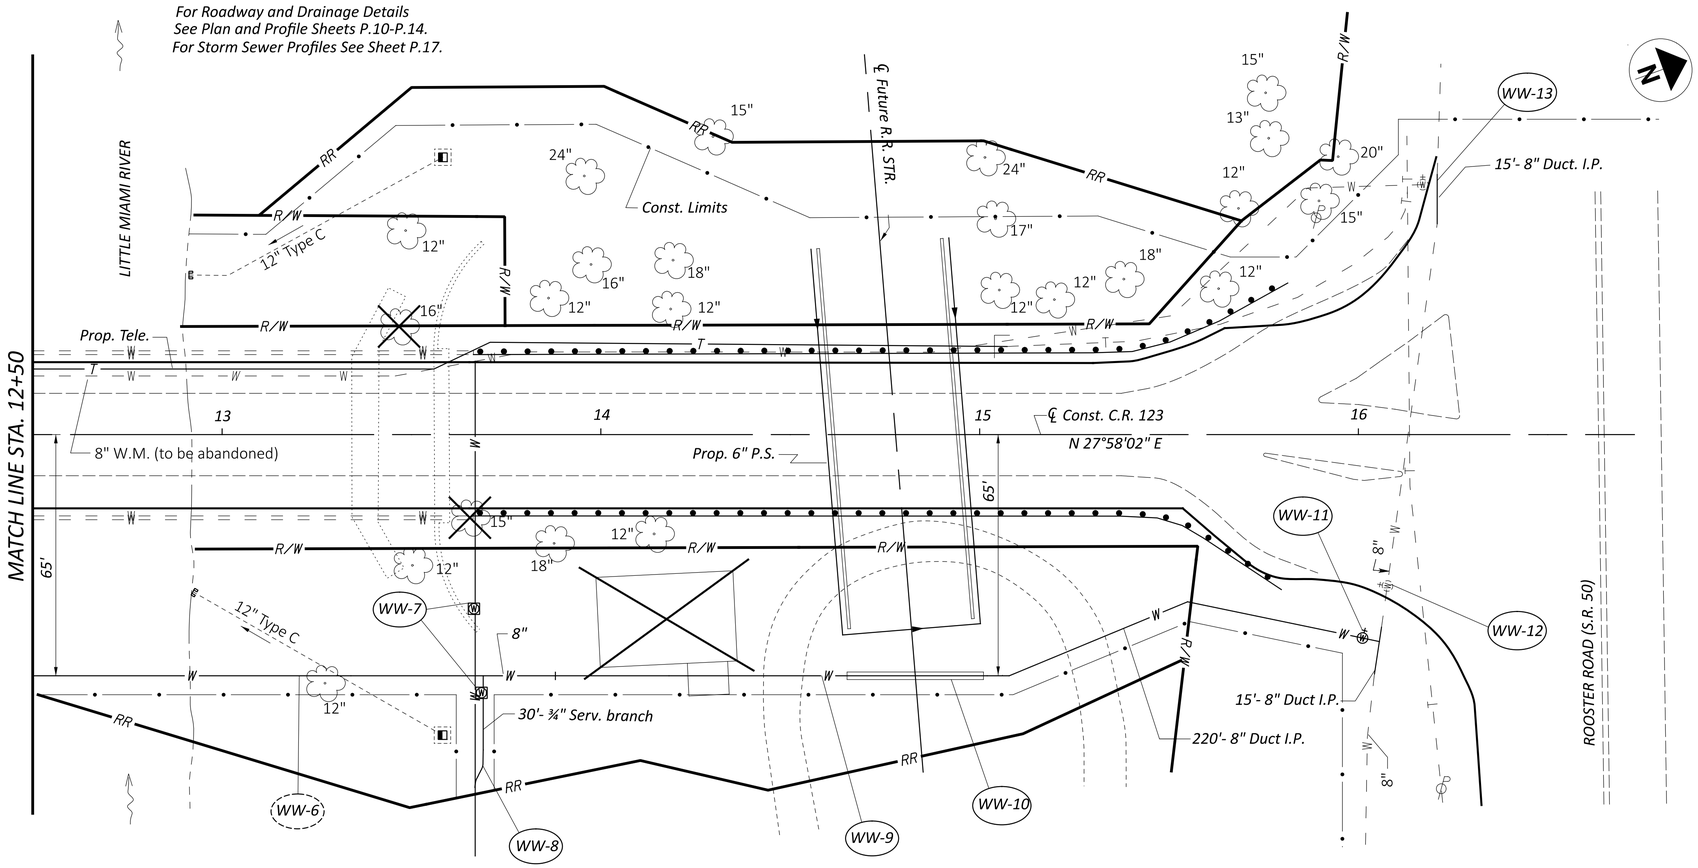

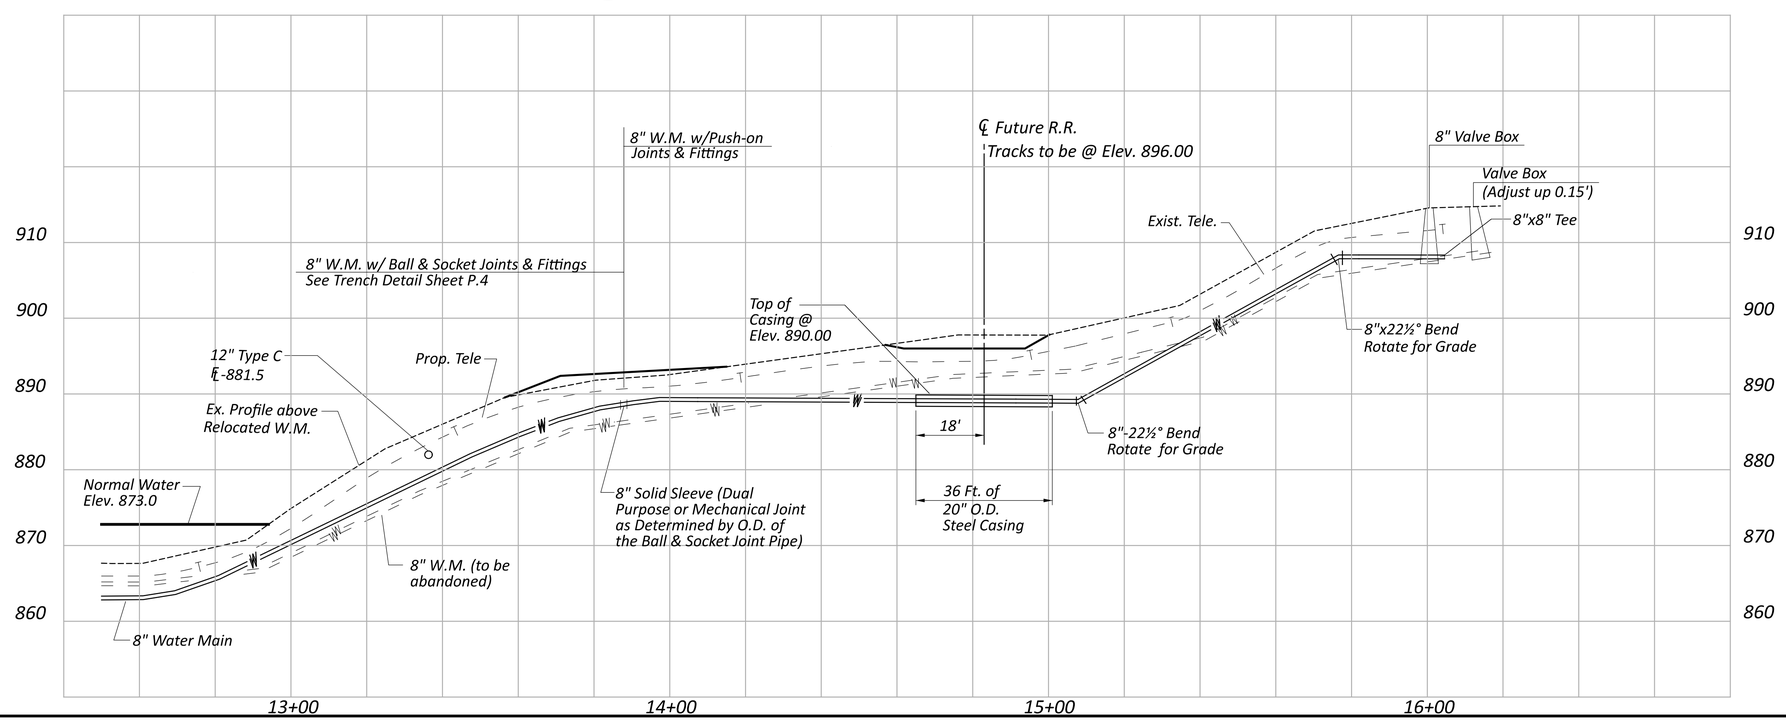

REF NO.	STATION FROM	STATION TO	SIDE	8" Water Main Ductile Iron Pipe ANSI Class 53, Push-on Joints and Fittings (FT)	20" Steel Pipe Encasement, Open Cut (FT)	Valve Box Adjusted to Grade (EACH)	¾" Copper Service Branch (FT)	Meter and Chamber Removed and Reset (EACH)	Sheeting and Bracing Ordered Left in Place (MBF)	8" Gate Valve and Valve Box (EACH)
WW-7	13+66	13+70	RT					1		
WW-8	13+67	13+70	RT				30			
WW-9	13+88	16+07	RT	235	36					
WW-10	14+65	15+01	RT							
WW-11	16+00		RT			1				1
WW-12	16+08		RT							
WW-13	16+20		LT	15					1	
TOTALS CARRIED TO GENERAL SUMMARY				250	36	1	30	1	1	1

638

HORIZONTAL SCALE IN FEET 0 10 20 40

WATER WORK PLAN
STA. 12+50 TO STA. 16+00

DESIGN AGENCY
Jane C. Smith Consulting, Inc.
9999 English Drive
Computerland, Ohio 00000

DESIGNER GJB
REVIEWER DJK 01/17/25
PROJECT ID 131301
SHEET P.12 TOTAL 127

CUY-CR123-6.55

MODEL: SP1313-1 PAPERSIZE: 34x22 (in.) DATE: 1/17/2025 TIME: 8:00:00 AM
pw:\\ohiodot-pw.bentley.com:ohiodot-pw-02\Documents\03 Standards\Sample Plans\02-Working\SP1313-1.dgn