LIGHT TOWER SCHEDULE

POLE I.D.	ROADWAY ELEVATION WITHIN 300'	POLE ELEVATION	POLE HEIGHT	NUMBER OF LUMINAIRES
A1-1	573'	563'	110'	6
A1-3	583'	575'	110'	4
A1-4	592'	584'	110'	4
A2-1	565'	545'	120'	6
A2-2	550'	538'	110'	6
A2-3	554'	546'	110'	6
A2-5	535'	525'	110'	6
A2-6	527'	518'	110'	6
A2-7	520'	520'	100'	4
A3-1	562'	546'	120'	6
A3-2	556'	538'	120'	4
A3-3	548'	534'	120'	4
A3-5	533'	530'	100'	6
B1-1	540'	525'	120'	6
B1-2	536'	528'	110'	4
B1-3	550'	540'	120'	6
B1-6	530'	524'	120'	7
B2-2	540'	529'	120'	6
B2-3	546'	523'	120'	6
B2-4	529'	523'	100'	6
B3-1	536'	527'	110'	6
B3-2	527'	526'	100'	7
B3-3	533'	526'	110'	6
B3-5	545'	536'	110'	6

LIGHT POLE SCHEDULE

POLE I.D.	ROADWAY ELEVATION	POLE ELEVATION	POLE HEIGHT	NUMBER OF LUMINAIRES
A1-5	601'	590'	60'	2
A1-7	608'	595'	60'	1
A1-8	614'	601'	60'	1
A1-9	620'	608'	60'	1
A3-6	530'	530'	40'	1
A3-7	530'	530'	40'	1
A3-8	530'	533'	50'	1
A3-10	530'	529'	50'	1
A3-11	530'	529'	50'	1
A3-12	530'	529'	50'	1

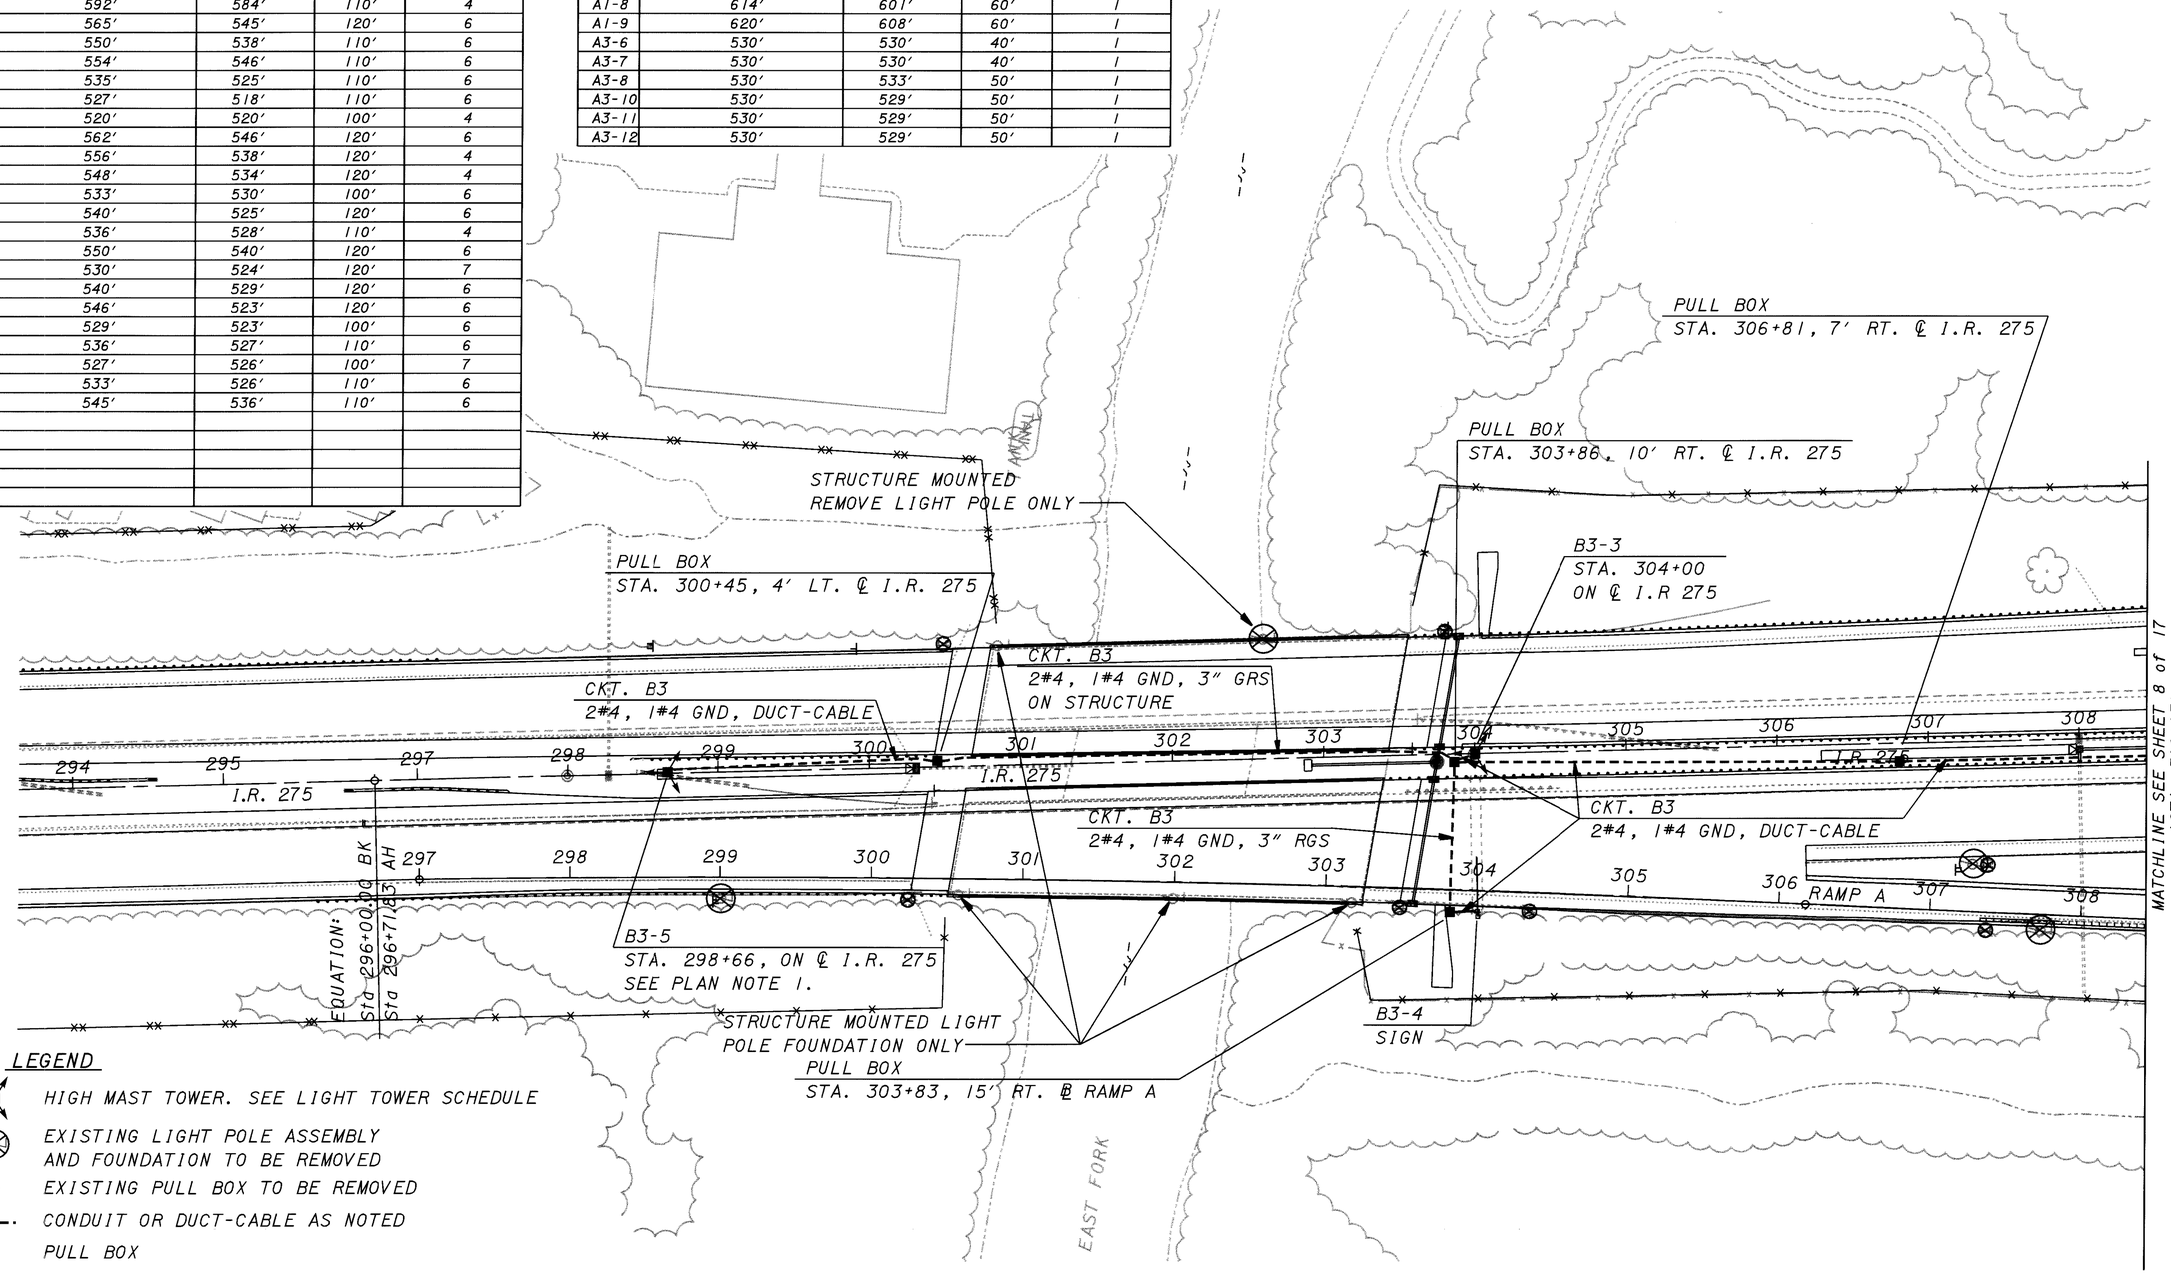

LEGEND

- HIGH MAST TOWER. SEE LIGHT TOWER SCHEDULE
- EXISTING LIGHT POLE ASSEMBLY AND FOUNDATION TO BE REMOVED
- EXISTING PULL BOX TO BE REMOVED
- CONDUIT OR DUCT-CABLE AS NOTED
- PULL BOX
- LOW MAST LIGHTING UNIT. SEE LIGHT POLE SCHEDULE
- CONVENTIONAL LIGHT STANDARD, SEE LIGHT POLE SCHEDULE FOR MOUNTING HEIGHT WITH 15' BRACKET ARM AND 200 W HPS COBRA HEAD LUMINAIRE
- B3-4 POLE DESIGNATION, "B" IS THE CONTROL CENTER, "3" IS THE CIRCUIT NUMBER AND "4" IS THE I.D.

PLAN NOTES

1. PROVIDE EMPTY 2" CONDUIT ELL FOR FUTURE EXPANSION TO THE NORTH.

N

50' 0 50' 100'
SCALE IN FEET

DESIGN AGENCY
HNTB 55 Erieview Plaza, Suite 900 Cleveland, Ohio 44114-1836
ARCHITECTS ENGINEERS PLANNERS

DESIGNED	DRAWN	REVIEWED	DATE
JGS/SMS	TGM		06/06/01
CHECKED	REVISED	STRUCTURE FILE NUMBER	
LEL		1305697	

LIGHTING PLAN - IR 275
STA. 293+70 TO STA. 308+36
CLE-275-05.35

CLE-275-05.35

7/17

619/857

SSympson 06-JUN-2001 J:\3ll47\dwgs\LP001.dgn