





PLAN NOTES

1. POWER SERVICE SHALL BE 100 AMPERE, 240/480 VOLT, SINGLE PHASE, THREE WIRE SECONDARY WITH GROUNDED NEUTRAL.

LEGEND

-  HIGH MAST TOWER. SEE LIGHT TOWER SCHEDULE
-  EXISTING LIGHT POLE ASSEMBLY AND FOUNDATION TO BE REMOVED
-  EXISTING PULL BOX TO BE REMOVED
-  CONDUIT OR DUCT-CABLE AS NOTED
-  PULL BOX
-  LOW MAST LIGHTING UNIT. SEE LIGHT POLE SCHEDULE
-  CONVENTIONAL LIGHT STANDARD, SEE LIGHT POLE SCHEDULE FOR MOUNTING HEIGHT WITH 15' BRACKET ARM AND 200 W HPS COBRA HEAD LUMINAIRE
-  POLE DESIGNATION, "B" IS THE CONTROL CENTER, "3" IS THE CIRCUIT NUMBER AND "4" IS THE I.D.

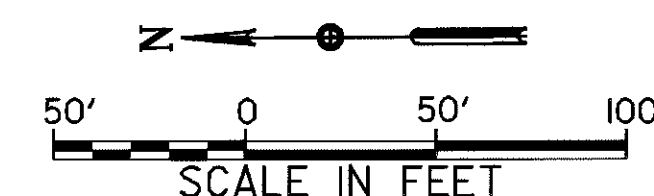

PROPOSED LIGHTING CONTROL CENTER "A"
STA. 339+39, 85' RT. @ RAMP F
SEE PLAN NOTE 1.

