


**LEGEND**

- HIGH MAST TOWER. SEE LIGHT TOWER SCHEDULE
- EXISTING LIGHT POLE ASSEMBLY AND FOUNDATION TO BE REMOVED
- EXISTING PULL BOX TO BE REMOVED
- CONDUIT OR DUCT-CABLE AS NOTED
- PULL BOX
- LOW MAST LIGHTING UNIT. SEE LIGHT POLE SCHEDULE
- CONVENTIONAL LIGHT STANDARD, SEE LIGHT POLE SCHEDULE FOR MOUNTING HEIGHT WITH 15' BRACKET ARM AND 200 W HPS COBRA HEAD LUMINAIRE
- B3-4** POLE DESIGNATION, "B" IS THE CONTROL CENTER, "3" IS THE CIRCUIT NUMBER AND "4" IS THE I.D.

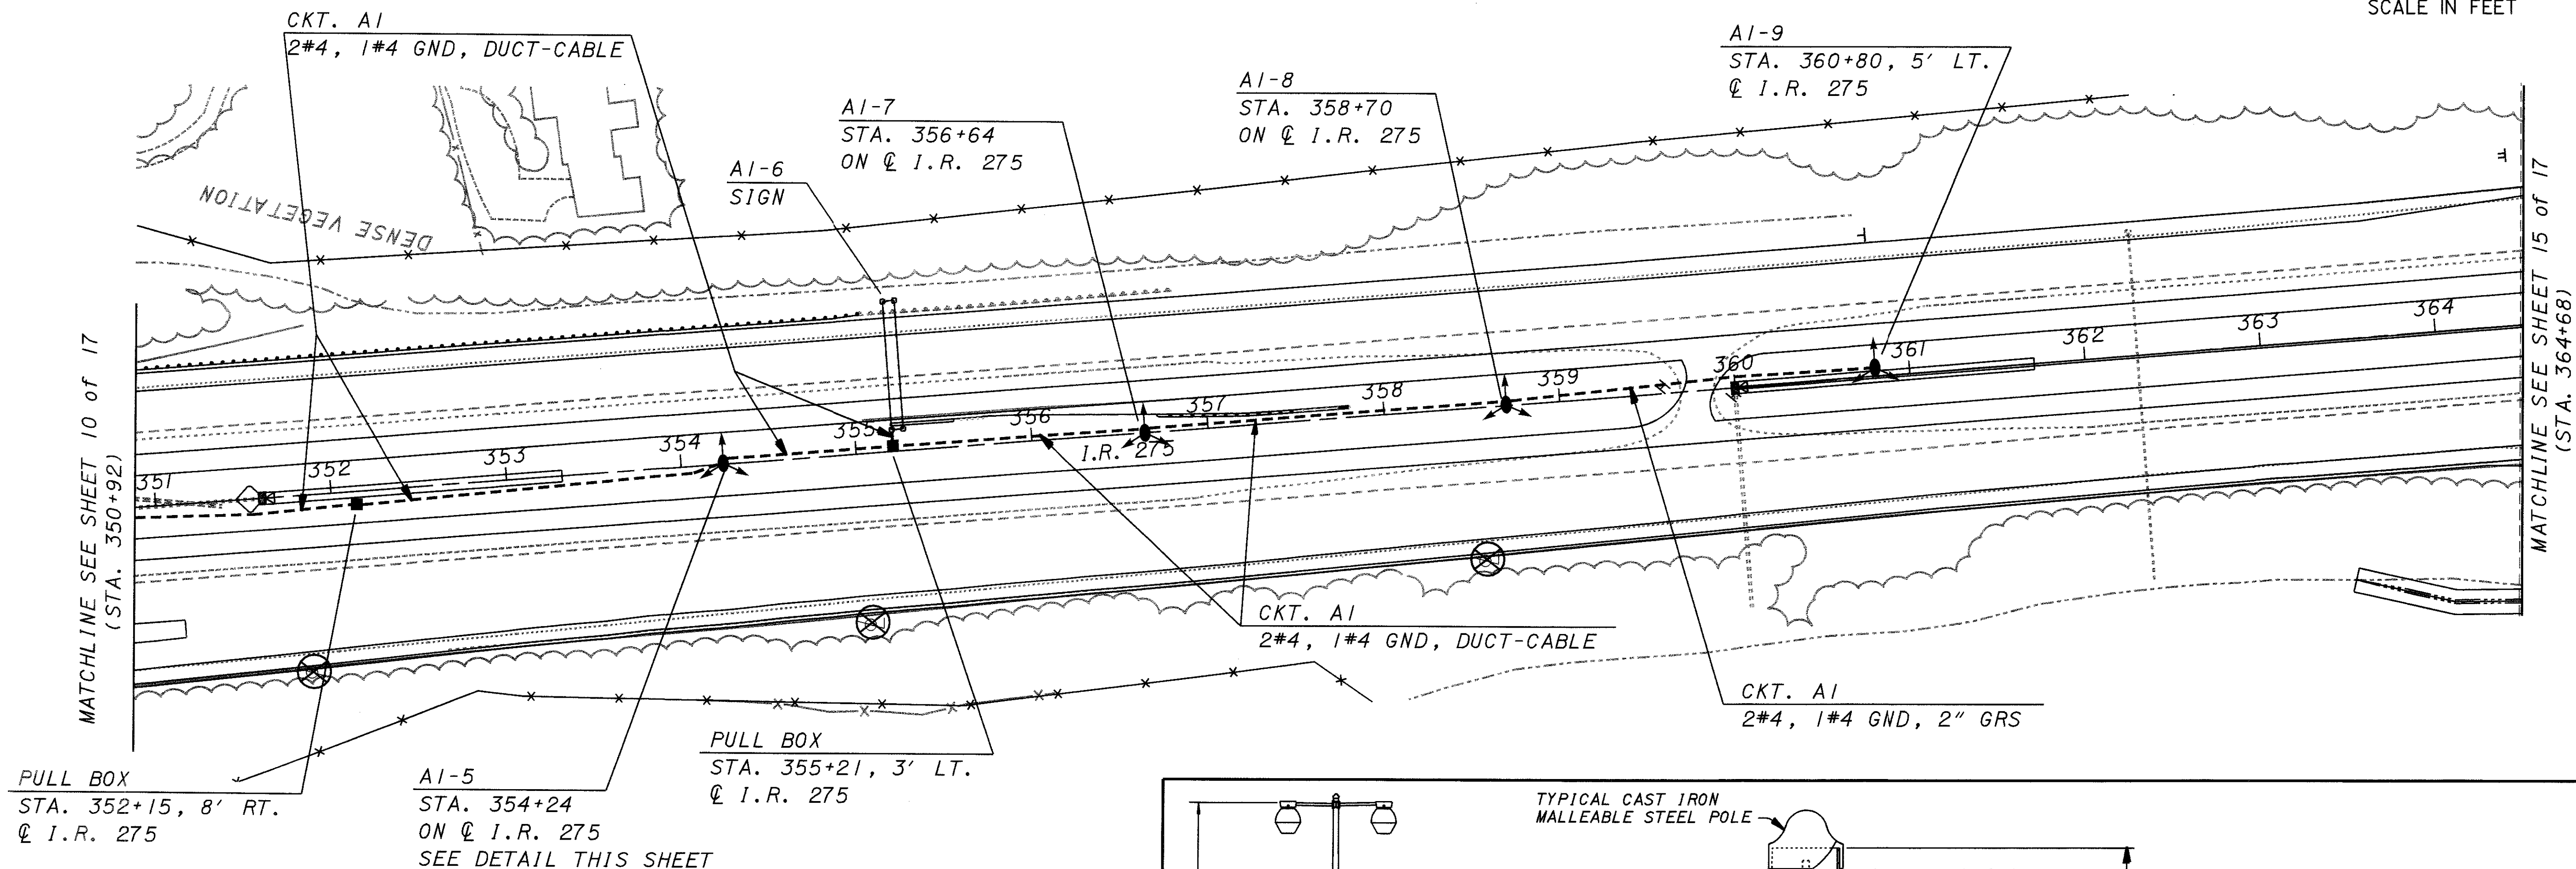