


EXISTING LIGHT STANDARD ICH8 TO REMAIN IN PLACE. DISCONNECT AND REMOVE THE EXISTING CABLES FEEDING THE LIGHTS TO THE EAST THAT ARE TO BE REMOVED. CLOSE CIRCUIT SUCH THAT THIS LIGHT IS THE END OF CIRCUIT #1CH.

EXISTING CIRCUIT CABLES (U.I.P.)
EXISTING CIRCUIT CABLES
TO BE ABANDONED.

MATCHLINE SEE THIS SHEET
(STA. 122+11)

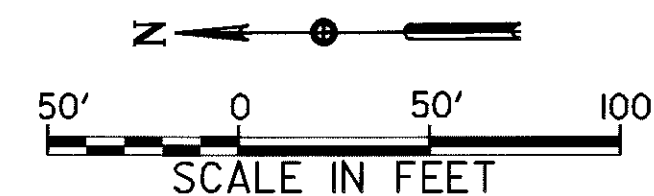

A3-12
STA. 124+30, 74' LT.
U.S. 50
SEE PLAN NOTE 2.

A3-11
STA. 122+90, 74' LT.
U.S. 50

A3-8
STA. 124+30, 77' RT.
U.S. 50
SEE PLAN NOTE 2.
CKT. A3

A3-7
STA. 122+90, 77' RT.
U.S. 50

CKT. A3
2#4, 1#4 GND, DUCT-CABLE

BI-6
STA. 115+60, 60' LT.
RAMP E

CKT. A3
2#4, 1#4 GND, DUCT-CABLE

A3-6
STA. 324+80, 17' LT.
RAMP H

CKT. A3
2#4, 1#4 GND, 2" PVC

PULL BOX
STA. 325+25, 32' RT. RAMP H

CKT. A3
2#4, 1#4 GND, 3" GRS

CKT. A3
2#4, 1#4 GND, DUCT-CABLE

A3-5
STA. 327+46, 92' RT.
RAMP H

PULL BOX
STA. 329+71, 70' RT.
RAMP H

CKT. A3
2#4, 1#4 GND,
DUCT-CABLE

A3-3
STA. 332+10, 85' RT.
RAMP H

CKT. A3
2#4, 1#4 GND, DUCT-CABLE

PULL BOX
STA. 113+86, 78' RT.
U.S. 50

CKT. BI
2#4, 1#4 GND,
DUCT-CABLE

CKT. BI
2#4, 1#4 GND,
2" GRS

PULL BOX
STA. 323+78, 32' RT.
RAMP D

MATCHLINE SEE SHEET 9 of 17
(STA. 112+71)

PLAN NOTES

- LUMINAIRES ON THIS TOWER SHALL BE EQUIPPED WITH 120 DEGREE SHIELDS. INSTALL SHIELDS ON THE ROW SIDE OF THE LUMINAIRES.
- PROVIDE EMPTY 2" CONDUIT ELL FOR FUTURE EXPANSION TO THE EAST.

LEGEND

- HIGH MAST TOWER. SEE LIGHT TOWER SCHEDULE
- EXISTING LIGHT POLE ASSEMBLY AND FOUNDATION TO BE REMOVED
- EXISTING PULL BOX TO BE REMOVED
- CONDUIT OR DUCT-CABLE AS NOTED
- PULL BOX
- LOW MAST LIGHTING UNIT. SEE LIGHT POLE SCHEDULE
- CONVENTIONAL LIGHT STANDARD, SEE LIGHT POLE SCHEDULE FOR MOUNTING HEIGHT WITH 15' BRACKET ARM AND 200 W HPS COBRA HEAD LUMINAIRE
- POLE DESIGNATION, "B" IS THE CONTROL CENTER, "3" IS THE CIRCUIT NUMBER AND "4" IS THE I.D.

BI-2
STA. 324+00, 40' LT.
RAMP D
SEE PLAN NOTE 1.

1:\3147\dwgs\LP006.dgn

SSympton

06-JUN-2001