





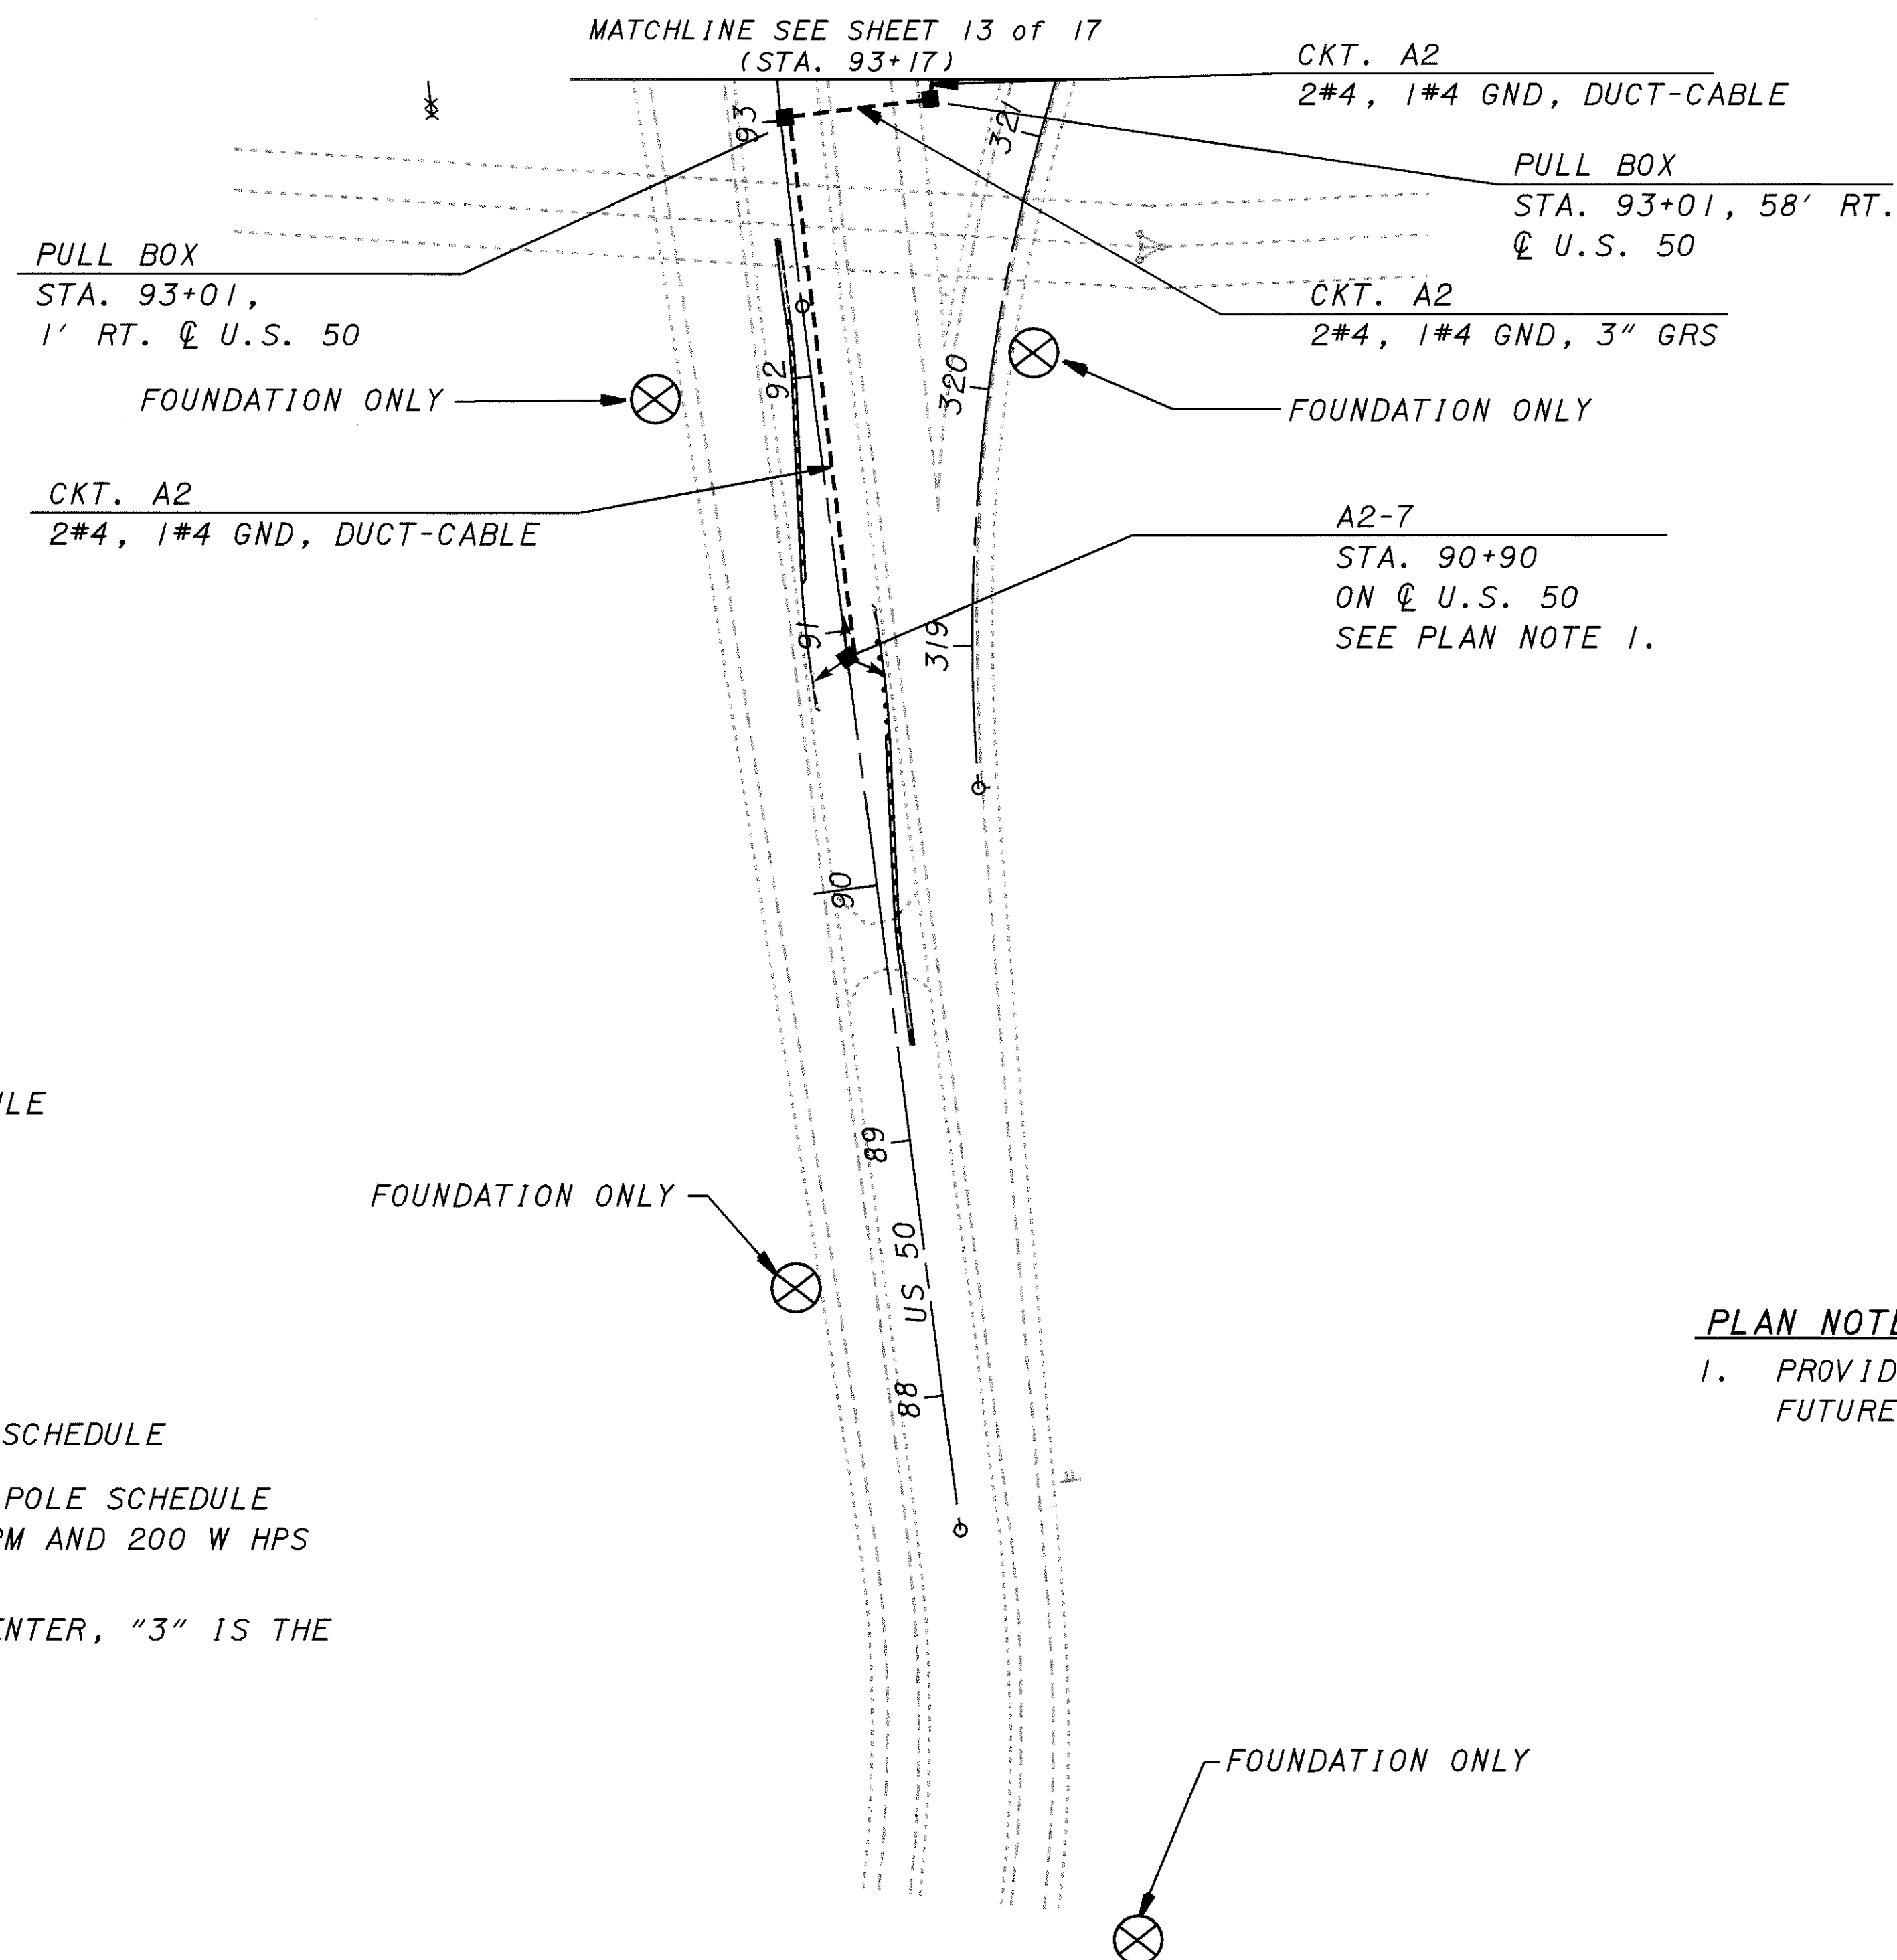


LEGEND

-  HIGH MAST TOWER. SEE LIGHT TOWER SCHEDULE
 EXISTING LIGHT POLE ASSEMBLY AND FOUNDATION TO BE REMOVED
 EXISTING PULL BOX TO BE REMOVED
 CONDUIT OR DUCT-CABLE AS NOTED
 PULL BOX
 LOW MAST LIGHTING UNIT. SEE LIGHT POLE SCHEDULE
 CONVENTIONAL LIGHT STANDARD, SEE LIGHT POLE SCHEDULE FOR MOUNTING HEIGHT WITH 15' BRACKET ARM AND 200 W HPS COBRA HEAD LUMINAIRE
B3-4 POLE DESIGNATION, "B" IS THE CONTROL CENTER, "3" IS THE CIRCUIT NUMBER AND "4" IS THE I.D.

PLAN NOTES

1. PROVIDE EMPTY 2" CONDUIT ELL FOR FUTURE EXPANSION TO THE WEST.

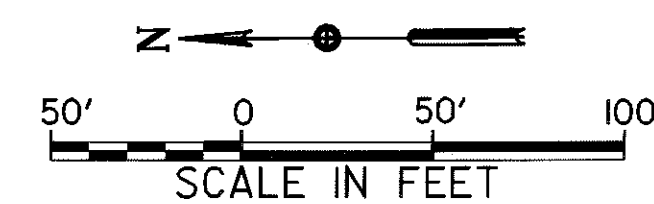

LIGHTING PLAN - IR 275
 STA. 84+41 TO STA. 93+17
 CLE-275-05.35

CLE-275-05.35

14/17

626
857