
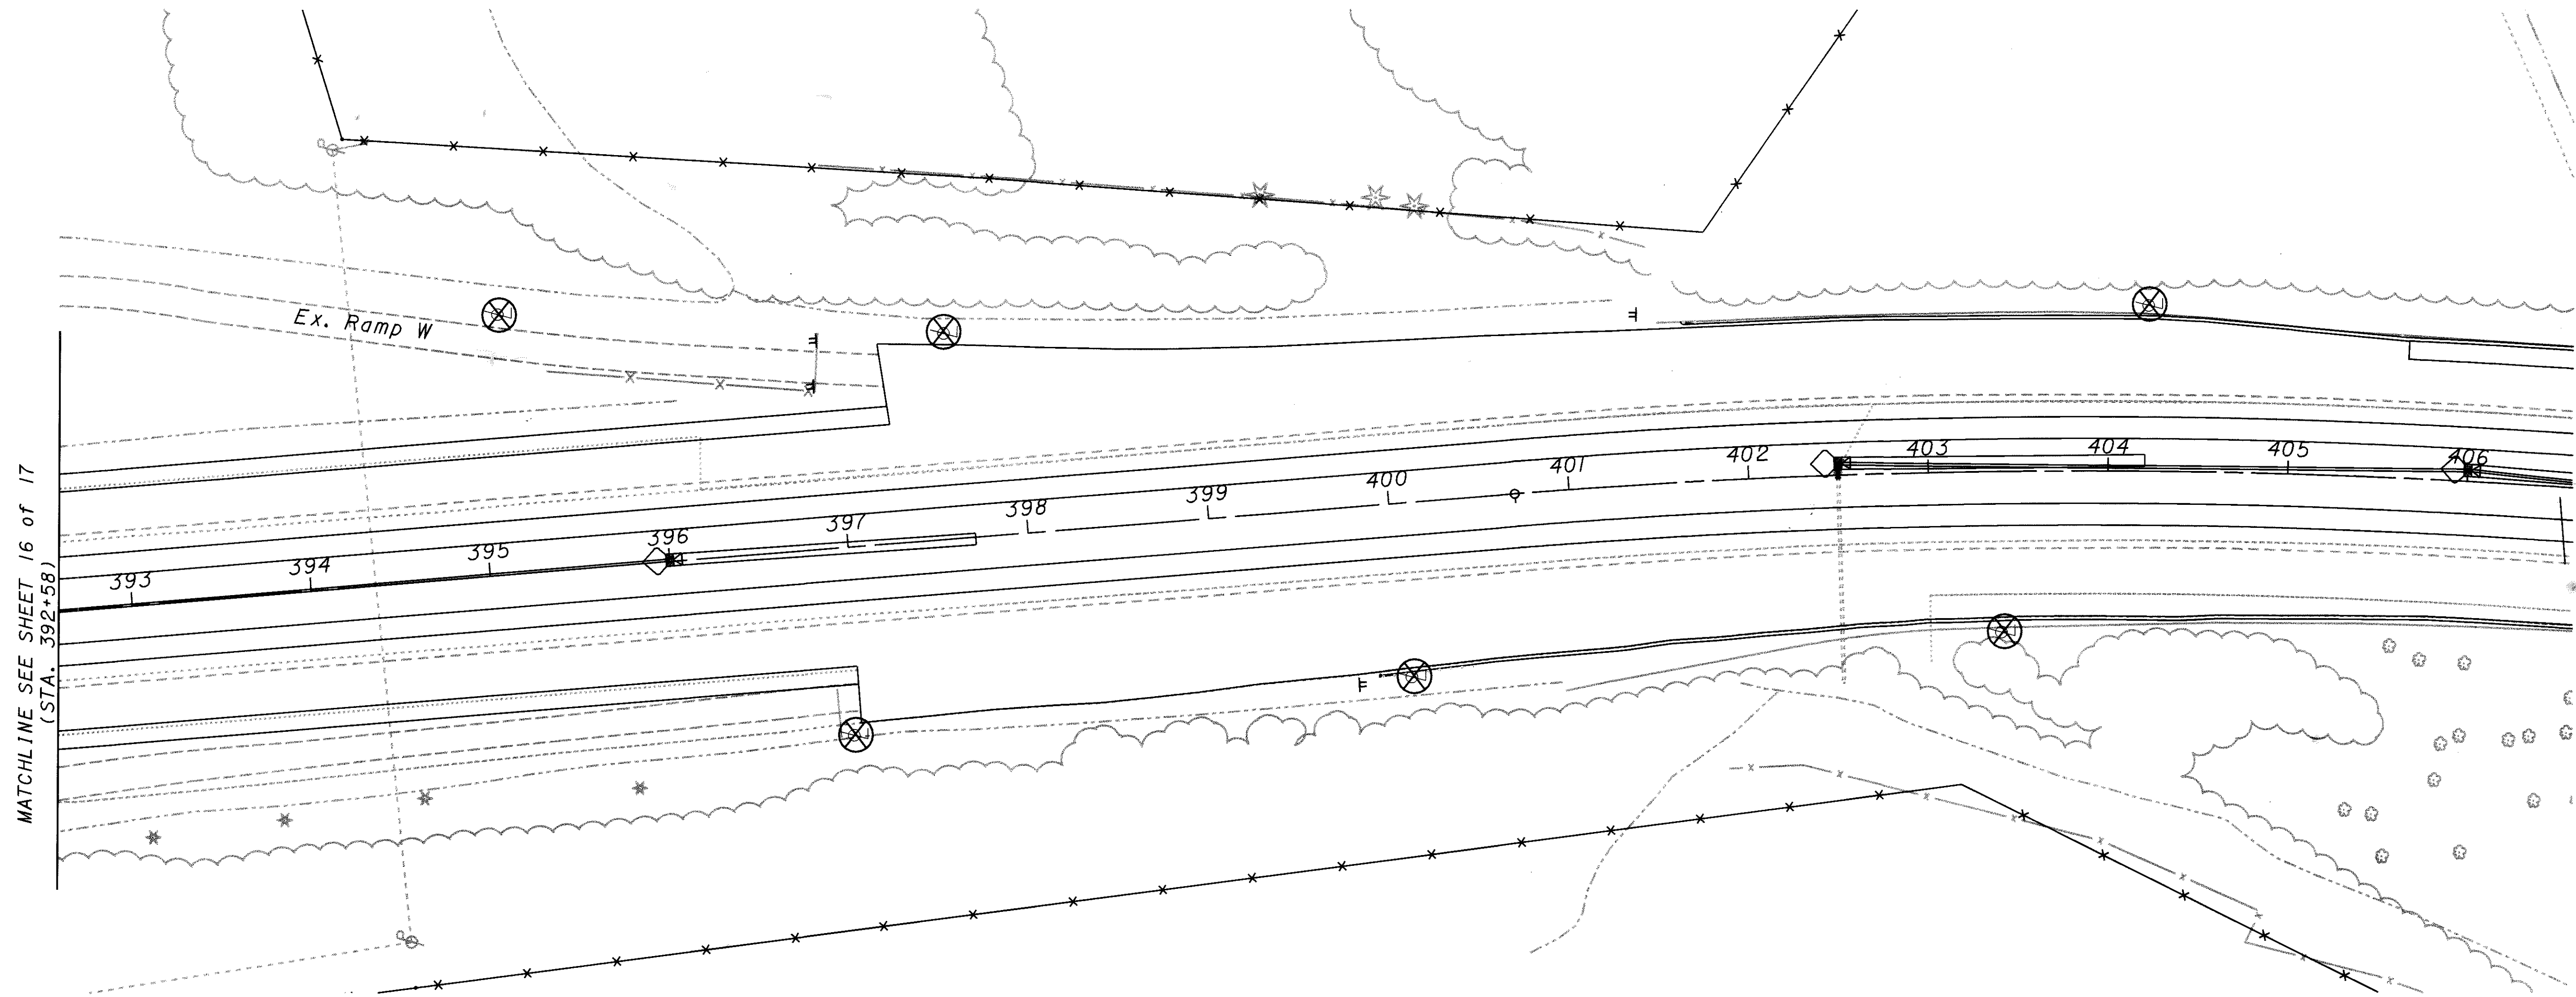



**LEGEND**

-  HIGH MAST TOWER. SEE LIGHT TOWER SCHEDULE
-  EXISTING LIGHT POLE ASSEMBLY AND FOUNDATION TO BE REMOVED
-  EXISTING PULL BOX TO BE REMOVED
-  CONDUIT OR DUCT-CABLE AS NOTED
-  PULL BOX
-  LOW MAST LIGHTING UNIT. SEE LIGHT POLE SCHEDULE
-  CONVENTIONAL LIGHT STANDARD, SEE LIGHT POLE SCHEDULE FOR MOUNTING HEIGHT WITH 15' BRACKET ARM AND 200 W HPS COBRA HEAD LUMINAIRE
- B3-4 POLE DESIGNATION, "B" IS THE CONTROL CENTER, "3" IS THE CIRCUIT NUMBER AND "4" IS THE I.D.

