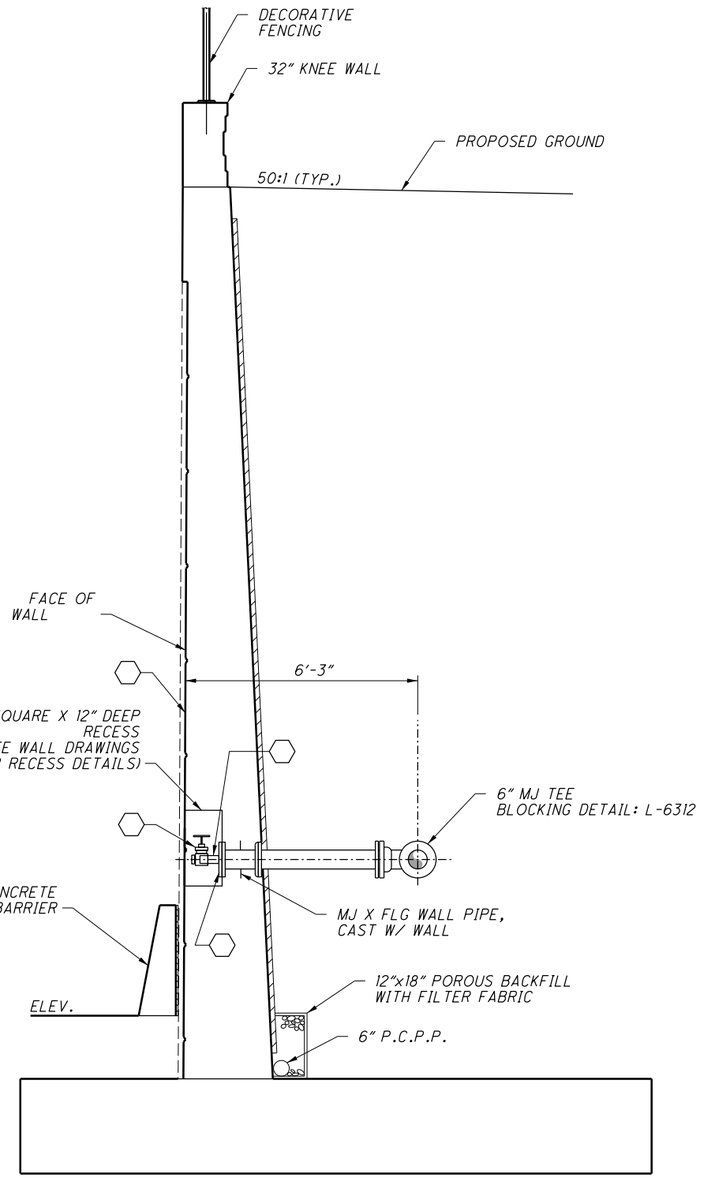
DECORATIVE FENCING
32" KNEE WALL
PROPOSED GROUND
50:1 (TYP.)
FACE OF WALL
6'-3"
24" SQUARE X 12" DEEP RECESS (SEE WALL DRAWINGS FOR RECESS DETAILS)
6" MJ TEE BLOCKING DETAIL: L-6312
CONCRETE BARRIER
MJ X FLG WALL PIPE, CAST W/ WALL
ELEV.
12"x18" POROUS BACKFILL WITH FILTER FABRIC
6" P.C.P.P.

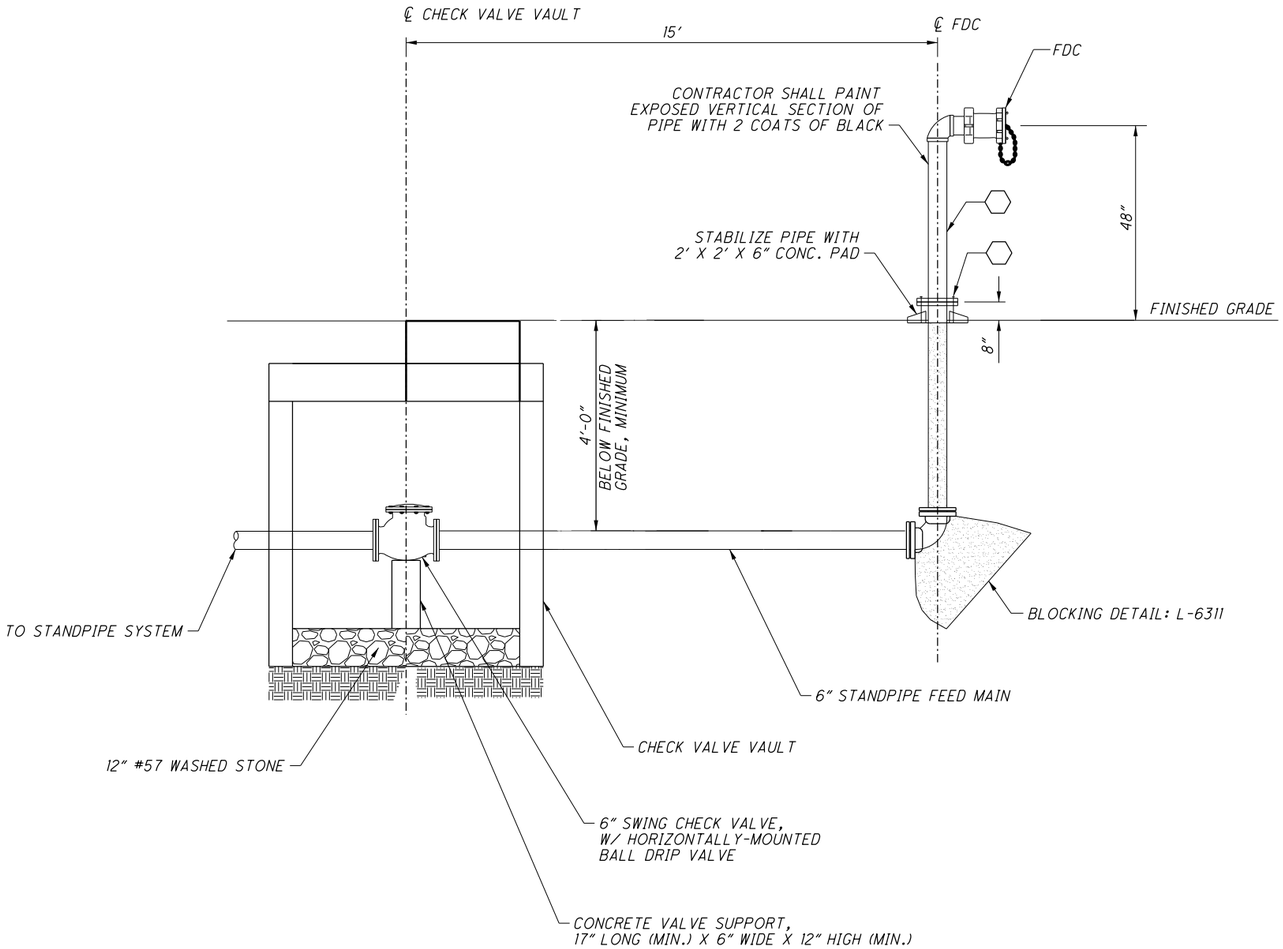
℄ CHECK VALVE VAULT
15'
℄ FDC
FDC
CONTRACTOR SHALL PAINT EXPOSED VERTICAL SECTION OF PIPE WITH 2 COATS OF BLACK
STABILIZE PIPE WITH 2' X 2' X 6" CONC. PAD
48"
FINISHED GRADE
8"
4'-0" BELOW FINISHED GRADE, MINIMUM
TO STANDPIPE SYSTEM
BLOCKING DETAIL: L-6311
6" STANDPIPE FEED MAIN
CHECK VALVE VAULT
12" #57 WASHED STONE
6" SWING CHECK VALVE, W/ HORIZONTALLY-MOUNTED BALL DRIP VALVE
CONCRETE VALVE SUPPORT, 17" LONG (MIN.) X 6" WIDE X 12" HIGH (MIN.)